

Job Name: 25-4566 - Government Center
Job Location: Henry Co, TN
Contractor: Parker Excavating, LLC.

Plant: Beaver Dam
6/2/2026 4:00:54 PM

Tech: S. Felletter
PC: J. Jarvis



Structure ID: SCI 9 (16)



P2 MH048LD10SP

MH FLAT TOP - TDOT NO 12 (28"x34" Hole) F/F

P3) 28" x 34" - CASTING HEIGHT - 7"
P2) 48" - MH FLAT TOP - TDOT NO 12 (28"x34" Hole) F/F - 10"
P1) 48" - MH BASE Custom Ht F/n - 47"
1) CASTING - JBS 3123 MODIFIED SET
1) 48" - Conseal CS-102 1.00"
1) 28" x 34" - Conseal CS-102 1.00"
1) Hole - 30
1) Hole - 24

0 lb
1497 lb
4100 lb
250 lb
0 lb
0 lb
0 lb
0 lb
0 lb
Structure Total: 5847 lb

Structure Notes:
1. PER TDOT D-CB-12RA / ASTM C478 SPEC'S.
2. CONCRETE = 4,000 PSI AT 28 DAYS
3. NO INVERT CHANNEL.
4. CASTING BY ICAST (TDOT TY. 12 - JBS 3123 MOD SINGLE SET).
REINFORCING PER ASTM 615 (GRADE 60).
PER TDOT STD DRAWING D-CB-12RA.
- TOP SLAB - DBL MAT #5 BARS
- RISER (As .24)
- FLOOR (As .62) #5 BARS @ 6" C.C.E.W.

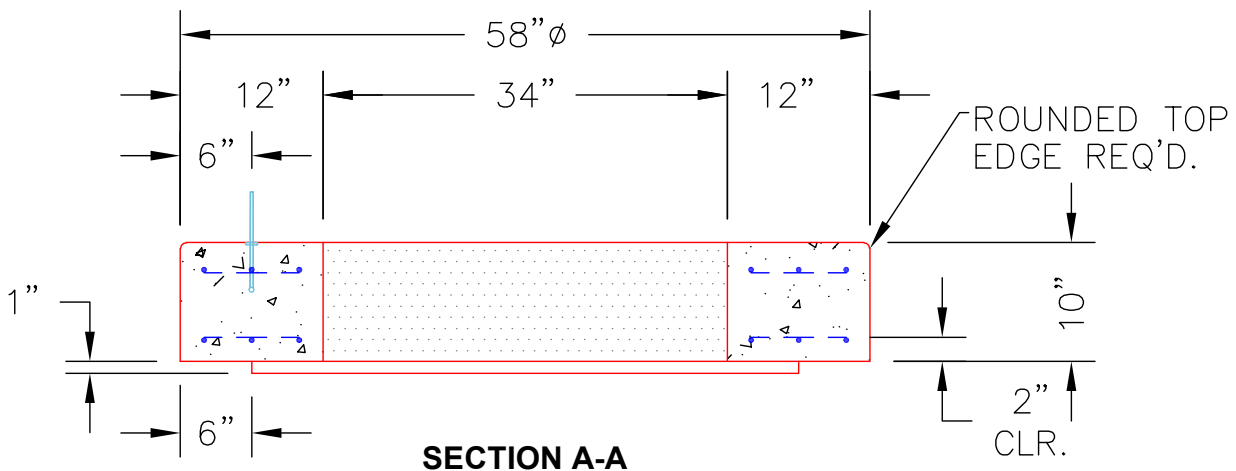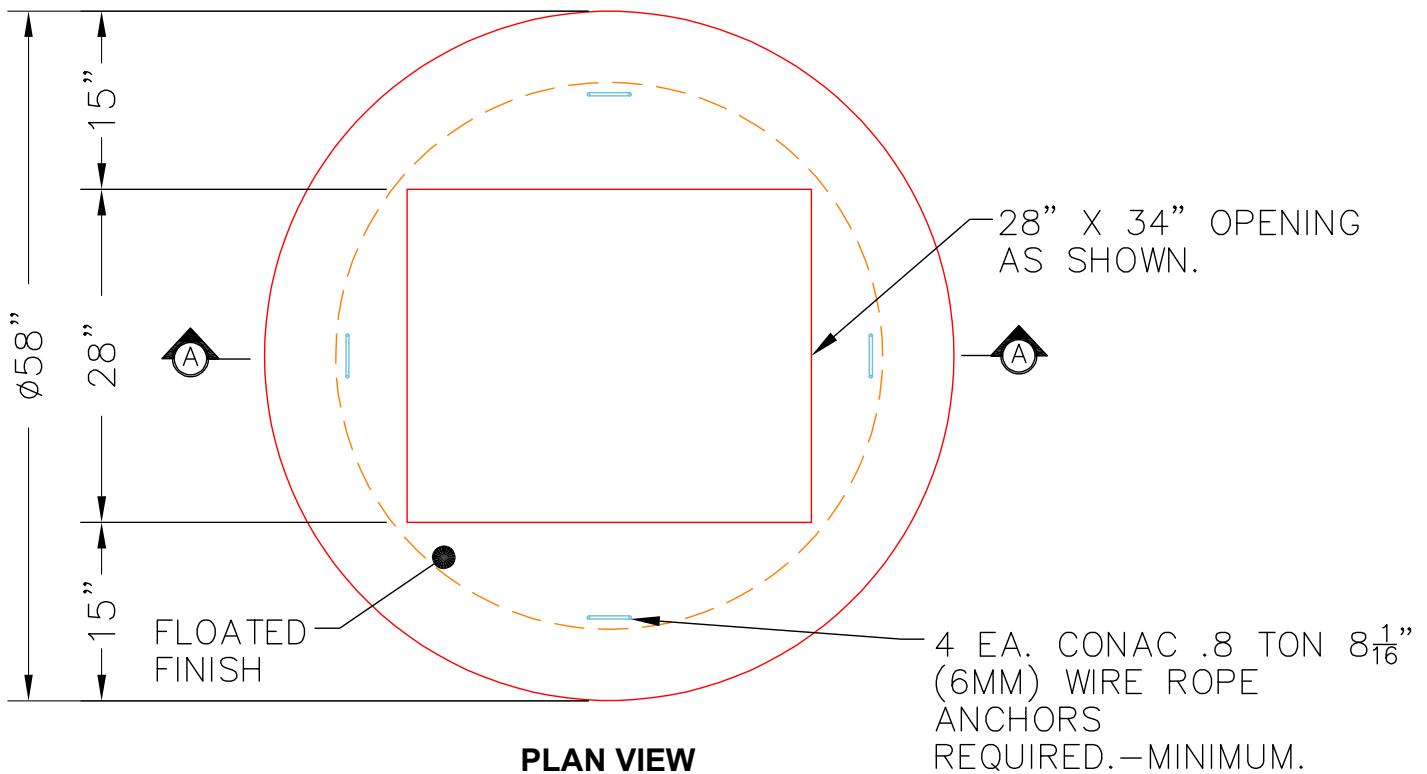

Coating (Int):
Coating (Ext):

Seam Up: Flat
Seam Dn: Flat

Wall Thickness: 5"

Height (Ext): 10"

Weight (Net): 1497 lb
Volume (Net): 0.38cu.yd