
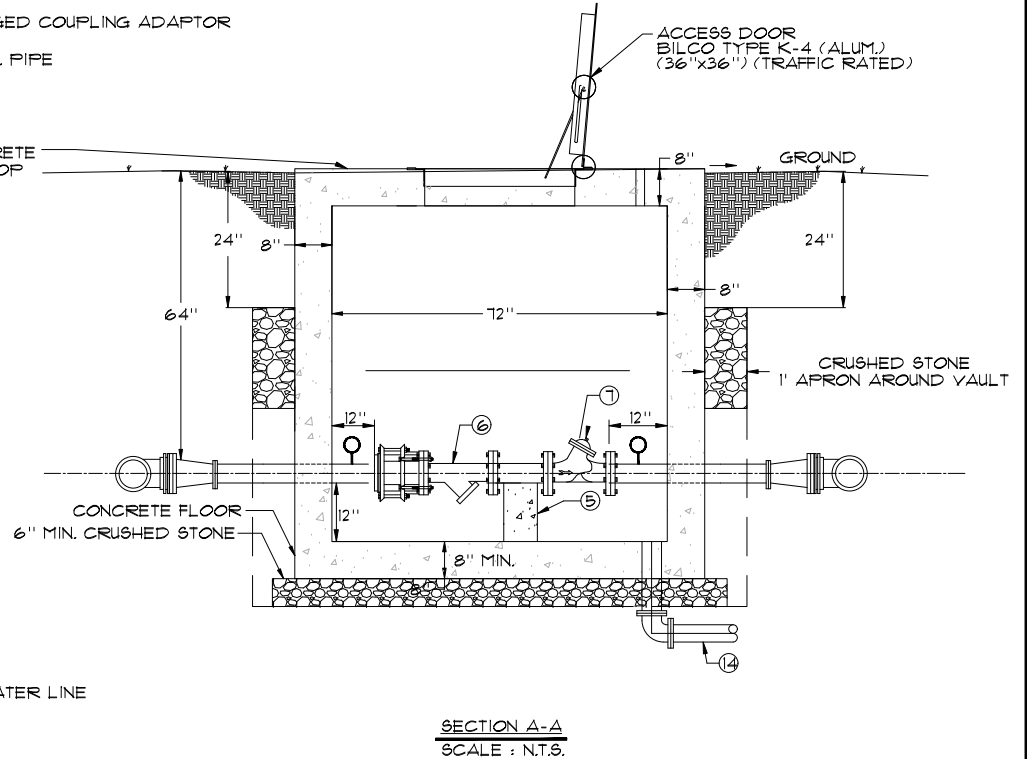


SPECIAL PRE-ASSEMBLY PERFORMED BY ICAST
JOB NUMBER: 25-4668
STRUCTURE: 54668 (4)

LEGEND

- | | |
|------------------------------------------------------------|----------------------------------------------------------------------------|
| ① 2 - 6"X6" TAPPING SLEEVE & VALVE | ⑨ 2 - 2" BRONZE GATE VALVE (LUNKENHEIMER #2151) |
| ② 1 - 6" INSERTION VALVE | ⑩ 2" BRASS PIPE |
| ③ 2 - 6" 90° M.J. BEND | ⑪ 1 - 2" PRV BERMAD MODEL WW-2"-T20-EN-P2-Y-C-A5-EB-NN-INV |
| ④ 2 - 6"X4" M.J. REDUCER | ⑫ 2 - PRESSURE GAUGE W/ VALVE ASHCROFT 4 1/2" DURAGAUGE W/ 0-200 psi RANGE |
| ⑤ CONCRETE SUPPORT AS REQUIRED | ⑬ MANHOLE STEPS |
| ⑥ 1 - 4" BERMAD 10F STRAINER | ⑭ 4" PVC DRAIN LINE, DRAIN TO DAYLIGHT (LOCATION TO BE FIELD VERIFIED) |
| ⑦ 1 - 4" PRV BERMAD MODEL WW-4"-T20-EN-P2-Y-C-A5-EB-NN-INV | ⑮ FLANGED COUPLING ADAPTOR |
| ⑧ 4" D.I. PIPE | ⑯ 6" D.I. PIPE |


NOTE : PRV INLET PRESSURE 78 psi
 OUTLET PRESSURE 58 psi

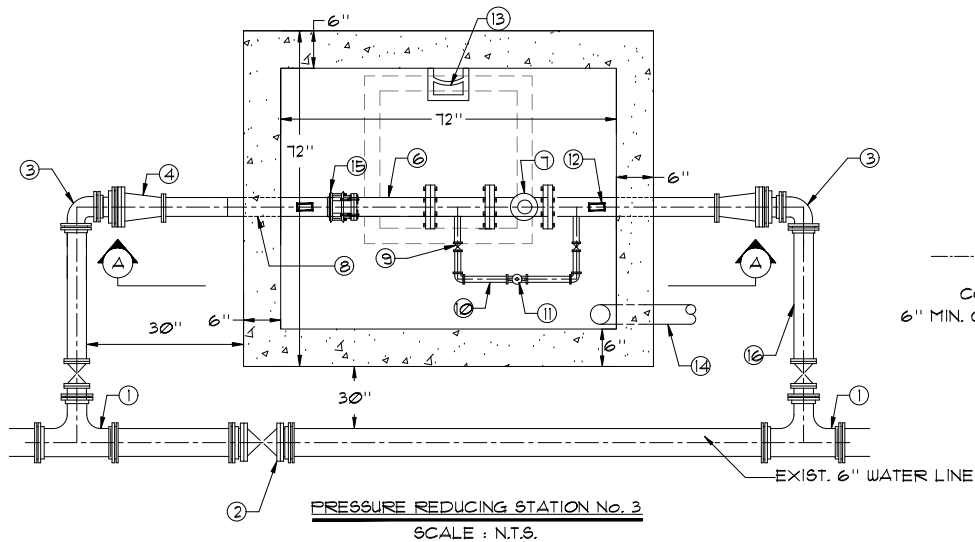

PROJECT: 4313.000-021 DATE: NOV. 2025		SCALE: NTS	
DESIGNED BY	NAME	DATE	
DRAWN BY	DPS	11/2025	
CHECKED BY	BGB	11/2025	
RECORD DUGS			



3 HMB CIRCLE
 FRANKFORT, KENTUCKY
 (502) 695-9800
 (502) 695-9810 FAX



LAGRANGE UTILITIES COMMISSION
SINGLE PRESSURE ZONE PROJECT
OLDHAM COUNTY, KENTUCKY
JERICO ROAD
PRESSURE REDUCING VALVE VAULT

SHEET
 SD3