



Job Name: 25-4733 - The Paddock Job Location: Springfield, KY Contractor: Core & Main LP (Lou)					Plant: 100 5/4/2026 6:49:41 PM		Tech: Jared - F PC: T. Lewis						
Structure ID: SSWR-6													
P2 MH048RS24		MH RISER T/G											
P4) 24" - CASTING HEIGHT - 7" P3) 48" - ECC CONE w/ 24" HOLE F/G - 36" P2) 48" - MH RISER T/G - 24" P1) 48" - MH BASE T/n - 24" 1) JOINT WRAP - 0.065"x6"x50' CONSEAL CS212 1) JOINT WRAP PRIMER - CONSEAL CS-75 (1 gal.) 1) 48" - MH INVERT CHANNEL - FULL HEIGHT 1) CASTING - HOE MC-315 F/C Sanitary 2) 48" - Conseal CS-102 1.00" (Double) 2) PSX - 12M NYLO 1) PSX - 12-06 NYLO 6) MH Step ML-10-TDS-NCR - 10"						0 lb 3000 lb 1677 lb 2863 lb 0 lb 0 lb 1440 lb 258 lb 0 lb 16 lb 8 lb 0 lb ----- Structure Total: 9262 lb		Structure Notes: 1. PER ASTM C478 SPECIFICATIONS. 2. CONCRETE = 4,000 PSI AT 28 DAYS. 3. CASTING BY ICAST (HOE MC-315 F/C SANITARY). REINFORCING PER ASTM A615 (GRADE 60). - CONE (As .12) - RISER/WALLS (As .12) - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.					
Rim: 892.81' Rim to Invert: 7.59' Slack: 2.08" Sump: 2" Step Position: 90°													
Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up (_)	Offset			
Invert 1													
Invert 2													
Invert 3													
Invert 4													
Invert 5													
Invert 6													
Invert 7													
Invert 8													

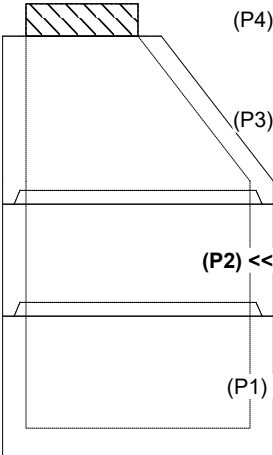


RIGHT-SIDE UP VIEW (int. dimensions)

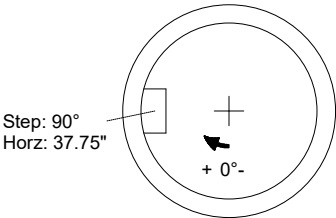

Step: 90°
Horz: 37.75"
+ 0°

INSIDE WALL DIMENSIONS

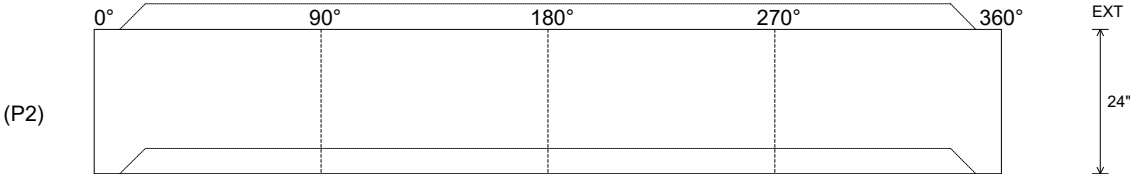

0° 90° 180° 270° 360°

(P2)

EXT
24"

Coating (Int): Coating (Ext):	Seam Up: Tongue Seam Dn: Groove	Wall Thickness: 5" Floor Height: 0"	Height (Int): 24" Height (Ext): 24"	Weight (Net): 1677 lb Volume (Net): 0.43cu.yd
----------------------------------	------------------------------------	--	--	--