



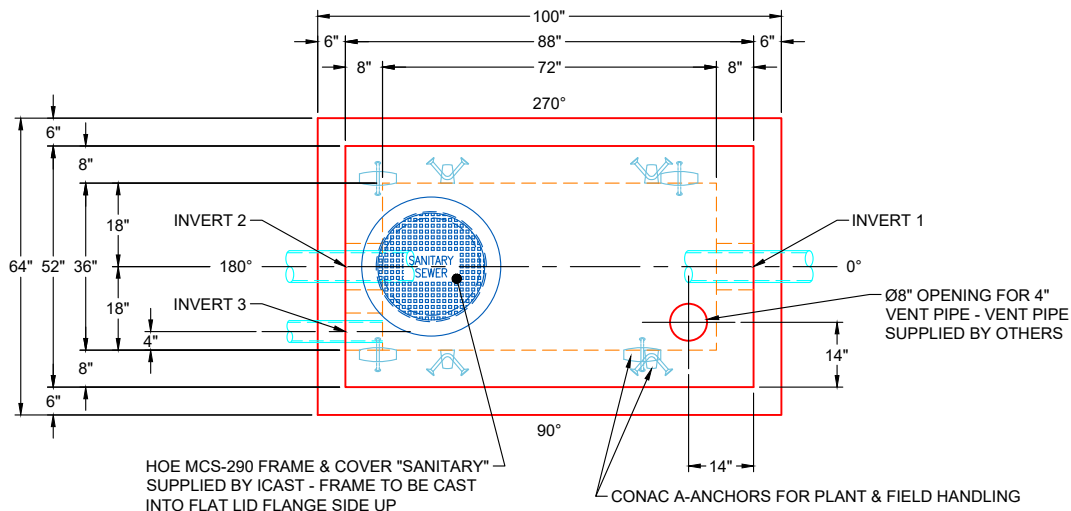


**PLAN VIEW**

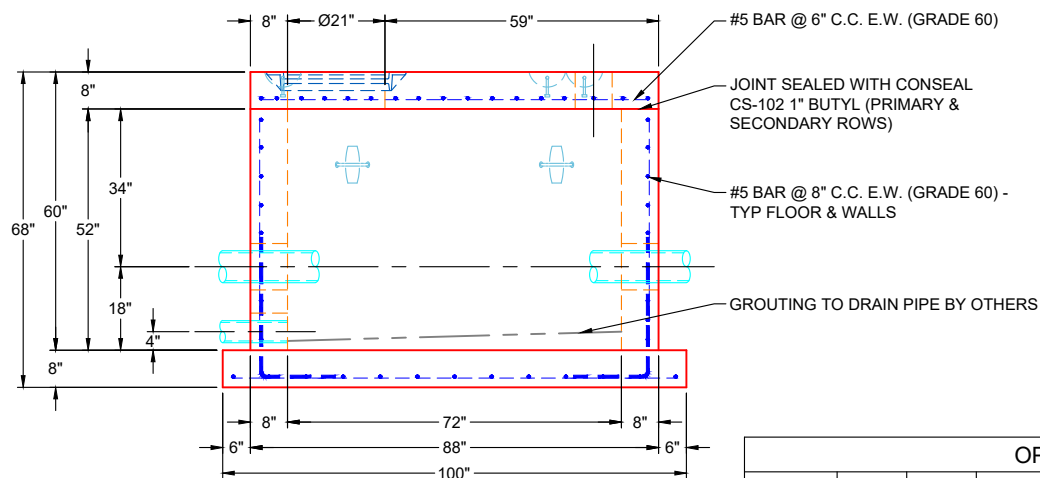

**FRONT VIEW**

**OPENINGS**

| PIPE ID  | ELEV    | ANGLE | PIPE  | PIPE OD | HOLE | CONNECTOR | UP FROM BOTTOM |
|----------|---------|-------|-------|---------|------|-----------|----------------|
| INVERT 1 | 968.25' | 0°    | 6" DI | 6.875"  | 10"  | HOLE 10   | 13"            |
| INVERT 2 | 968.25' | 180°  | 6" DI | 6.875"  | 10"  | HOLE 10   | 13"            |
| INVERT 3 | 967.17' | 180°  | 4" DI | 4.75"   | 8"   | HOLE 8    | 0"             |

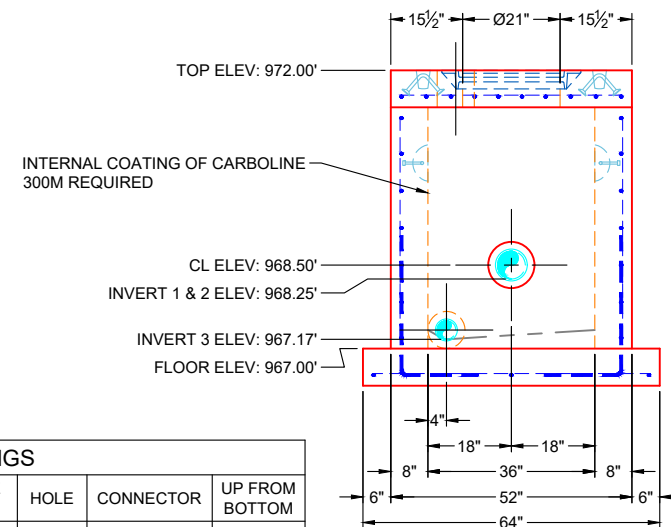

**SIDE VIEW**

**GENERAL NOTES:**

1. MANUFACTURED PER ASTM C-913 SPECIFICATIONS
2. CONCRETE: 5,000 PSI AT 28 DAYS
3. REINFORCEMENT:  
- FLAT LID: #5 BAR @ 6" C.C. E.W. (GRADE 60)  
- BASE: #5 BAR @ 8" C.C. E.W. (GRADE 60)
4. WEIGHTS:  
8" FLAT LID 2,925 LBS  
52" BASE W/ 6" EXT. FLANGE 12,882 LBS  
TOTAL WEIGHT 15,807 LBS
5. HOE MCS-290 FRAME & COVER "SANITARY" SUPPLIED BY ICAST - FRAME TO BE CAST INTO FLAT LID FLANGE SIDE UP
6. JOINT SEALANT: CONSEAL CS-102 - 1" (PRIMARY & SECONDARY ROWS)
7. CARBONLINE 300M INTERNAL COATING REQUIRED
8. 4" VENT PIPE SUPPLIED BY OTHERS
9. OPENINGS TO BE GROUTED (BY OTHERS)

**REVISION INFORMATION**

REV. DATE: NO REVISIONS TO DATE



SUBMITTAL DRAWING: 36" X 72" VAULT (YORK LANE PS)

CUSTOMER: CONNHURST, LLC

PROJECT: PERRYVILLE & JUNCTION CITY WW IMPROVEMENTS

STRUCTURE: 61038 (2)

QUOTE/SALES ORDER NO: 26-1038

CHECKED BY: B. SMITH DRAWN BY: K. CARDWELL

DATE: 05/04/26 SCALE: NTS PG. 1 OF 1