
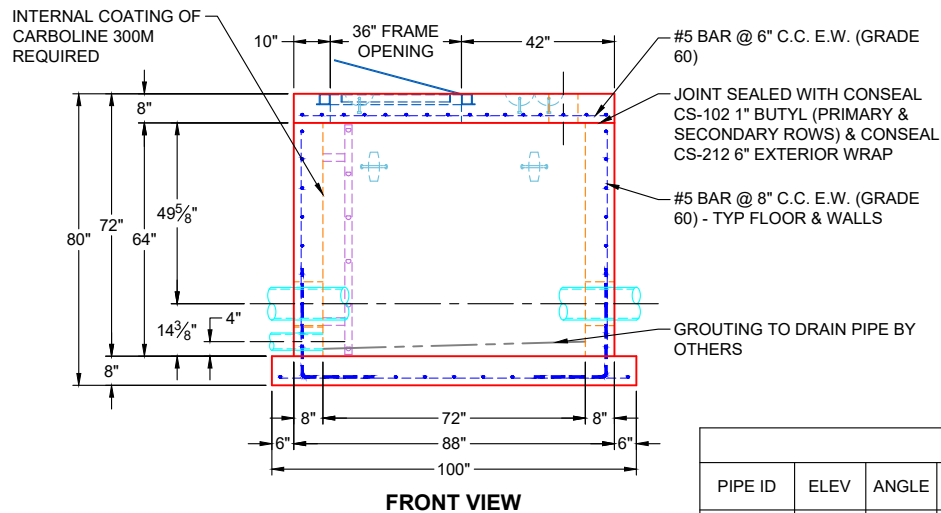


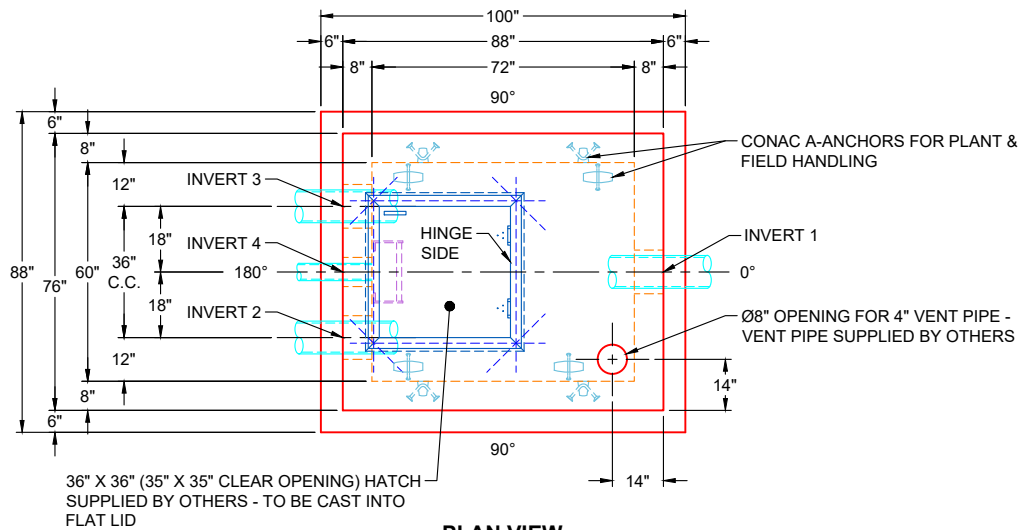


OPENINGS							
PIPE ID	ELEV	ANGLE	PIPE	PIPE OD	HOLE	CONNECTOR	UP FROM BOTTOM
INVERT 1	838.87'	0°	8" DI	9"	12"	HOLE 12	8.5"
INVERT 2	838.87'	180°	8" DI	9"	12"	HOLE 12	8.5"
INVERT 3	838.87'	180°	8" DI	9"	12"	HOLE 12	8.5"
INVERT 4	838.17'	180°	4" DI	4.75"	8"	HOLE 8	0"

GENERAL NOTES:

- MANUFACTURED PER ASTM C-913 SPECIFICATIONS
- CONCRETE: 5,000 PSI AT 28 DAYS
- REINFORCEMENT:
 - FLAT LID: #5 BAR @ 6" C.C. E.W. (GRADE 60)
 - BASE: #5 BAR @ 8" C.C. E.W. (GRADE 60)
- WEIGHTS:

8" FLAT LID	3,665 LBS
64" BASE W/ 6" EXT. FLANGE	18,363 LBS
TOTAL WEIGHT	22,028 LBS
- 36" X 36" (35" X 35" CLEAR OPENING) HATCH SUPPLIED BY OTHERS - TO BE CAST INTO FLAT LID
- HALLIDAY L1B 5' LADDER & L1EAA SAFETY POST SUPPLIED BY ICAST
- JOINT SEALANT: CONSEAL CS-102 - 1" (PRIMARY & SECONDARY ROWS)
EXTERIOR WRAP: CONSEAL CS-212 - 6"
- CARBONLINE 300M INTERNAL COATING REQUIRED
- 4" VENT PIPE SUPPLIED BY OTHERS
- OPENINGS TO BE GROUTED (BY OTHERS)

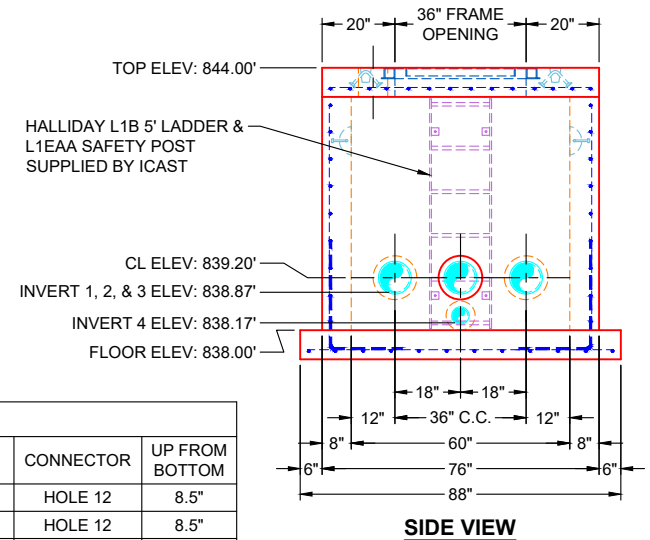

REVISION INFORMATION

REV. DATE: NO REVISIONS TO DATE



SUBMITTAL DRAWING: 60" X 72" VAULT (LEONARD FIELD P5)

CUSTOMER: CONNHURST, LLC

PROJECT: PERRYVILLE & JUNCTION CITY WW IMPROVEMENTS

STRUCTURE: 61038 (7)

QUOTE/SALES ORDER NO: 26-1038

CHECKED BY: B. SMITH

DRAWN BY: K. CARDWELL

DATE: 05/04/26

SCALE: NTS

PG. 1 OF 1