
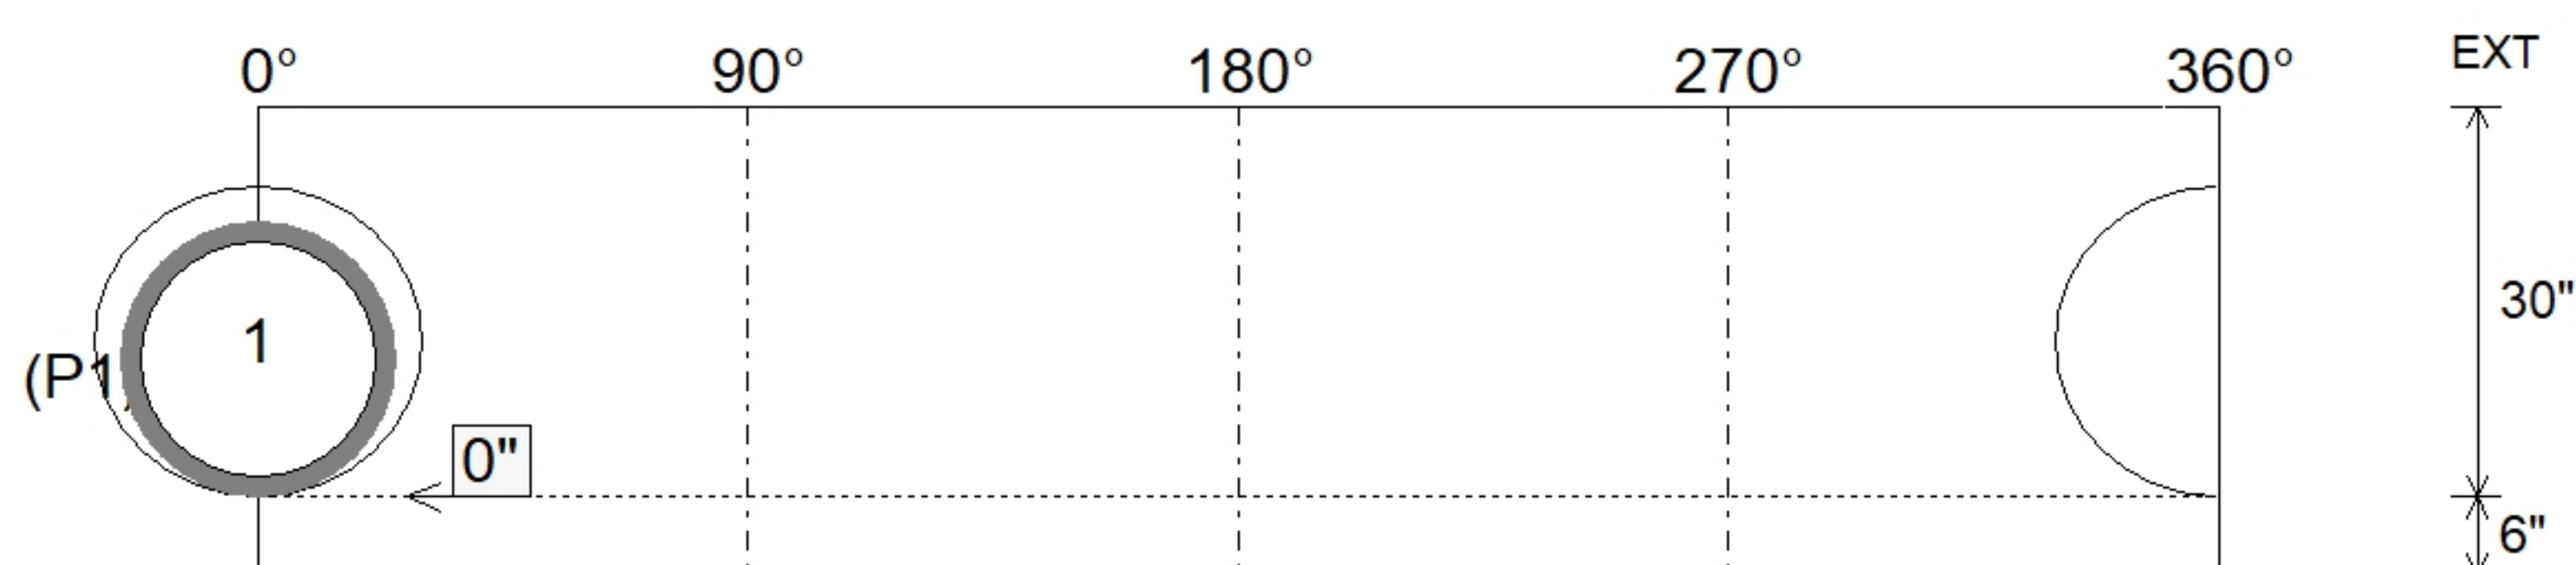


Structure Notes: . 1. PER ASTM C478 SPECIFICATIONS. 2. CONCRETE = 4,000 PSI AT 28 DAYS. 3. NO INVERT CHANNEL. 4. CASTING BY ICAST (EJ 6488 O BEEHIVE GRATE). . REINFORCING PER ASTM A615 (GRADE 60). - TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W.. - RISER/WALLS (As .12) - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.	STRUCTURE SUMMARY: P4) 24" - CASTING HEIGHT - 1.25" 0 lb P3) 24" - GRADE RING - 6" 405 lb P2) 48" - MH FLAT TOP w/ 24" Center Hole - 7" 1700 lb P1) 48" - MH BASE - 30" 3229 lb 1) CASTING - EJ 6488 O Beehive Grate 250 lb 1) 48" - Conseal CS-102 1.00" 0 lb 2) 24" - Conseal CS-102 1.00" 0 lb 1) Hole - 24 0 lb 2) MH Step ML-10-TDS-NCR - 10" 0 lb ----- Structure Total: 5584 lb
--	---

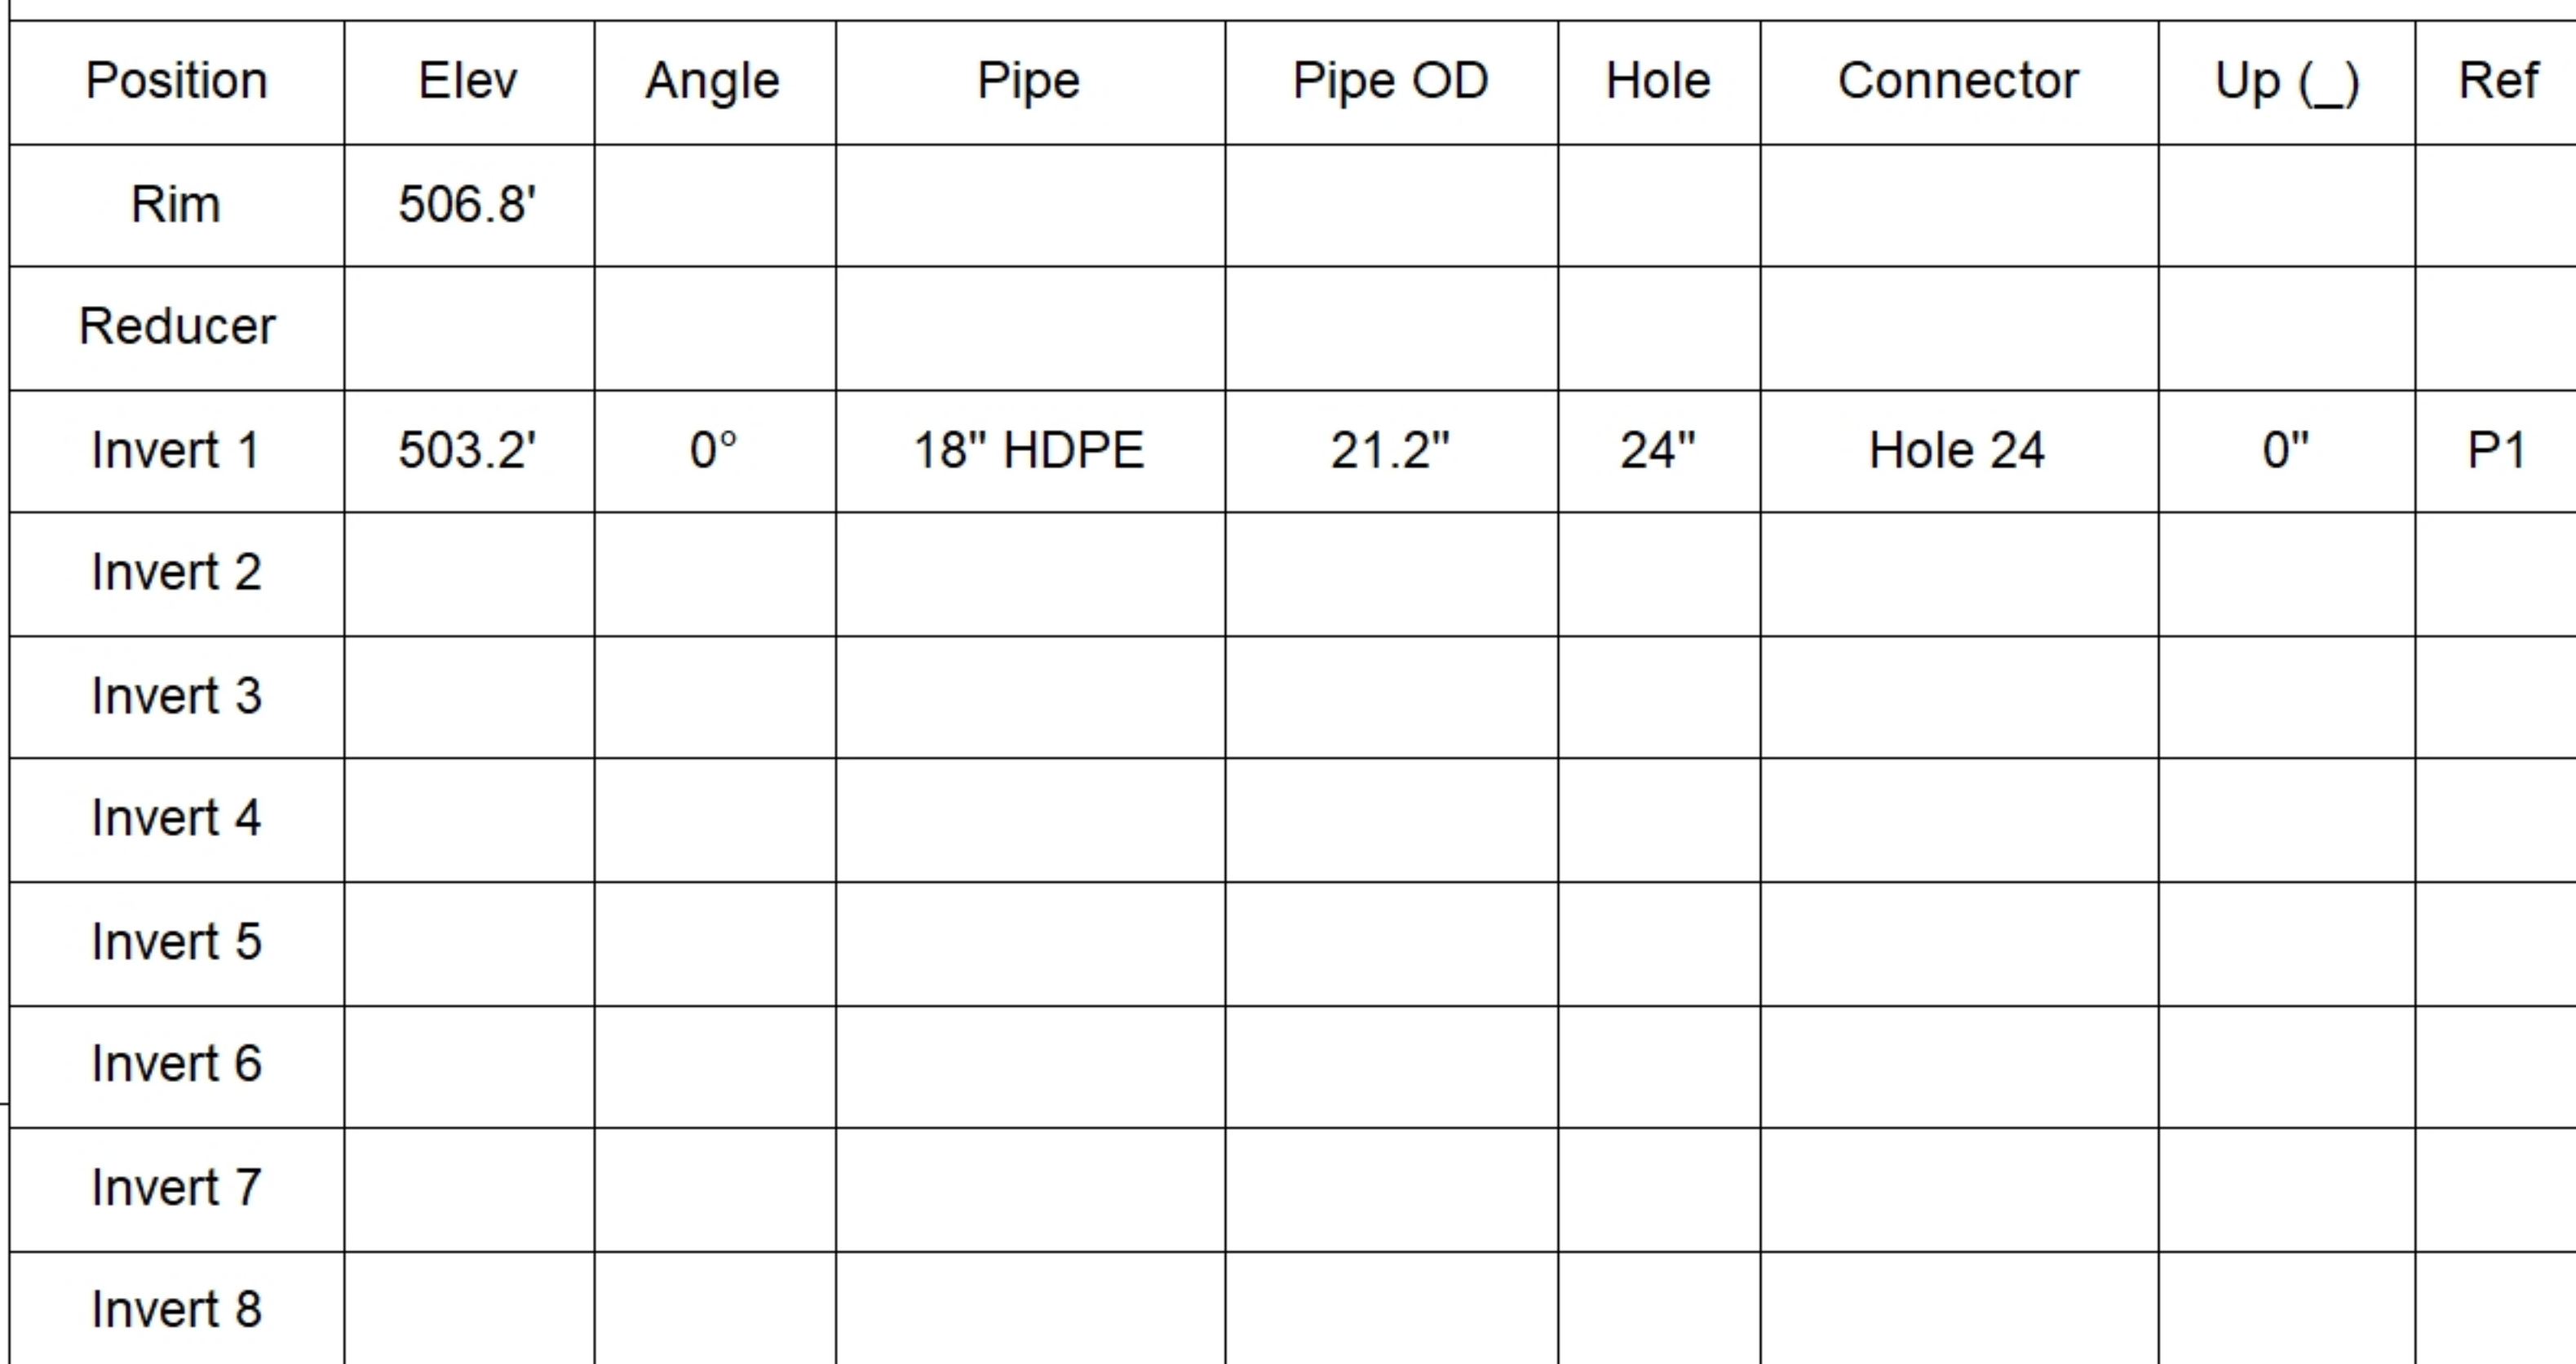

SUBMITTAL
APPROVED BY: