

Job Name: 26-1077 - Westside Markets of Greensboro Village
 Job Location: Gallatin, TN
 Contractor: Cleary Construction, Inc.

Plant: 100

Tech: J. Coppage - F

3/27/2026 8:29:17 PM

PC: C. Goff



Structure ID: A10A

P1 BX3636-08BAVF

BOX BASE 8inW, 8inF, Variable Ht F/n

- P2) 36" x 36" - CASTING HEIGHT - 4"
- P1) 36" x 36" - BOX BASE 8inW, 8inF, Variable Ht F/n - 37"
- 1) 36" x 36" - STORM INVERT CHANNEL (FLAT) - 4" THK
- 1) 36" x 36" - Conseal CS-102 1.00"
- 1) Hole - 24
- 4) Hole - 6

0 lb
 5760 lb
 450 lb
 0 lb
 0 lb
 0 lb

 Structure Total: 6210 lb

- Structure Notes:**
1. PER ASTM C913 SPECIFICATIONS.
 2. CONCRETE = 4,000 PSI AT 28 DAYS.
 3. NO STEPS.
 4. CASTING SUPPLIED BY OTHERS (JBS 4073 F/G).




REINFORCING PER ASTM A615 (GRADE 60).
 - WALLS (As .12) #5 BARS AT 12" C.C.E.W.
 - FLOOR (As .12) #5 BARS AT 12" C.C.E.W.

Rim: 498.83' Rim to Invert: 3.5' Slack: 2.6" Sump: 1.6" Step Position:


Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset
Invert 1	495.33'	30°	30.625"	18" HDPE	21.2"	Hole 24	24"	27.713"	0"	-9"
Invert 2	497.11'	0°	40.75"	4" HDPE (perf pipe)	4.8"	Hole 6	6"	6"	22.5"	14.75"
Invert 3	497.11'	90°	26"	4" HDPE (perf pipe)	4.8"	Hole 6	6"	6"	22.5"	0"
Invert 4	497.11'	180°	26"	4" HDPE (perf pipe)	4.8"	Hole 6	6"	6"	22.5"	0"
Invert 5	497.11'	270°	26"	4" HDPE (perf pipe)	4.8"	Hole 6	6"	6"	22.5"	0"
Invert 6										
Invert 7										
Invert 8										

RIGHT-SIDE UP VIEW (int. dimensions)

UPSIDE-DOWN VIEW (int. dimensions)

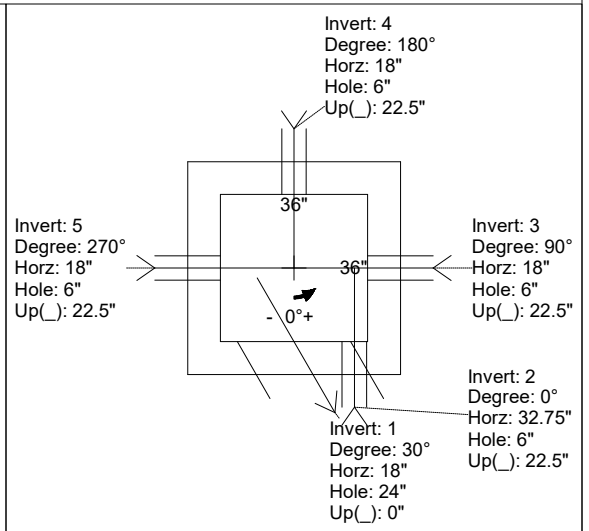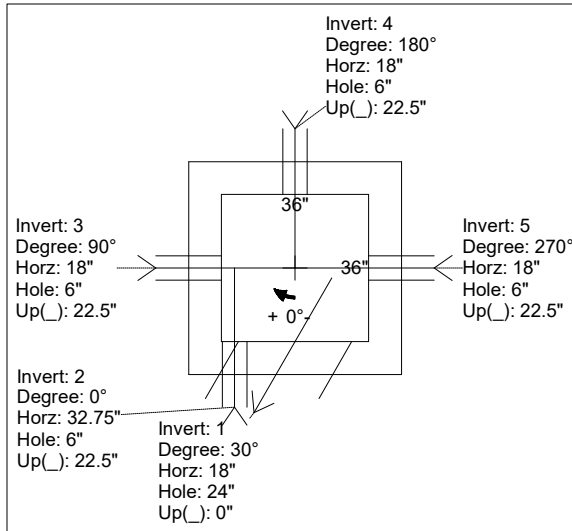

INSIDE WALL DIMENSIONS

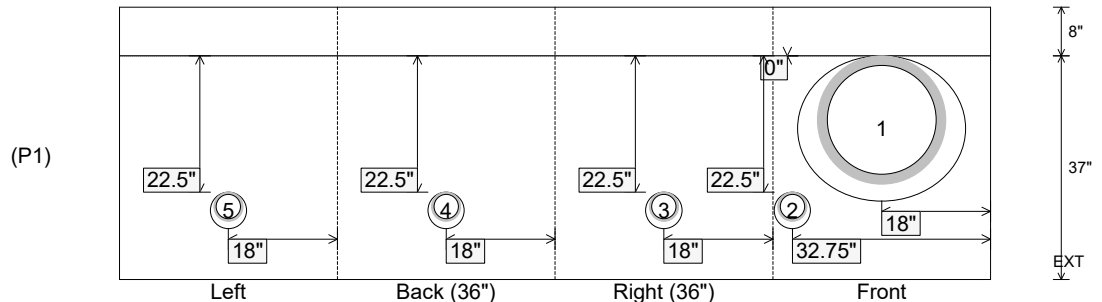

Coating (Int):
 Coating (Ext):

Seam Up: Flat
 Seam Dn: n/a

Wall Thickness: 8"
 Floor Height: 8"

Height (Int): 37"
 Height (Ext): 45"

Weight (Net): 5760 lb
 Volume (Net): 1.47cu.yd

Job Name: 26-1077 - Westside Markets of Greensboro Village
 Job Location: Gallatin, TN
 Contractor: Cleary Construction, Inc.

Plant: 100

Tech: J. Coppage - F

3/27/2026 8:29:17 PM

PC: C. Goff



Structure ID: A10A

P1 BX3636-08BAVF

BOX BASE 8inW, 8inF, Variable Ht F/n

P2) 36" x 36" - CASTING HEIGHT - 4"

P1) 36" x 36" - BOX BASE 8inW, 8inF, Variable Ht F/n - 37"

1) 36" x 36" - STORM INVERT CHANNEL (FLAT) - 4" THK

1) 36" x 36" - Conseal CS-102 1.00"

1) Hole - 24

4) Hole - 6

0 lb

5760 lb

450 lb

0 lb

0 lb

0 lb

Structure Total: 6210 lb

Structure Notes:

1. PER ASTM C913 SPECIFICATIONS.

2. CONCRETE = 4,000 PSI AT 28 DAYS.

3. NO STEPS.

4. CASTING SUPPLIED BY OTHERS (JBS 4073 F/G).

REINFORCING PER ASTM A615 (GRADE 60).

- WALLS (As .12) #5 BARS AT 12" C.C.E.W.


- FLOOR (As .12) #5 BARS AT 12" C.C.E.W.

Rim: 498.83' Rim to Invert: 3.5' Slack: 2.6" Sump: 1.6" Step Position:


Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset
Invert 1	495.33'	30°	30.625"	18" HDPE	21.2"	Hole 24	24"	27.713"	0"	-9"
Invert 2	497.11'	0°	40.75"	4" HDPE (perf pipe)	4.8"	Hole 6	6"	6"	22.5"	14.75"
Invert 3	497.11'	90°	26"	4" HDPE (perf pipe)	4.8"	Hole 6	6"	6"	22.5"	0"
Invert 4	497.11'	180°	26"	4" HDPE (perf pipe)	4.8"	Hole 6	6"	6"	22.5"	0"
Invert 5	497.11'	270°	26"	4" HDPE (perf pipe)	4.8"	Hole 6	6"	6"	22.5"	0"
Invert 6										
Invert 7										
Invert 8										

RIGHT-SIDE UP VIEW (int. dimensions)

UPSIDE-DOWN VIEW (int. dimensions)

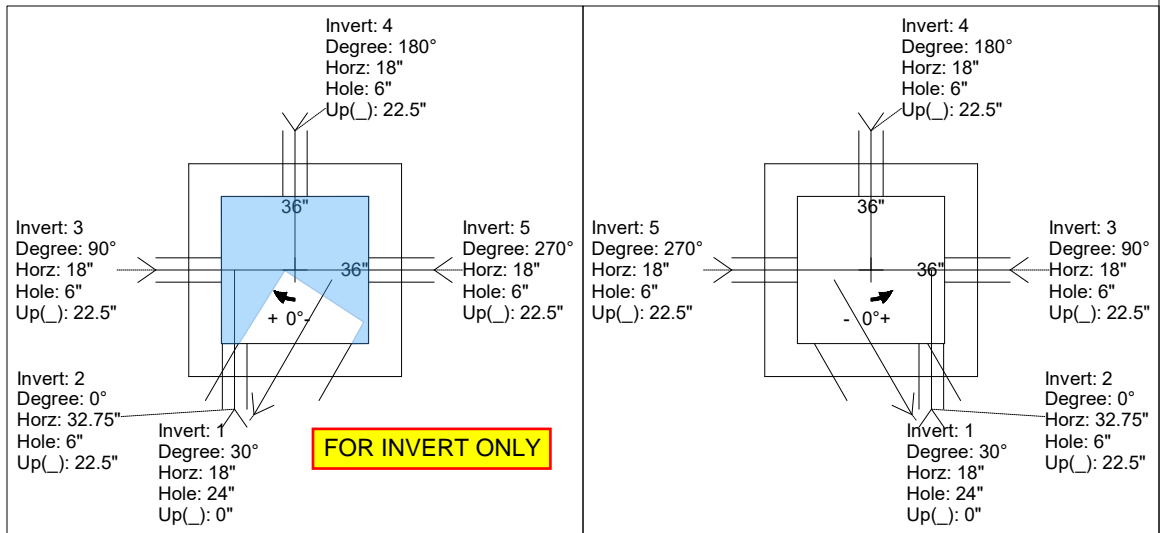

INSIDE WALL DIMENSIONS

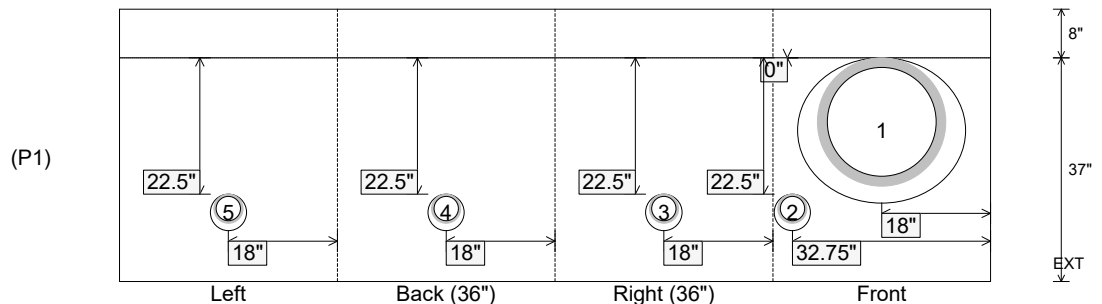

Coating (Int):
Coating (Ext):

Seam Up: Flat
Seam Dn: n/a

Wall Thickness: 8"
Floor Height: 8"

Height (Int): 37"
Height (Ext): 45"

Weight (Net): 5760 lb
Volume (Net): 1.47cu.yd