

Plant: 100

6/16/2026 1:23:31 PM

Tech:	J. Horsley
PC:	J. Jarvis



WALL PANEL 6" THICK F/F

$$\begin{array}{r} 1398 \text{ lb} \\ 1398 \text{ lb} \\ 932 \text{ lb} \\ 932 \text{ lb} \\ 0 \text{ lb} \\ \hline 4659 \text{ lb} \end{array}$$

REINFORCING PER ASTM A615 (GRADE 60).
-VERTICAL BARS = #4 BARS AT 12" C/C
-HORIZONTAL BARS = #6 BARS EQUALLY SPACED
(10" MAX.)

4659 lb

[illegible]




Note:
See attached typical drawing
for reinforcing and lifting details.



EXT

36

Weight (Net): 1398 lb
Volume (Net): 0.36cu.yd

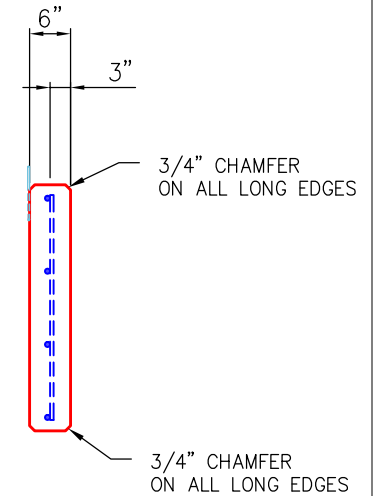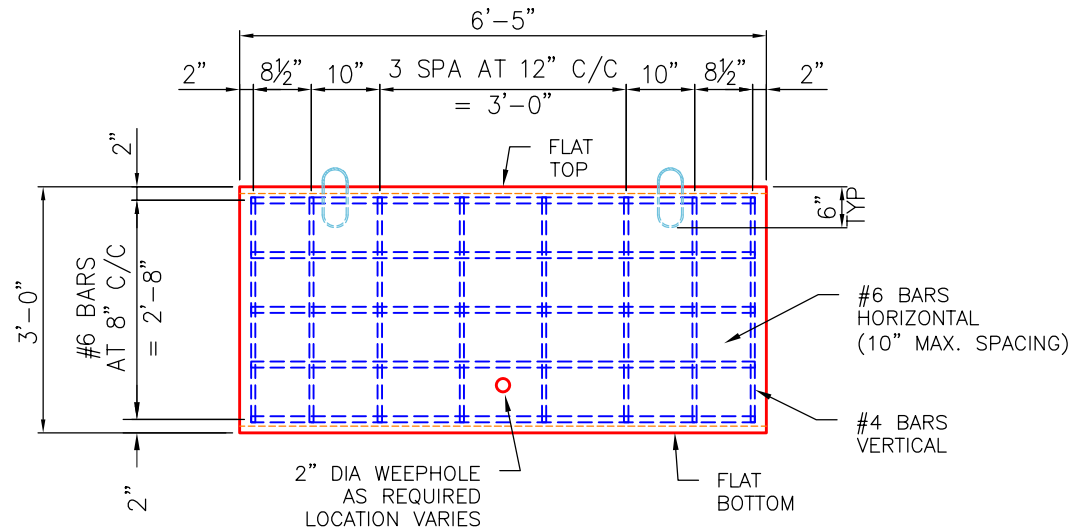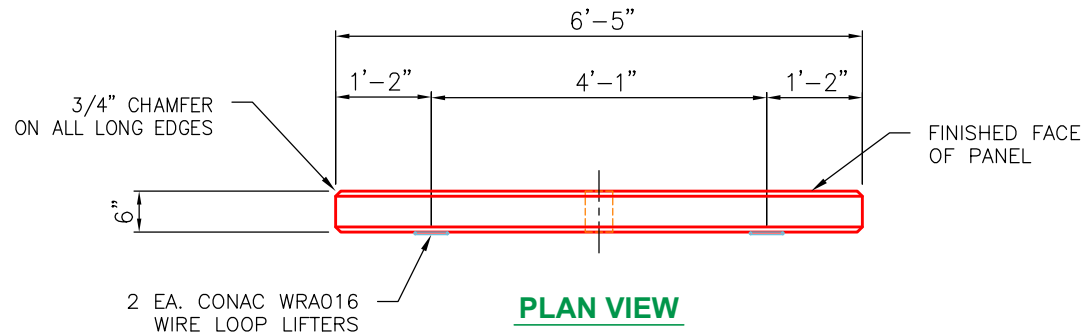

GENERAL NOTES:

1. MANUFACTURED ASTM C913 SPECIFICATIONS.
2. CONCRETE: 4,000 PSI MINIMUM AT 28 DAYS.
3. REINFORCING: AS PER PLAN DESIGN (GRADE 60).
4. CONAC 5CA14 ANCHORS CAST IN FOR HANDLING.
5. WEIGHT = 1,413 LBS
6. 68 REQUIRED.

SIDE VIEW

END VIEW

REVISION INFORMATION				SUBMITTAL DESCRIPTION: WALL PANEL 6.50' LG x 6" THK.	
REV. 	DATE:	NO REVISIONS TO DATE		CUSTOMER: HALL CONTRACTING OF KY INC.	
				PROJECT: MITCHELL HILL ROAD PROJECT	
				STRUCTURE ID.: WALL PANEL 6" THK (78" LG x 36" HT)	
				SALES ORDER NO: 26-1333	
				CHECK: B. SMITH	DRAWN BY: J. HORSLEY
				DATE: 04/20/26	SCALE: NTS PG. 1 of 1