
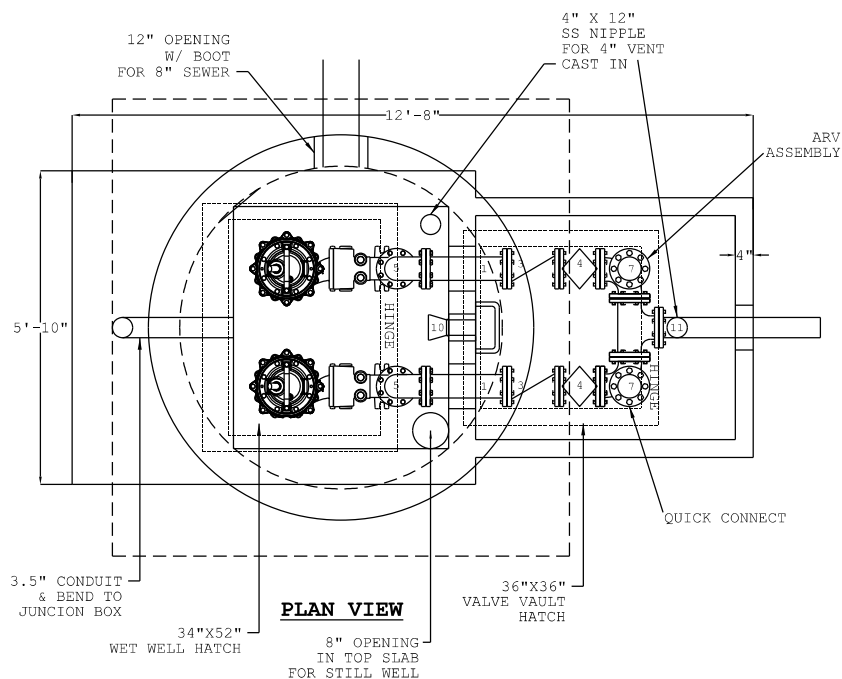



- 1 - 4" DI PIPE
 - 2 - 4" RFCA W/ SS HARDWARE
 - 3 - 4" FLANGED CHECK VALVE
 - 4 - 4" FLANGED PLUG VALVE
 - 5 - 4" FLANGED 90
 - 6 - 4" ALUM FLANGE ADAPTER X FLANGE W/ CAP
 - 7 - 4" FLANGED SIDE OUTLET 90
 - 8 - 36"X36" ALUM. HATCH
 - 9 - 34"X52" ALUM. HATCH W/ SAFETY GRATING
 - 10 - 2" TIDEFLEX CHECK VALVE
 - 11 - 4" MUSHROOM VENT W/ SS304 NIPPLE
 - 12 - PRESSURE GAUGE ASSEMBLY
 - 13 - 4"x2" COMPANION FLANGE
 - 14 - 2" SS304 BALL VALVE & NIPPLE
 - 15 - 2" ARI D025 COMBO ARV
 - 16 - 1.5" SS304 GUIDERAIL PIPE
 - 17 - 8" SDR 35 PVC TEE, PIPE & SS WALL CLAMPS
- NOTE: ALL DUCTILE IRON PIPE AND FITTINGS SHALL RECEIVE TNEC 431 LINER & COATING

26-1355 Sinking Creek Lift Station

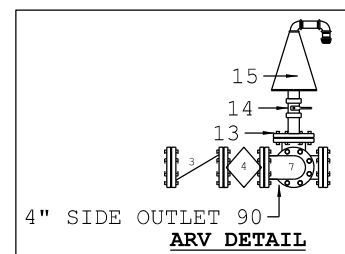


CONCRETE MIX DESIGN:
 5,000 PSI @ 28 DAYS
 XYPEX RED ADMIXTURE

CARBOLINE 300M COATING:
 EXTERIOR WALLS
 +
 INTERIOR WALLS
 BOTTOM OF TOP SLAB IN WET WELL AREA
 BOTTOM OF COMBO SECTION IN WET WELL AREA

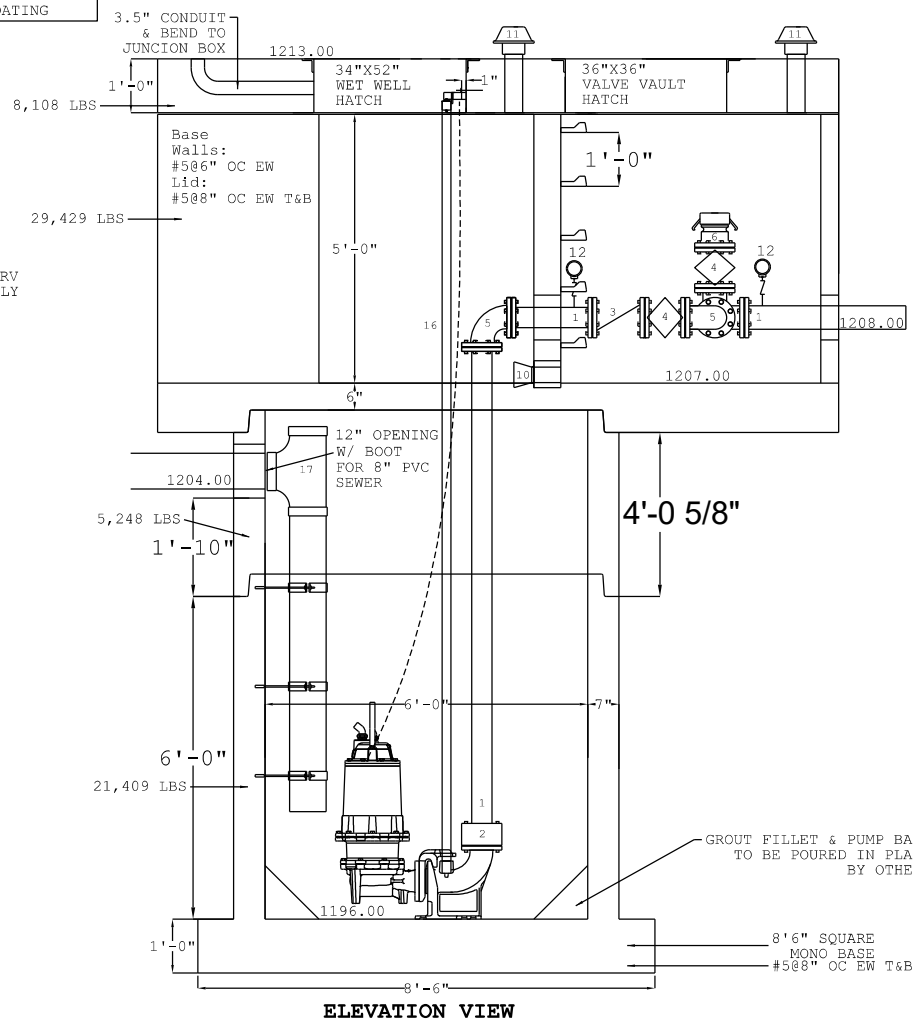

GRAPHIC SCALE



PROJECT INFORMATION

OWNER: LONDON UTILITY COMMISSION
ENGINEER: ECLIPSE ENGINEERS


DRAWING INFORMATION

DRAWING BY: J.H. ROSS, PE
DATE: MARCH 23, 2026
REV. DATE: N/A

SINKING CREEK PH 2
6' DIA PRE-ENGINEERED
PACKAGE PUMP STATION

ENDESOL, INC.
 981 WEST SEVENTH STREET
 BEAVER DAM, KENTUCKY 42320

I



Base
Walls:
#5@6" OC EW
Lid:
#5@8" OC EW T&B

CONCRETE MIX DESIGN:
5,000 PSI @ 28 DAYS
XYPEX RED ADMIXTURE

CARBOLINE 300M COATING, TWO COATS:
ALL INTERIOR WALLS
BOTTOM OF TOP SLAB IN WET WELL AREA
BOTTOM OF COMBO SECTION IN WET WELL AREA