




Job Name: 26-1466 - Lower Mill Creek HWDW Protection Job Location: Cincinnati, OH Contractor: Sunesis Construction					Plant: 100 7/22/2026 12:40:08 PM		Tech: Jared - F PC: E. Bradley				
Structure ID: CS0 422 RISER											
P2 MH072RS48			MH RISER T/F								
P5) 24" - CASTING HEIGHT - 7.25" P4) 72" - MH FLAT LID w/24in ECC Hole F/G - 15" P3) 72" - MH RISER T/G - 48" P2) 72" - MH RISER T/F - 48" P1) 72" - P.I.P. BY OTHERS - BTM SLAB F/n - 0" 1) JOINT WRAP - 0.065"x6"x50' CONSEAL CS212 1) JOINT WRAP PRIMER - CONSEAL CS-75 (1 gal.) 1) Hole - 0						0 lb 5098 lb 6997 lb 6997 lb 0 lb 0 lb 0 lb 0 lb ----- 19093 lb		Structure Notes: . 1. PER ASTM C478 SPECIFICATIONS. 2. CONCRETE = 4,000 PSI AT 28 DAYS. 3. NO INVERT CHANNEL. 4. CASTING SUPPLIED BY OTHERS. REINFORCING PER ASTM A615 (GRADE 60). - TOP SLAB (As .31) #5 BARS AT 6" C.C.E.W. - RISER/WALLS (As .12) - FLOOR (As .37) #5 BARS AT 10" C.C.E.W.			
Rim: 501.5' Rim to Invert: 10' Slack: 1.75" Sump: 0" Step Position: 180°											
Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset	
Invert 1	491.5'	0°	0"	0" No Hole	0.01"	Hole 0	0"	0"	0"	0"	
Invert 2											
Invert 3											
Invert 4											
Invert 5											
Invert 6											
Invert 7											
Invert 8											

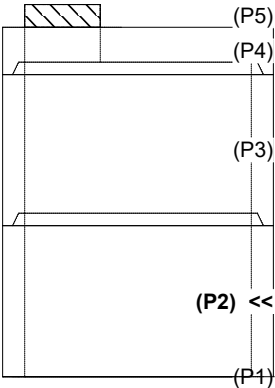

RIGHT-SIDE UP VIEW (int. dimensions)

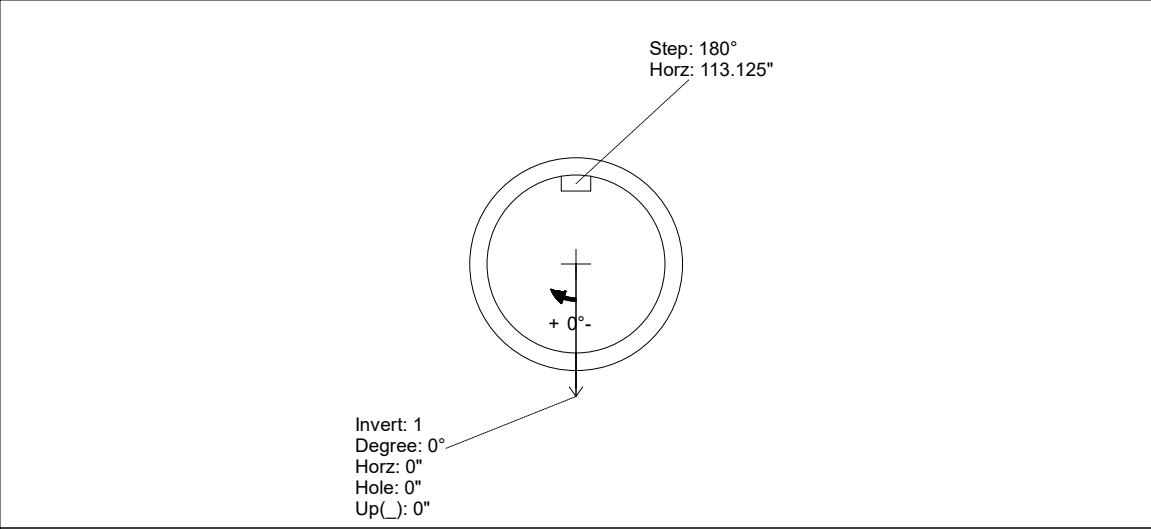

INSIDE WALL DIMENSIONS

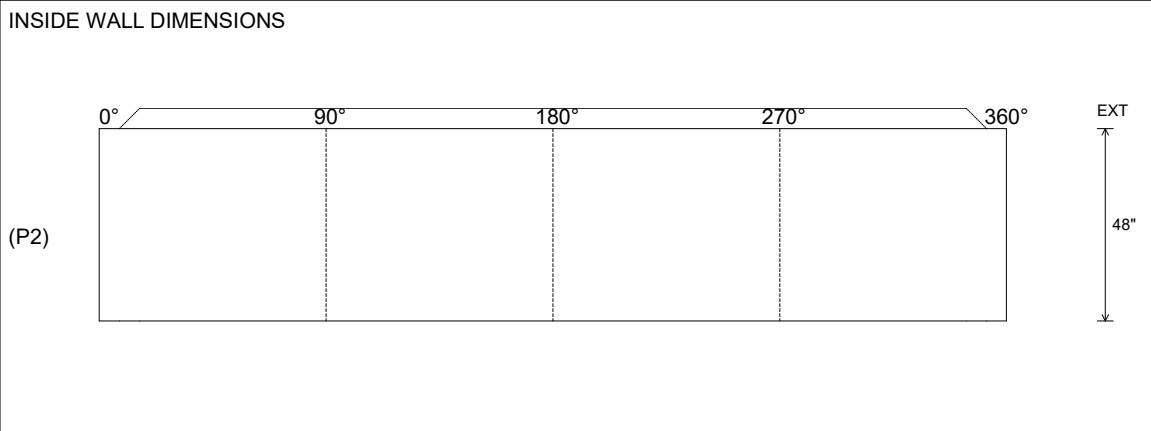

Coating (Int): Coating (Ext):	Seam Up: Tongue Seam Dn: Flat	Wall Thickness: 7" Floor Height: 0"	Height (Int): 48" Height (Ext): 48"	Weight (Net): 6997 lb Volume (Net): 1.79cu.yd
----------------------------------	----------------------------------	--	--	--