



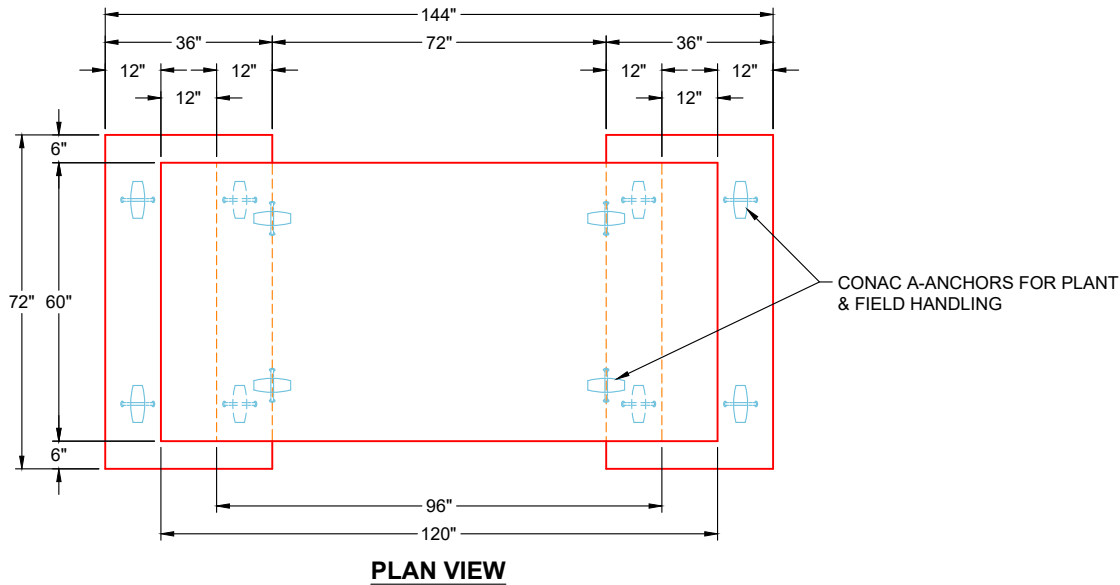



GENERAL NOTES:

1. MANUFACTURED PER ASTM C-913 SPECIFICATIONS
2. CONCRETE: 5,000 PSI AT 28 DAYS
3. REINFORCEMENT - 2" MIN. REBAR CLEARANCE (TYP):
 - TOP: #5 BAR @ 12" C.C. E.W. (GRADE 60)
 - FOOTER SHORT BARS: #4 BAR @ 12" C.C. E.W. (GRADE 60)
 - FOOTER LONG BARS: #5 BAR @ 12" C.C. E.W. (GRADE 60)
 - WALL VERTICAL BARS: DBL MAT #4 L-BAR @ 12" C.C. E.W. (GRADE 60)
 - WALL HORIZONTAL BARS: DBL MAT #5 BAR @ 12" C.C. E.W. (GRADE 60)
4. ALL REINFORCEMENT BARS TO BE EPOXY COATED
5. WEIGHTS:

120" X 60" X 14" SIDEWALK BRIDGE TOP - STR 10	8,458 LBS
72" X 36" X 12" SIDEWALK BRIDGE FOOTER - STR 11 (1)	4,060 LBS
72" X 36" X 12" SIDEWALK BRIDGE FOOTER - STR 11 (2)	4,060 LBS
TOTAL WEIGHT	16,578 LBS
6. LIFTING ANCHORS POCKETS TO BE GROUTED SMOOTH AFTER SETTING WITH KYTC APPROVED NON-SHRINK GROUT (BY OTHERS)

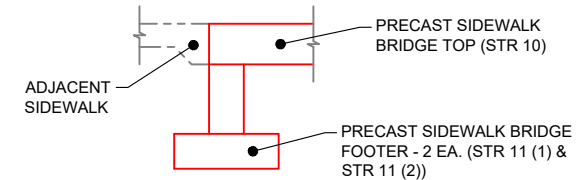

SIDEWALK BRIDGE DETAIL

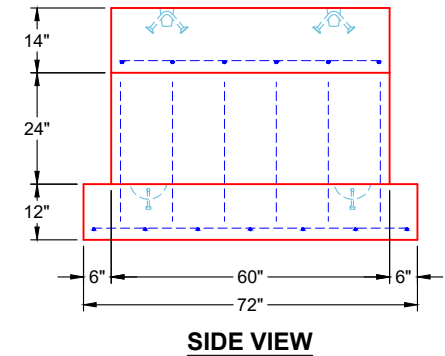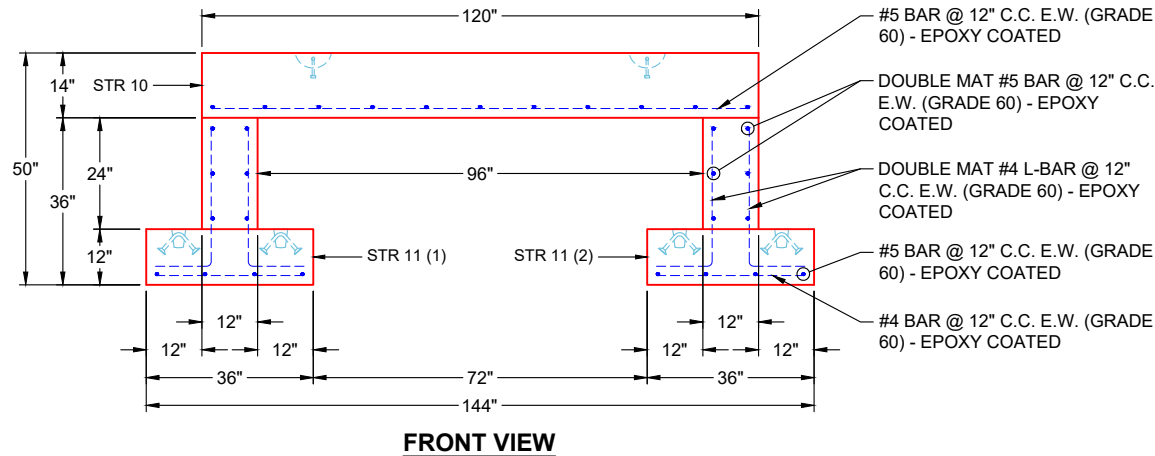

REVISION INFORMATION

REV. DATE: NO REVISIONS TO DATE



SUBMITTAL DRAWING: CUSTOM SIDEWALK BRIDGE

CUSTOMER: SCHROEDER CONSTRUCTION, INC.

PROJECT: WEST RAILROAD AVE

STRUCTURE: 10, 11 (1), & 11 (2)

QUOTE/SALES ORDER NO: 26-1510

CHECKED BY: B. SMITH

DRAWN BY: ADVENSER

DATE: 05/05/26

SCALE: NTS

PG. 1 OF 1