


Contractor: CITCO Water

Plant: 100




Slack: 0"


Structure Total:	11856 lb
------------------	----------

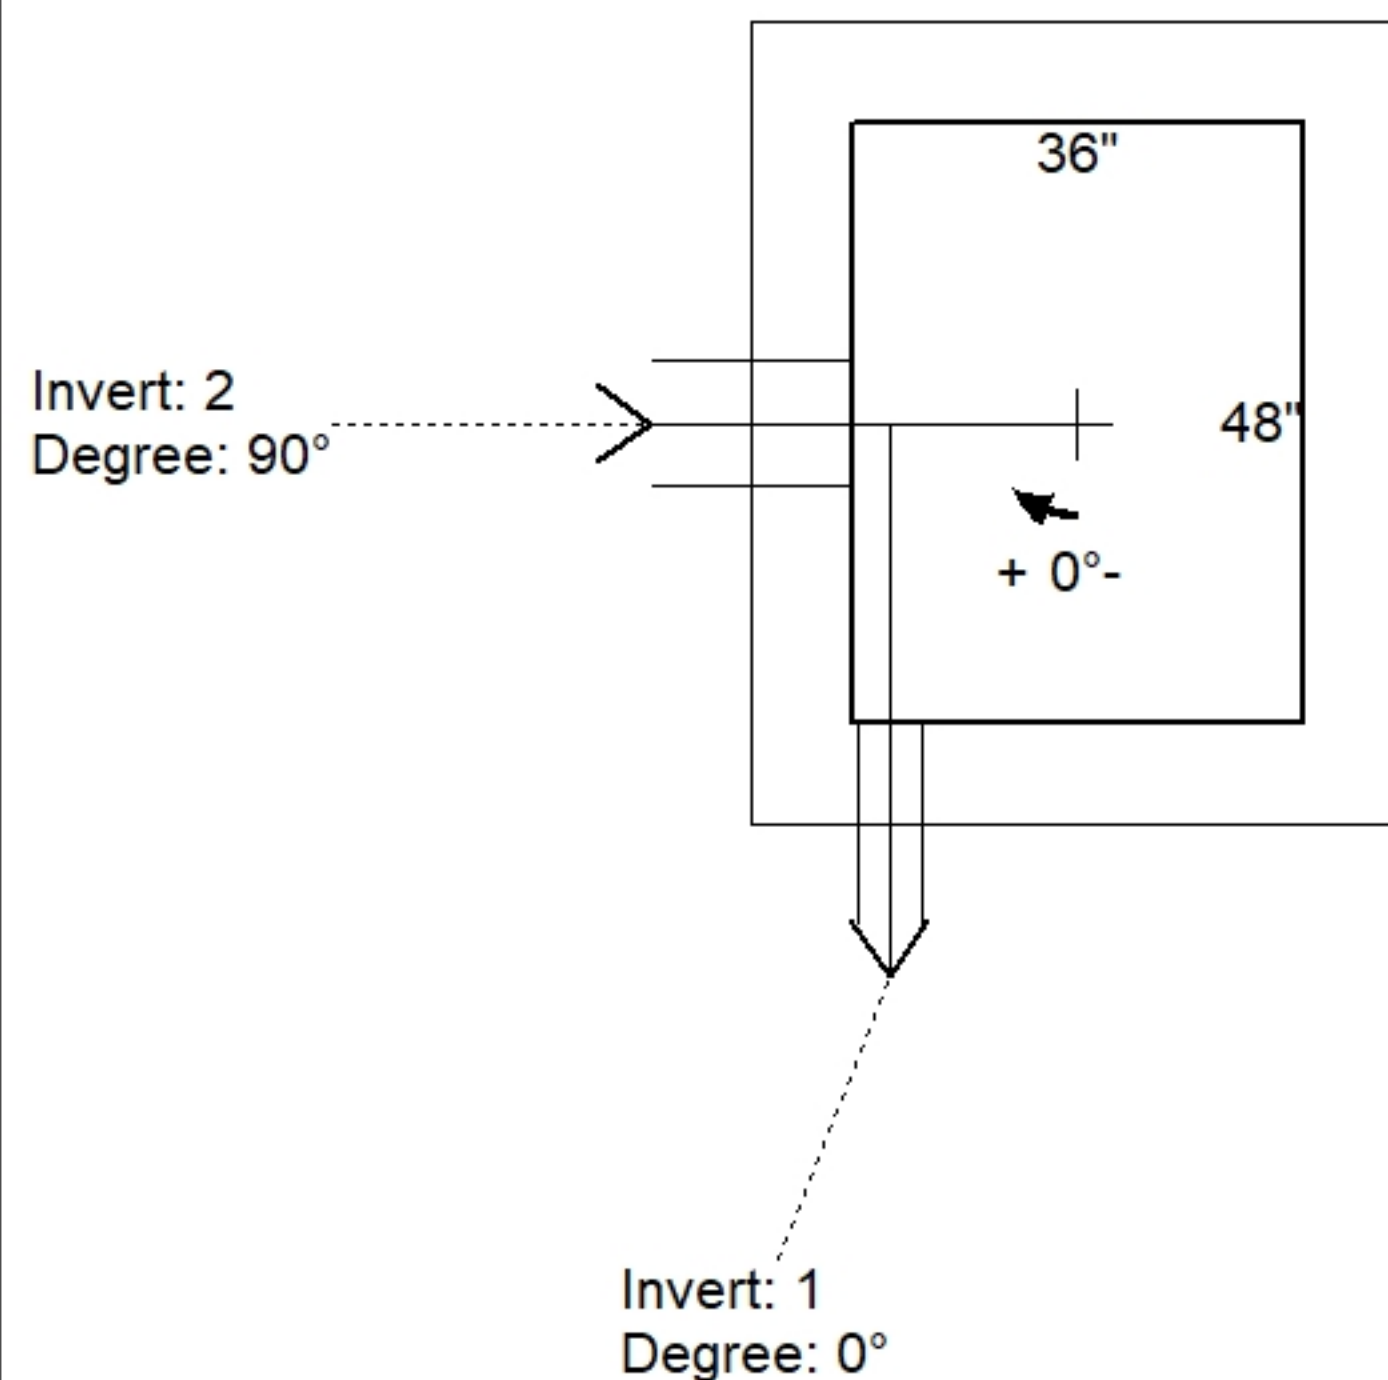

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up (')	Ref
Rim	950.5'							
Reducer								
Invert 1	946.58'	0°	3" PVC SCH40	3.5"	5"	Hole 5	0.731"	P1
Invert 2	946.83'	90°	6" DI	6.875"	10"	Hole 10	3.522"	P1
Invert 3								
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

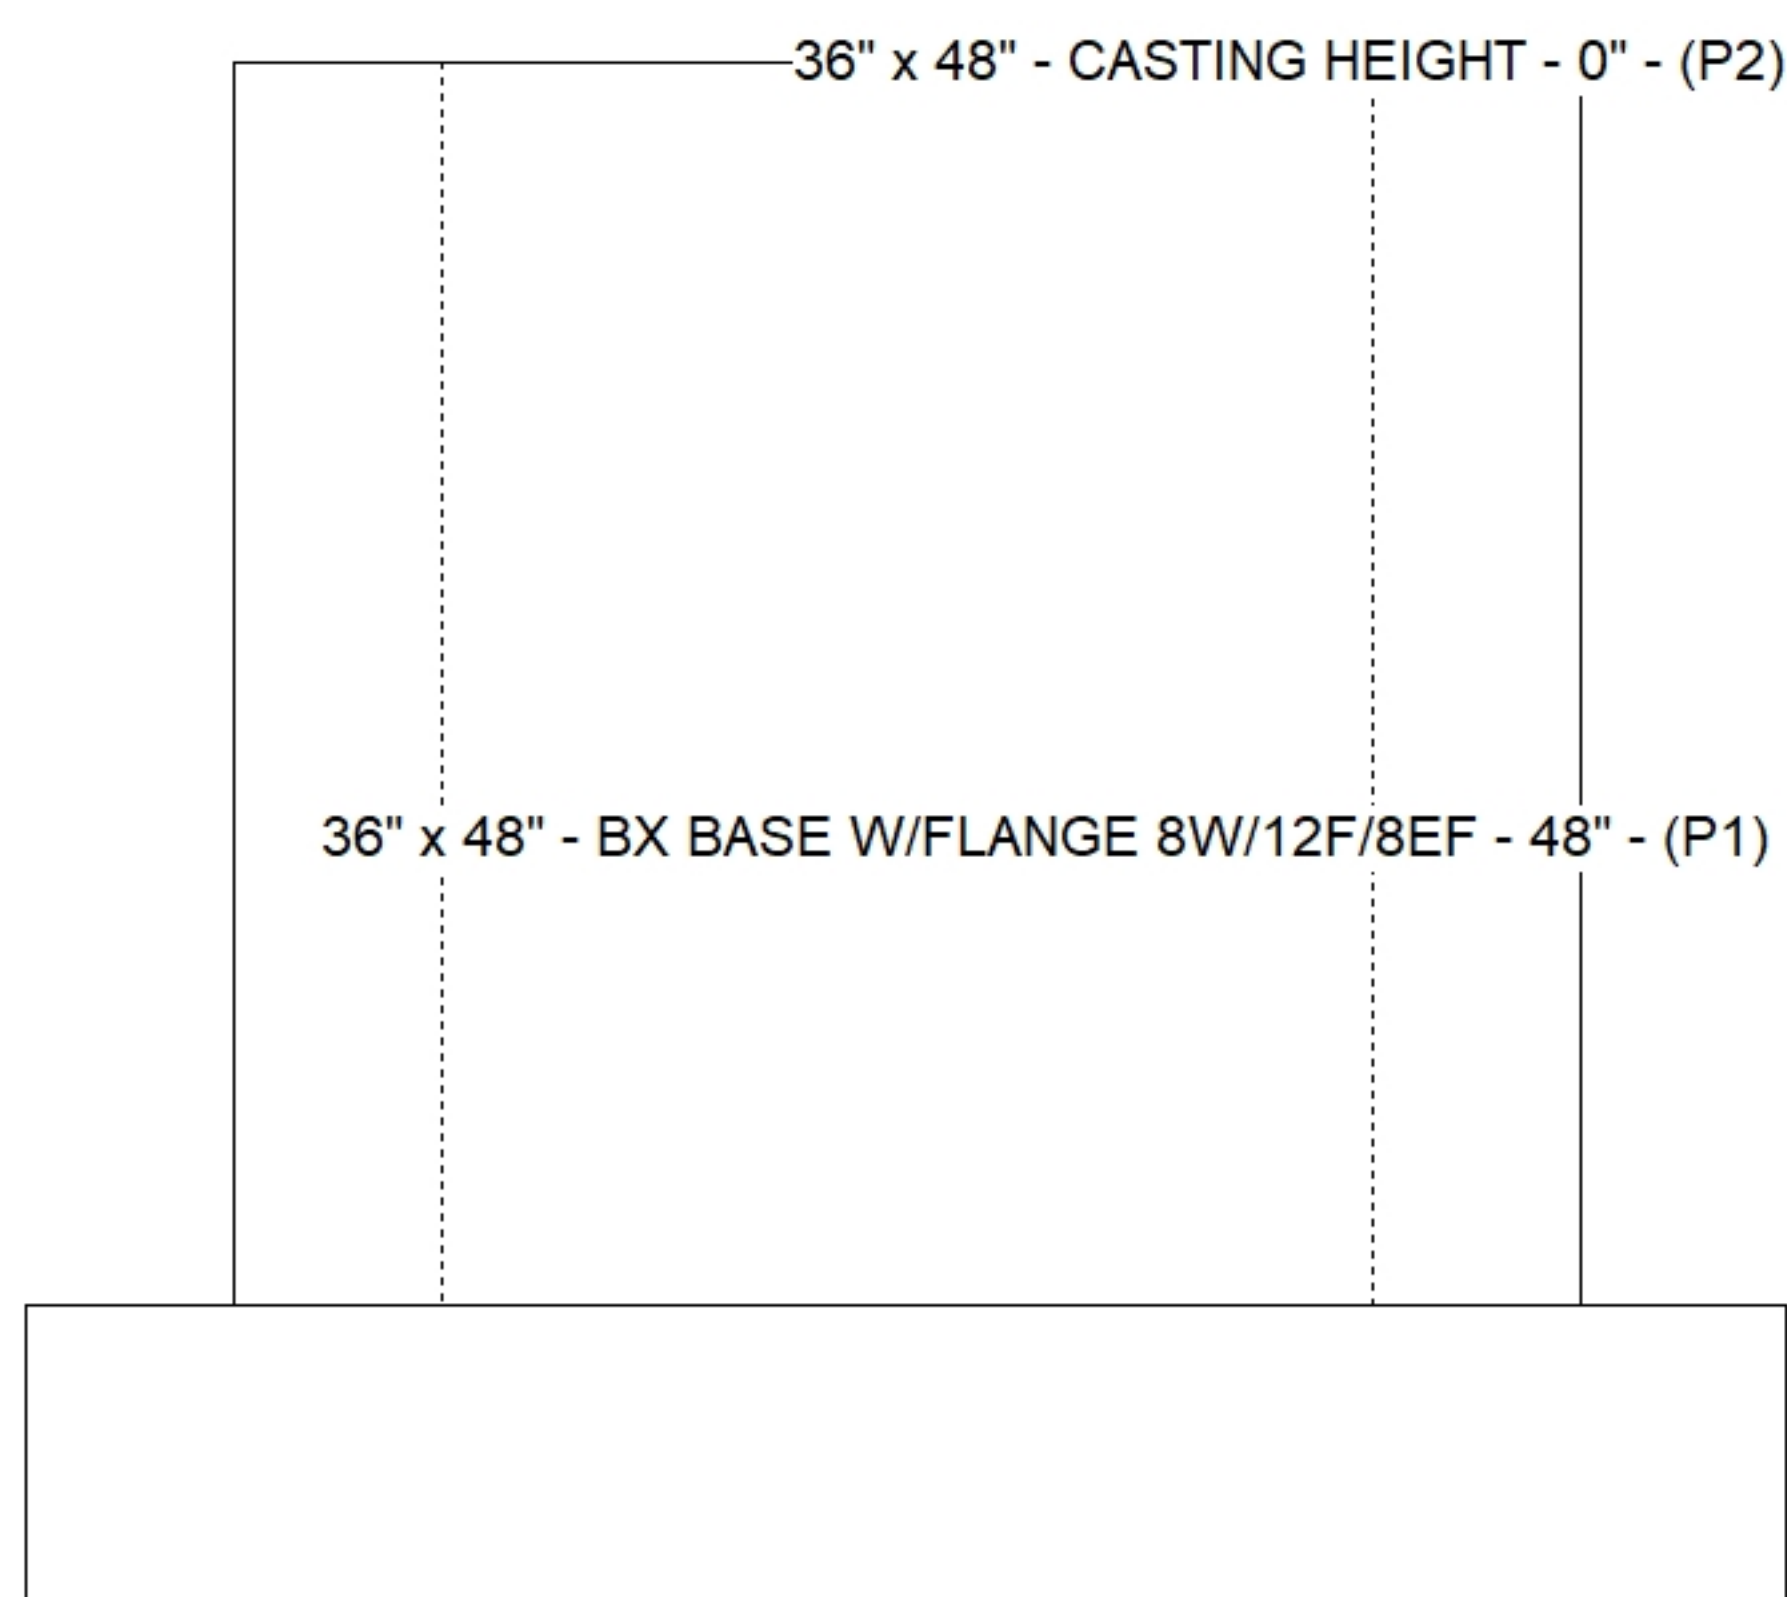

(P1)

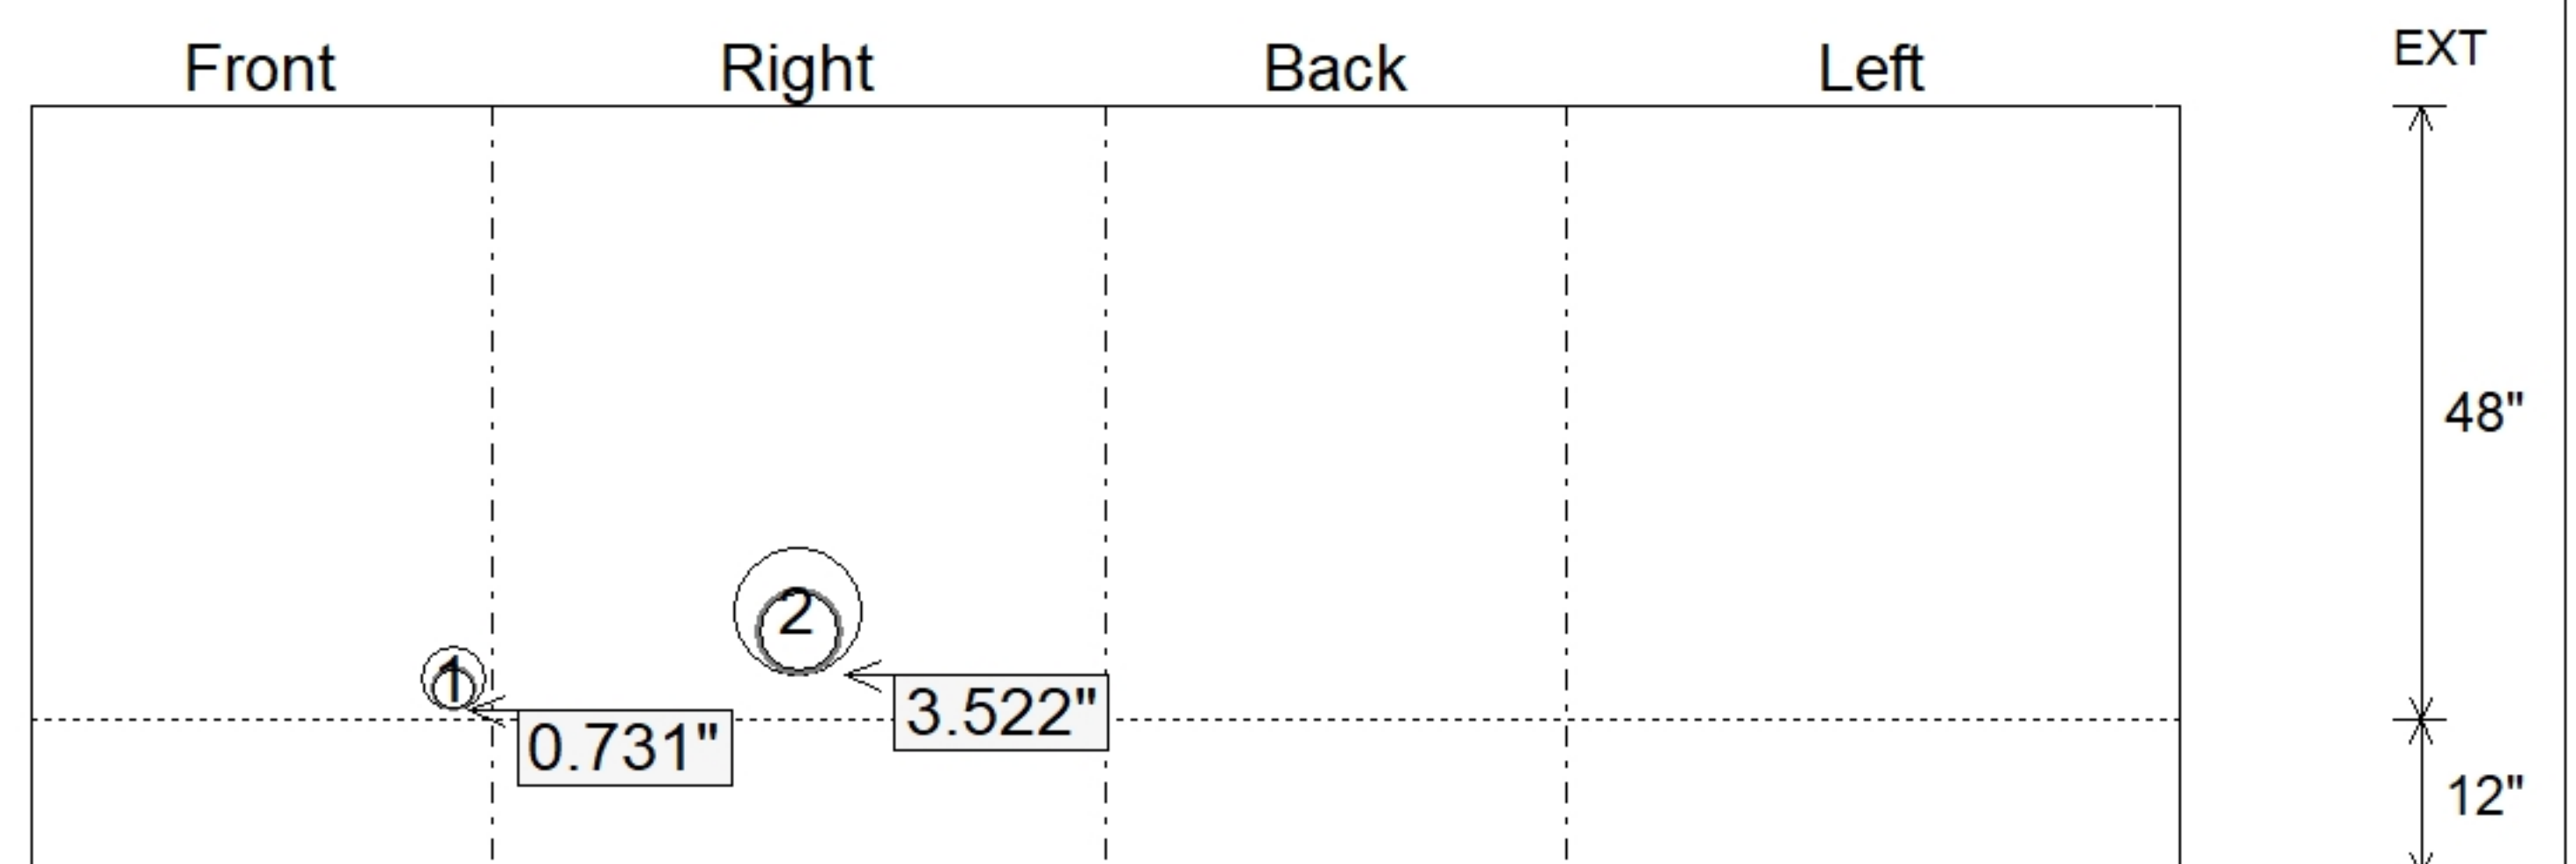

SUBMITTAL
APPROVED BY: