




Structure Notes:

1. PER ASTM C478 SPECIFICATIONS.
2. CONCRETE = 4,000 PSI AT 28 DAYS.
3. CASTING BY ICAST (HOE 595 F/C).



REINFORCING PER ASTM A615 (GRADE 60).

- TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W..
- RISER/WALLS (As .12)
- FLOOR (As .31) #5 BARS AT 12" C.C.E.W.

STRUCTURE SUMMARY:	
P2) 34" x 34" - CASTING HEIGHT - 3"	0 lb
P1) 48" - MH FLAT TOP w/34"x34" Hole F/F - 7"	873 lb
1) CASTING - HOE 595 F/G	376 lb
Structure Total:	1249 lb

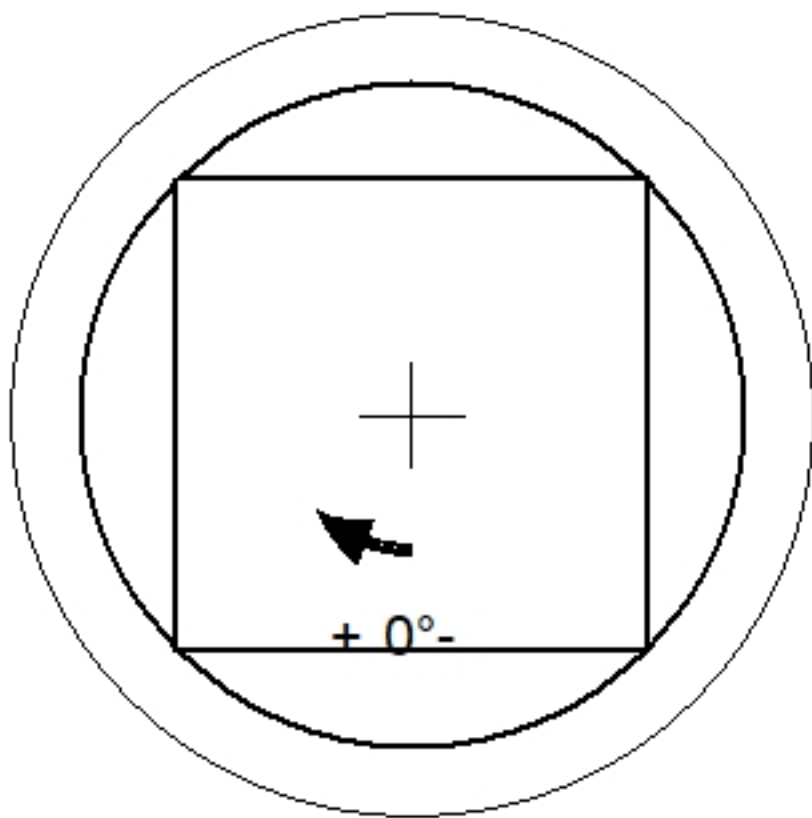

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up (')_	Ref
Rim	0.833'							
Reducer								
Invert 1								
Invert 2								
Invert 3								
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

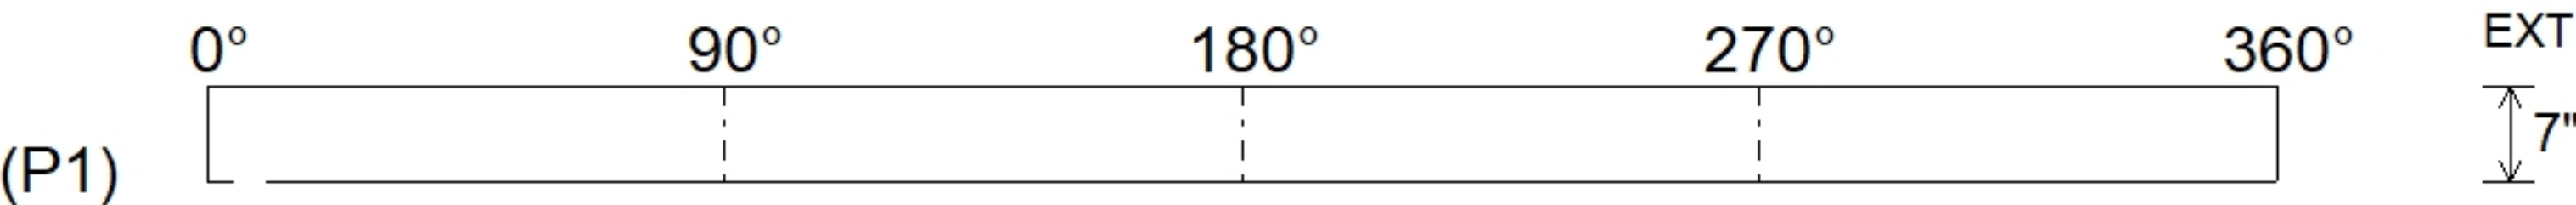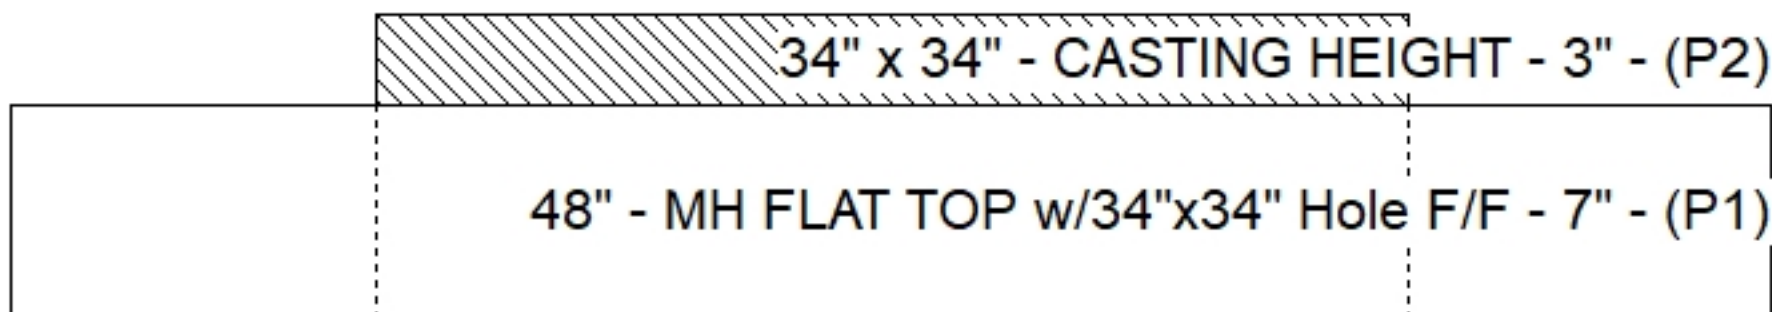

Submittal Drawing 6/30/2026 8:22:33 AM	SUBMITTAL APPROVED BY:
---	---------------------------