





<u>Structure Notes:</u> . 1. PER ASTM C913 SPECIFICATIONS. 2. CONCRETE = 4,000 PSI AT 28 DAYS. 3. SOLID SLAB (NO CASTING). . REINFORCING PER ASTM A615 (GRADE 60). - TOP LAYER = #4 BARS AT 10" C.C.E.W. - BTM LAYER = #5 BARS AT 6" C.C.E.W.	STRUCTURE SUMMARY: P1) 168" x 78" - CUST. TOP SLAB (SOLID) F/F - 12"	13195 lb Structure Total: 13195 lb
---	--	--

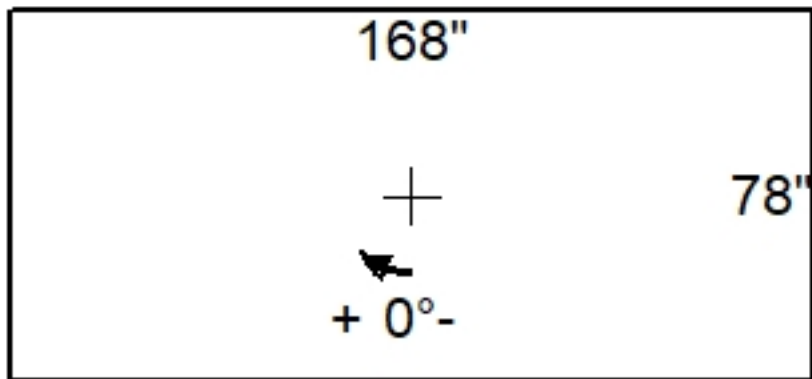

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up ()	Ref
Rim	1'							
Reducer								
Invert 1								
Invert 2								
Invert 3								
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

168" x 78" - CUST. TOP SLAB (SOLID) F/F - 12" - (P1)
--

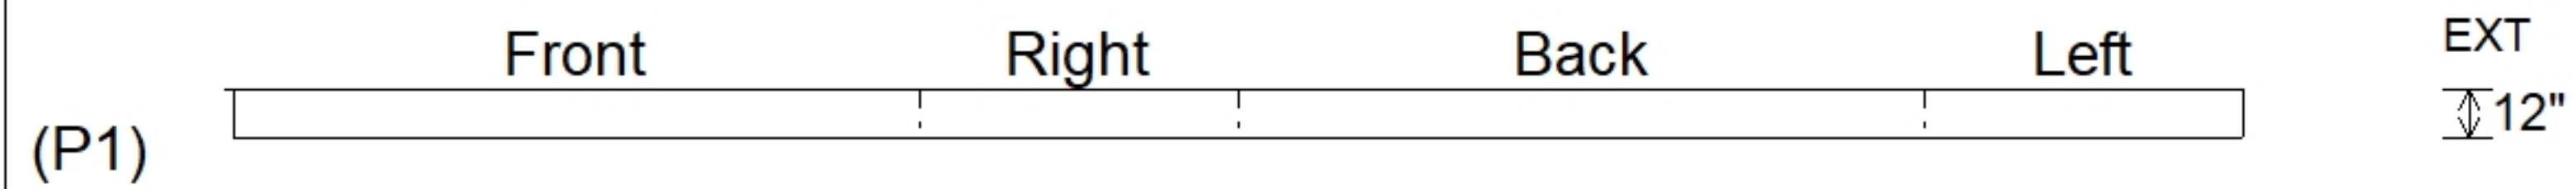

Submittal Drawing 8/10/2026 7:20:34 AM	SUBMITTAL APPROVED BY:
---	---------------------------