



Job Name: 26-1822 - Project Versailles Job Location: Versailles, KY Contractor: KY Earthworks					Plant: 100 8/26/2026 3:45:45 PM		Tech: Jared - F PC: E. Bradley			
Structure ID: T4.1 SS-MH										
P1 MH048BA36			MH BASE NO STEP T/n							
P3) 24" - CASTING HEIGHT - 7" P2) 48" - ECC CONE w/ 24" HOLE NO STEP F/G - 42" P1) 48" - MH BASE NO STEP T/n - 36" 1) JOINT WRAP - 0.065"x6"x50' CONSEAL CS212 1) JOINT WRAP PRIMER - CONSEAL CS-75 (1 gal.) 1) 48" - MH INVERT CHANNEL - FULL HEIGHT 1) CASTING - HOE MC-375 F/C Sanitary 1) 48" - Conseal CS-102 1.00" (Double) 1) 24" - Conseal CS-102 1.00" (Double) 1) A-Lok - 0285					0 lb 3000 lb 3814 lb 0 lb 0 lb 1440 lb 271 lb 0 lb 0 lb 1 lb ----- Structure Total: 8526 lb		Structure Notes: 1. PER ASTM C478 SPECIFICATIONS. 2. CONCRETE = 4,000 PSI AT 28 DAYS. 3. NO STEPS 4. CASTING BY ICAST (HOE MC-375 F/C SANITARY) REINFORCING PER ASTM A615 (GRADE 60). - CONE (As .12) - RISER/WALLS (As .12) - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.			
Rim: 932' Rim to Invert: 7.11' Slack: 2.32' Sump: 2' Step Position: 0°										
Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset
Invert 1	924.89'	0°	0"	8" PVC SDR35	8.5"	A-Lok 0285	9.75"	9.818"	1.125"	0"
Invert 2										
Invert 3										
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										

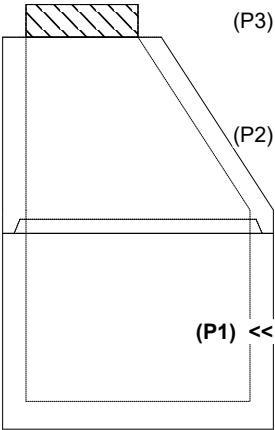


(P3)

(P2)

(P1) <<




Invert: 1
Degree: 0°
Horz: 0"
Hole: 9.75"
Up(): 1.125"



Invert: 1
Degree: 0°
Horz: 0"
Hole: 9.75"
Up(): 1.125"

(P1)

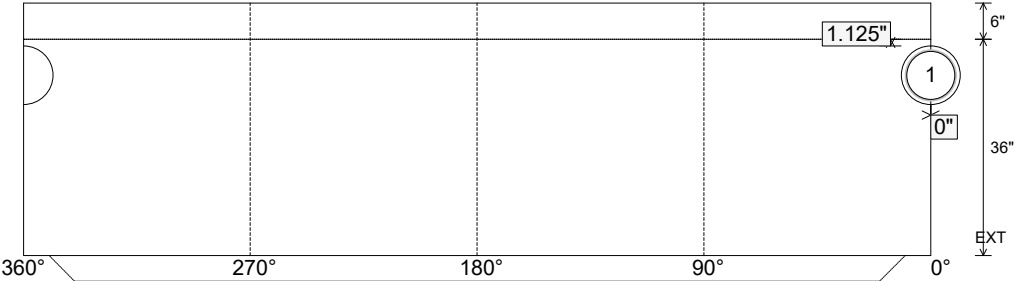

360° 270° 180° 90° 0°

1.125"

36"


EXT

Coating (Int): Coating (Ext):	Seam Up: Tongue Seam Dn: n/a	Wall Thickness: 5" Floor Height: 6"	Height (Int): 36" Height (Ext): 42"	Weight (Net): 3814 lb Volume (Net): 0.97cu.yd
----------------------------------	---------------------------------	--	--	--

Job Name: 26-1822 - Project Versailles Job Location: Versailles, KY Contractor: KY Earthworks					Plant: 100 8/26/2026 3:45:45 PM		Tech: Jared - F PC: E. Bradley			
Structure ID: T4.1 SS-MH										
P1 MH048BA36		MH BASE NO STEP T/n								
P3) 24" - CASTING HEIGHT - 7" P2) 48" - ECC CONE w/ 24" HOLE NO STEP F/G - 42" P1) 48" - MH BASE NO STEP T/n - 36" 1) JOINT WRAP - 0.065"x6"x50' CONSEAL CS212 1) JOINT WRAP PRIMER - CONSEAL CS-75 (1 gal.) 1) 48" - MH INVERT CHANNEL - FULL HEIGHT 1) CASTING - HOE MC-375 F/C Sanitary 1) 48" - Conseal CS-102 1.00" (Double) 1) 24" - Conseal CS-102 1.00" (Double) 1) A-Lok - 0285					0 lb 3000 lb 3814 lb 0 lb 0 lb 1440 lb 271 lb 0 lb 0 lb 1 lb ----- Structure Total: 8526 lb		Structure Notes: 1. PER ASTM C478 SPECIFICATIONS. 2. CONCRETE = 4,000 PSI AT 28 DAYS. 3. NO STEPS 4. CASTING BY ICAST (HOE MC-375 F/C SANITARY) REINFORCING PER ASTM A615 (GRADE 60). - CONE (As .12) - RISER/WALLS (As .12) - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.			
Rim: 932' Rim to Invert: 7.11' Slack: 2.32' Sump: 2' Step Position: 0°										
Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset
Invert 1	924.89'	0°	0"	8" PVC SDR35	8.5"	A-Lok 0285	9.75"	9.818"	1.125"	0"
Invert 2										
Invert 3										
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										


RIGHT-SIDE UP VIEW (int. dimensions)

FOR INVERT ONLY




Invert: 1
Degree: 0°
Horz: 0"
Hole: 9.75"
Up(): 1.125"

UPSIDE-DOWN VIEW (int. dimensions)



Invert: 1
Degree: 0°
Horz: 0"
Hole: 9.75"
Up(): 1.125"

INSIDE WALL DIMENSIONS

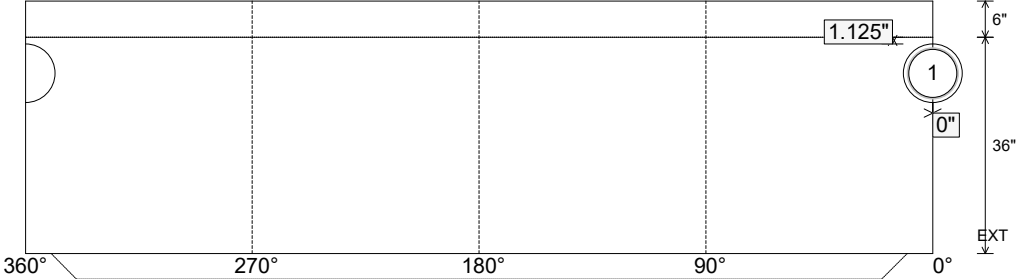

(P1)

360° 270° 180° 90° 0°

1.125"

6"

36"

EXT

Coating (Int): Coating (Ext):	Seam Up: Tongue Seam Dn: n/a	Wall Thickness: 5" Floor Height: 6"	Height (Int): 36" Height (Ext): 42"	Weight (Net): 3814 lb Volume (Net): 0.97cu.yd
----------------------------------	---------------------------------	--	--	--