

Contractor: KY Earthworks

TECH: Jared - F

Plant: 100



Slack: 1.92"


REINFORCING PER ASTM A615 (GRADE 60).

- TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W..
- RISER/WALLS (As .18)
- FLOOR (As .37) #5 BARS AT 10" C.C.E.W.


- P4) 24" x 36" - CASTING HEIGHT - 6"
- P3) 60" - MH FLAT TOP w/24"x36" Hole - 13"
- P2) 60" - MH RISER - 24"
- P1) 60" - MH BASE - 60"
- 1) CASTING - HOE 525 LV SET (F/G/H)
- 2) 60" - Conseal CS-102 1.00"
- 1) 24" x 36" - Conseal CS-102 1.00"
- 1) Hole - 48
- 1) Hole - 16
- 1) Hole - 40
- 7) MH Step ML-10-TDS-NCR - 10"

0 lb
3499 lb
2505 lb
7186 lb
442 lb
0 lb
0 lb
0 lb
0 lb
0 lb
0 lb


Structure Total: 13632 lb

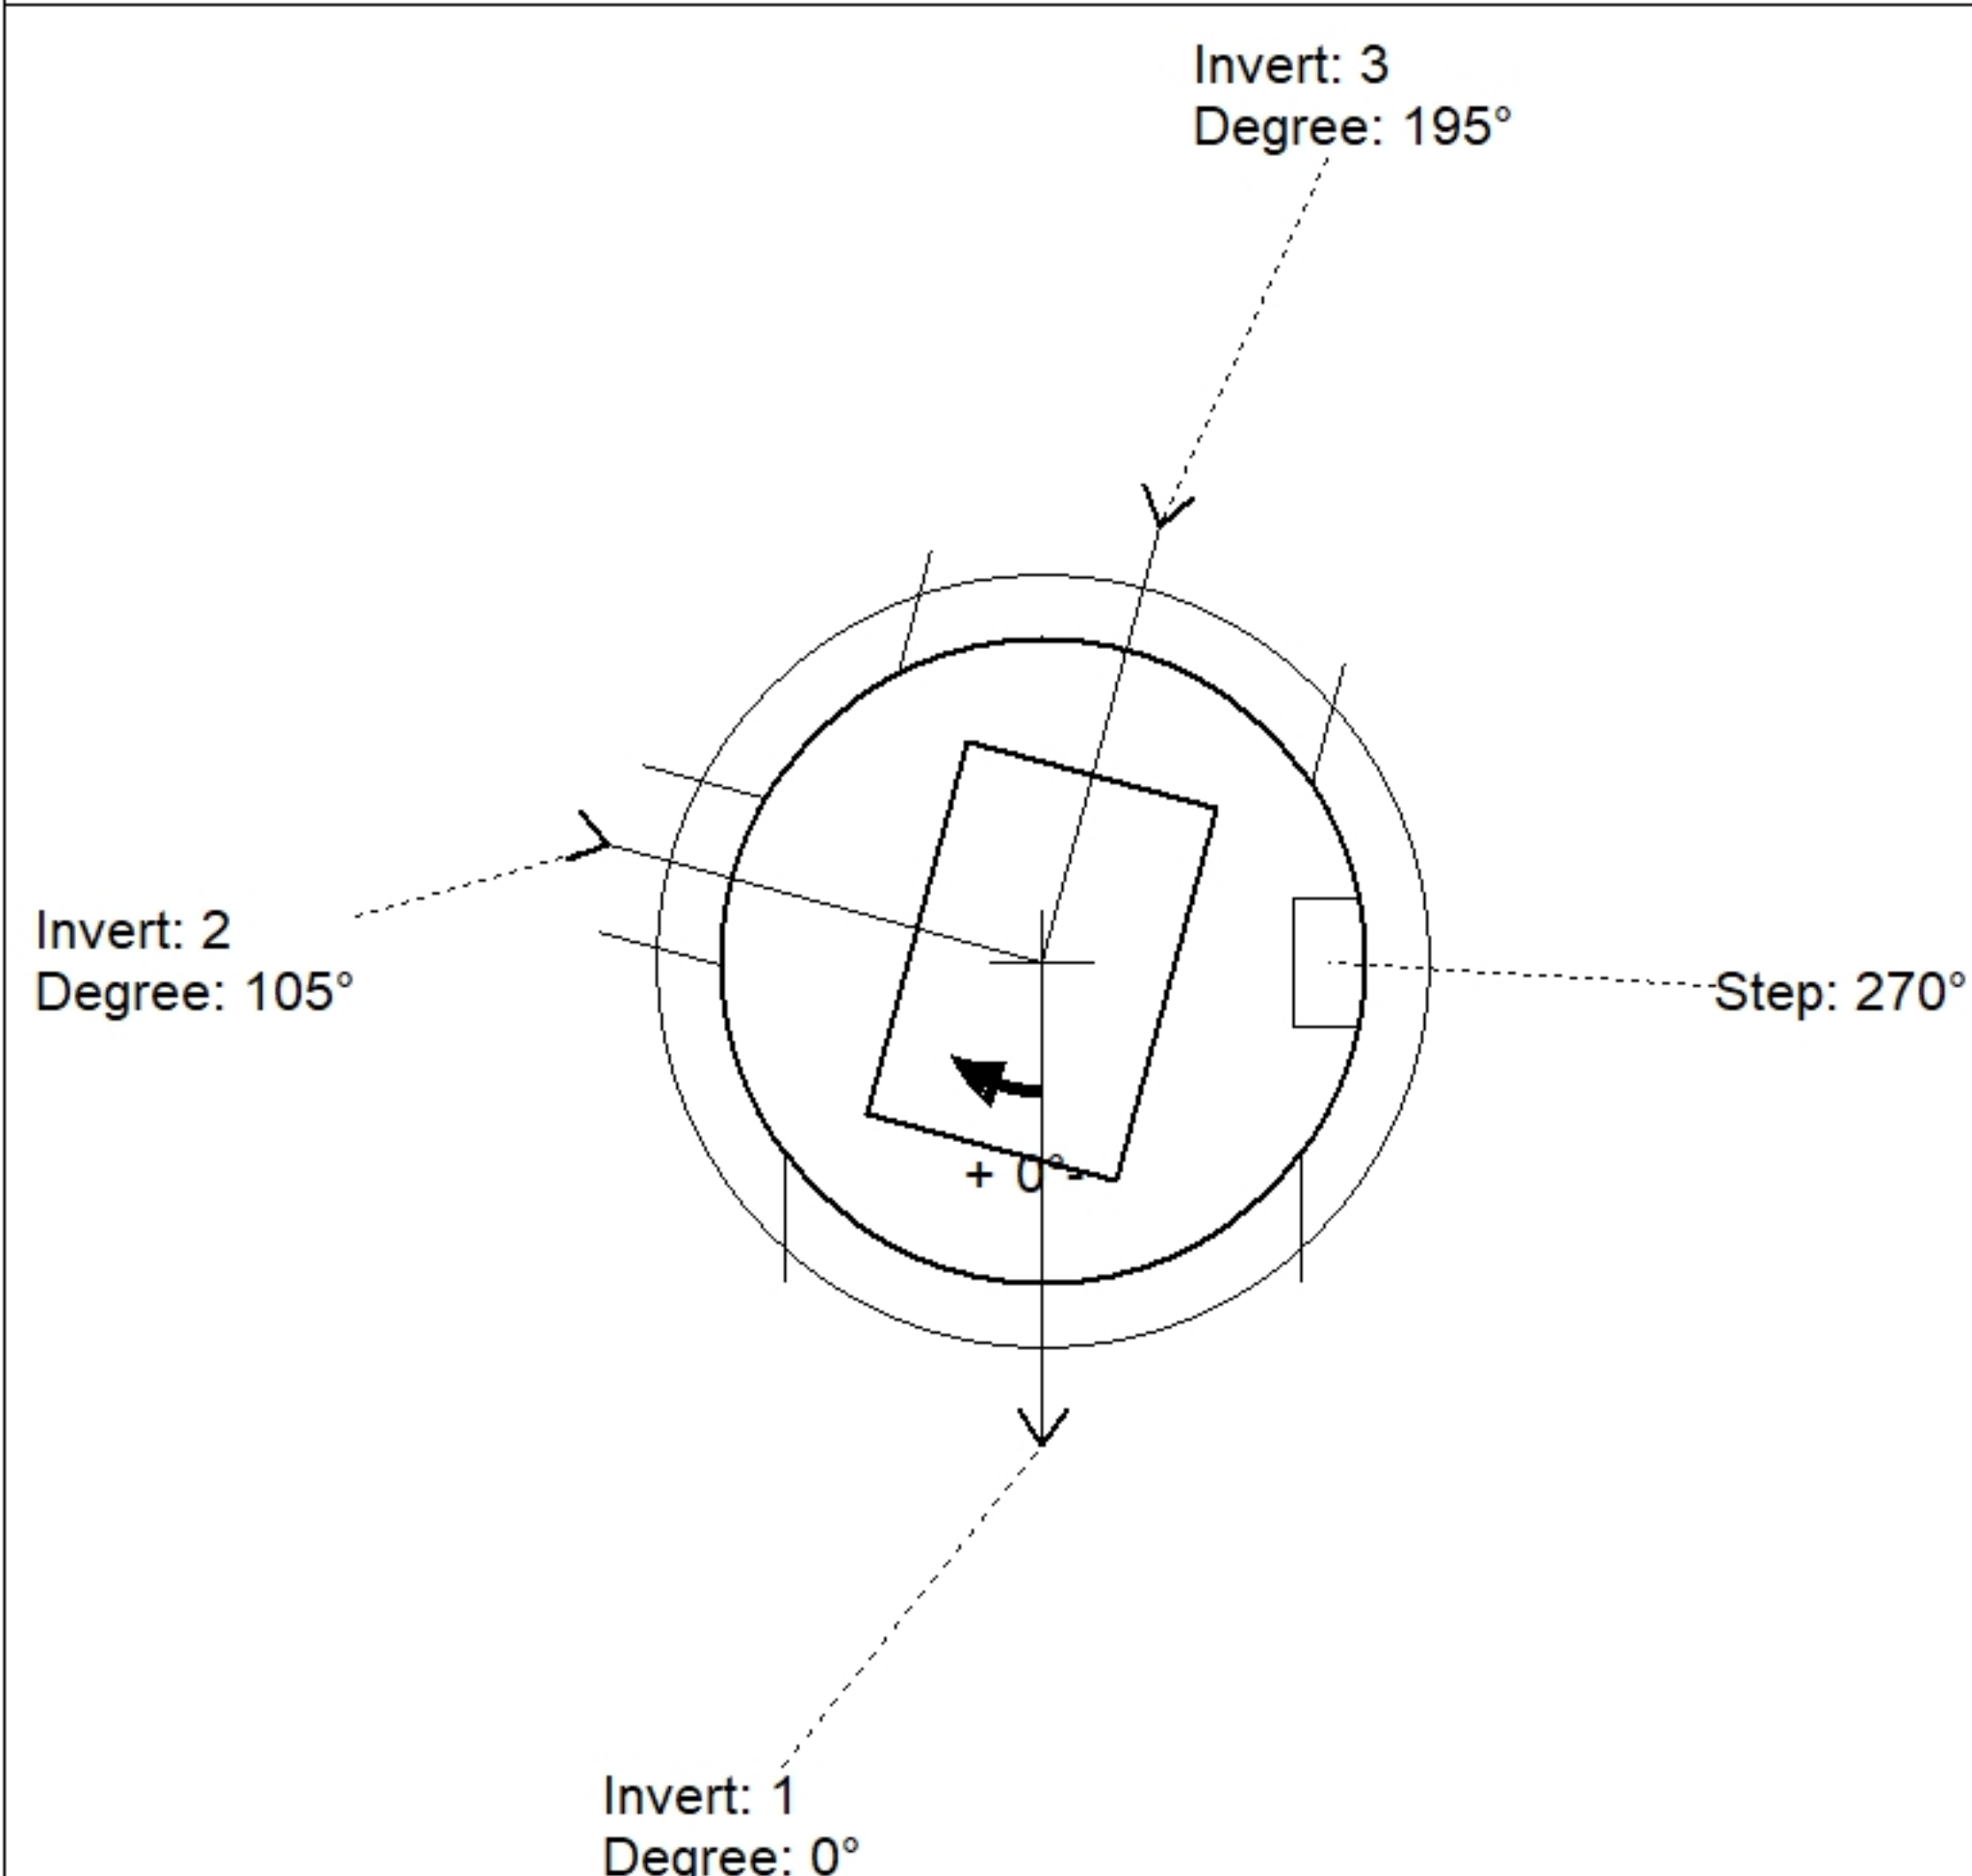

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up (')	Ref
Rim	934.75'							
Reducer								
Invert 1	926.34'	0°	36" RCP B WALL	44"	48"	Hole 48	0"	P1
Invert 2	926.44'	105°	12" HDPE	14.5"	16"	Hole 16	3.95"	P1
Invert 3	926.34'	195°	30" RCP B WALL	37"	40"	Hole 40	0.5"	P1
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

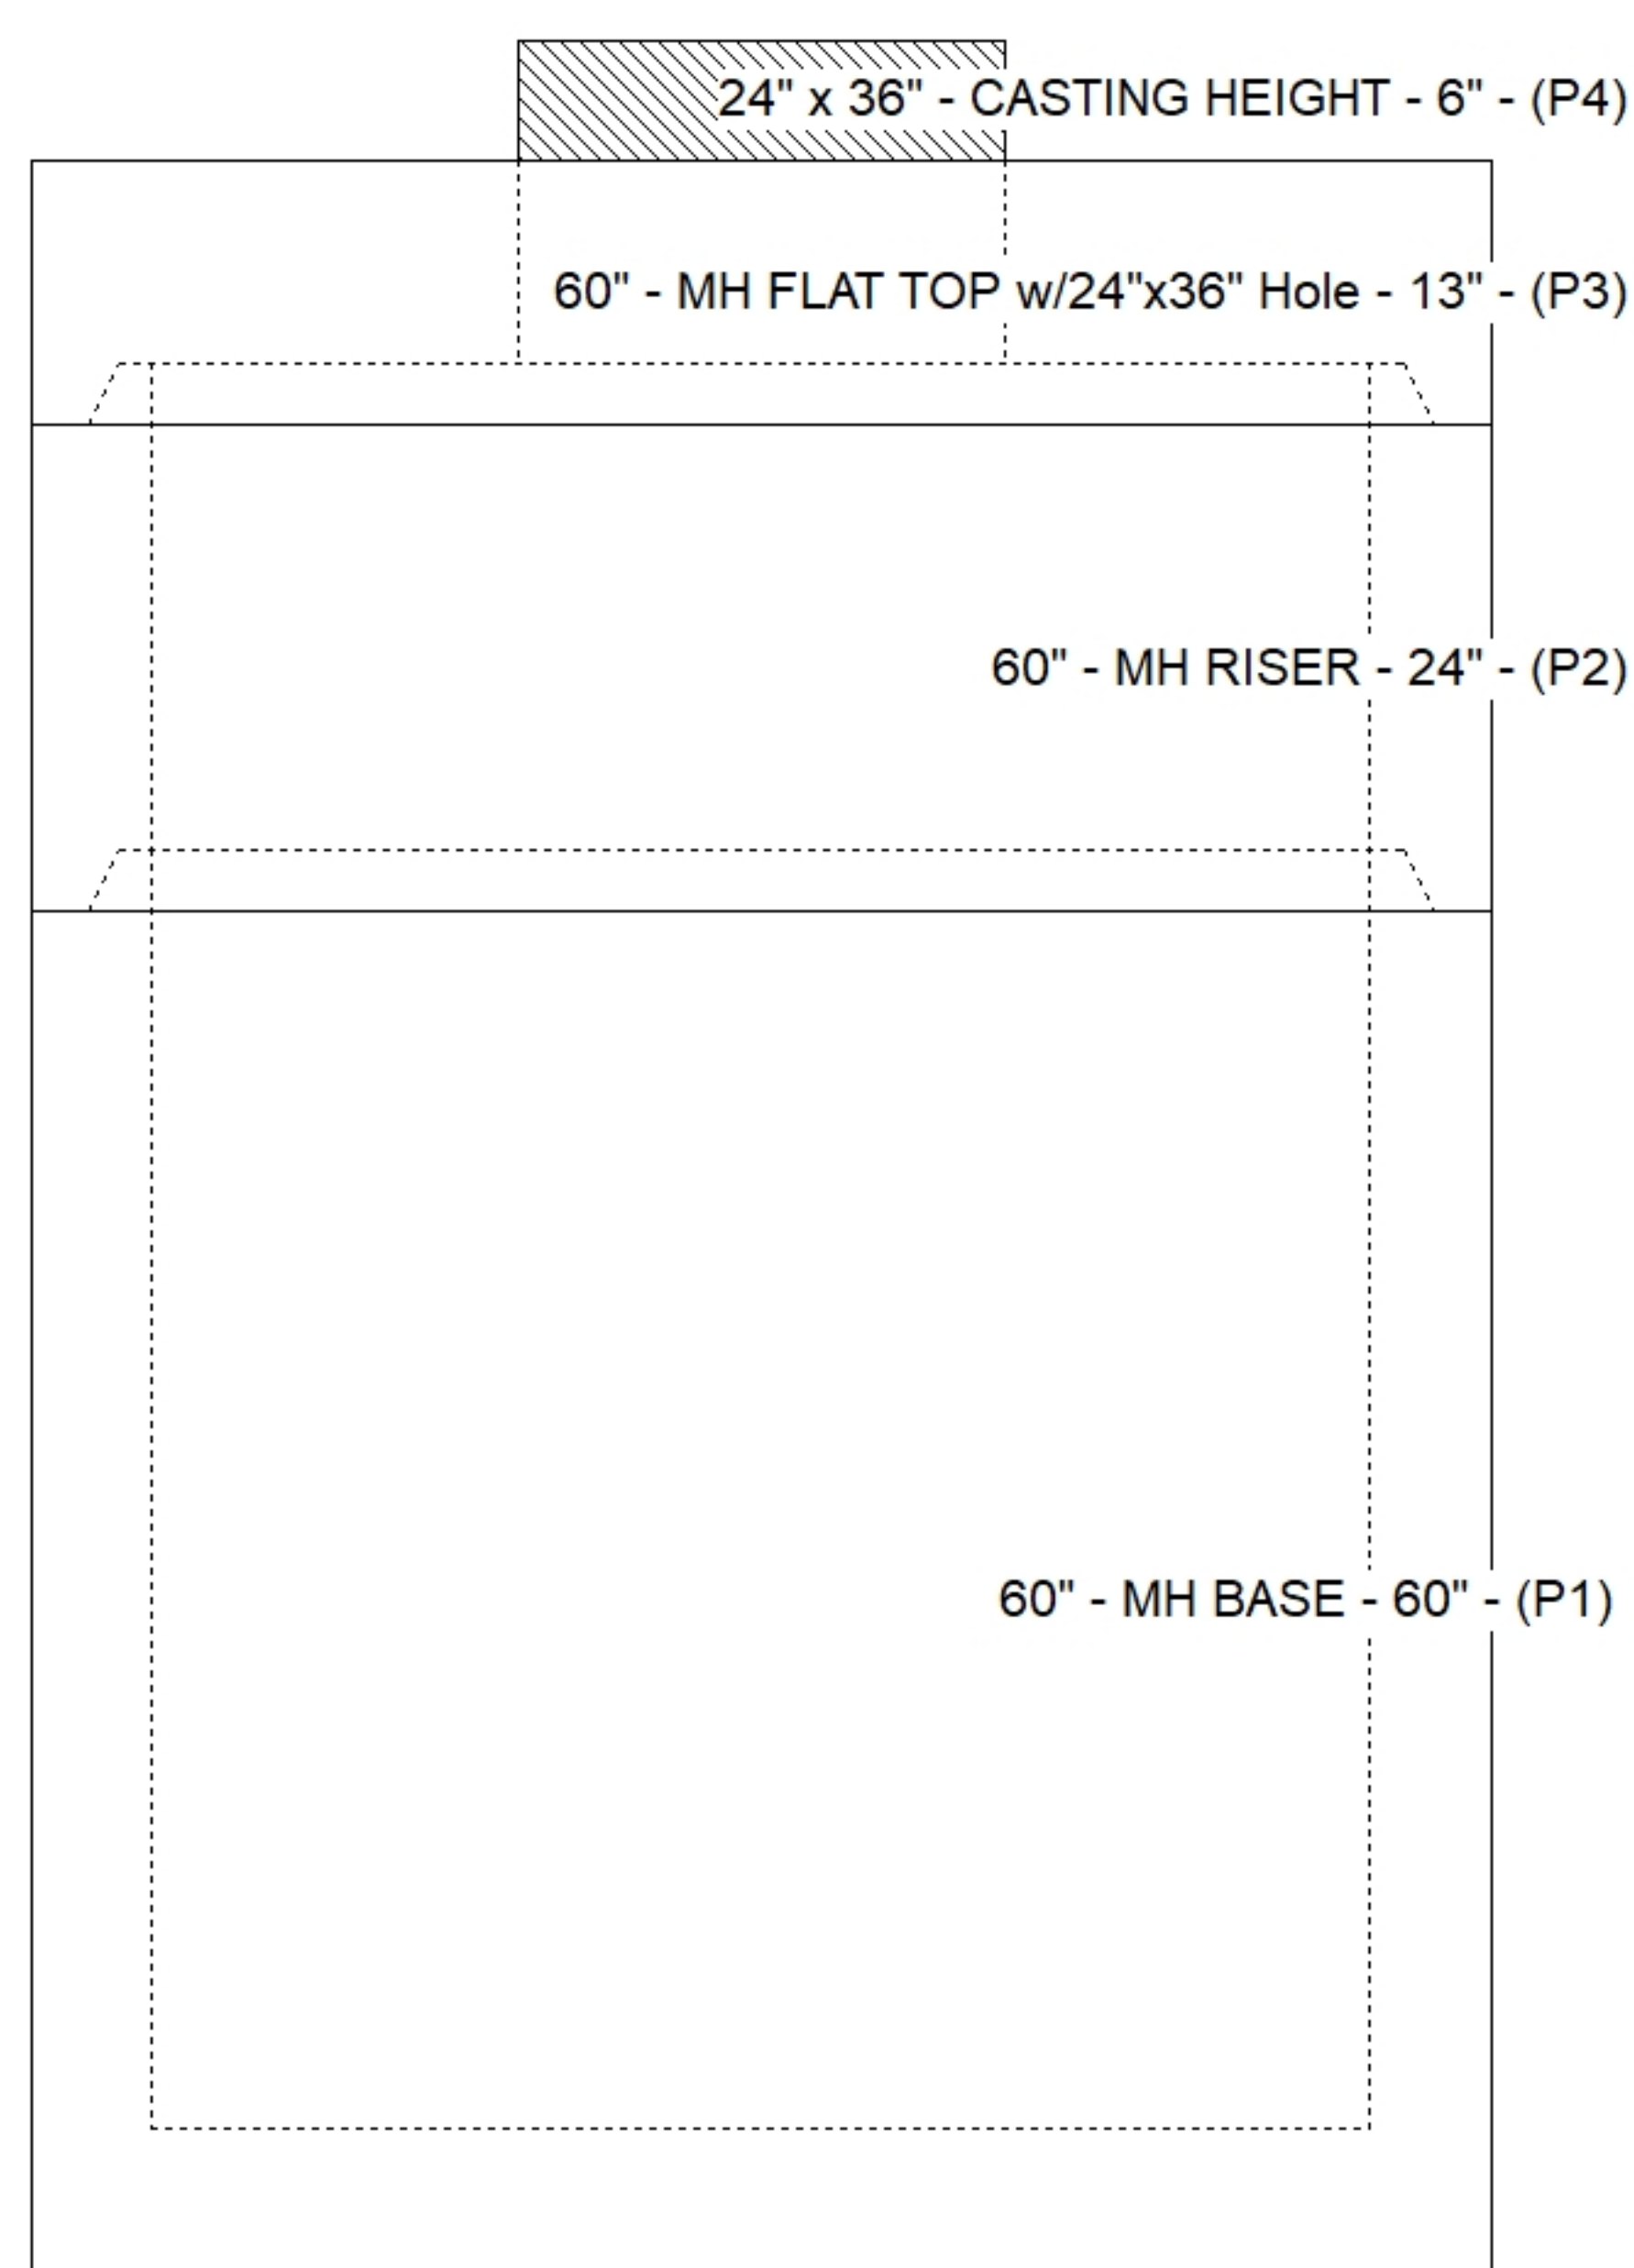

Default - Interior Dimensions

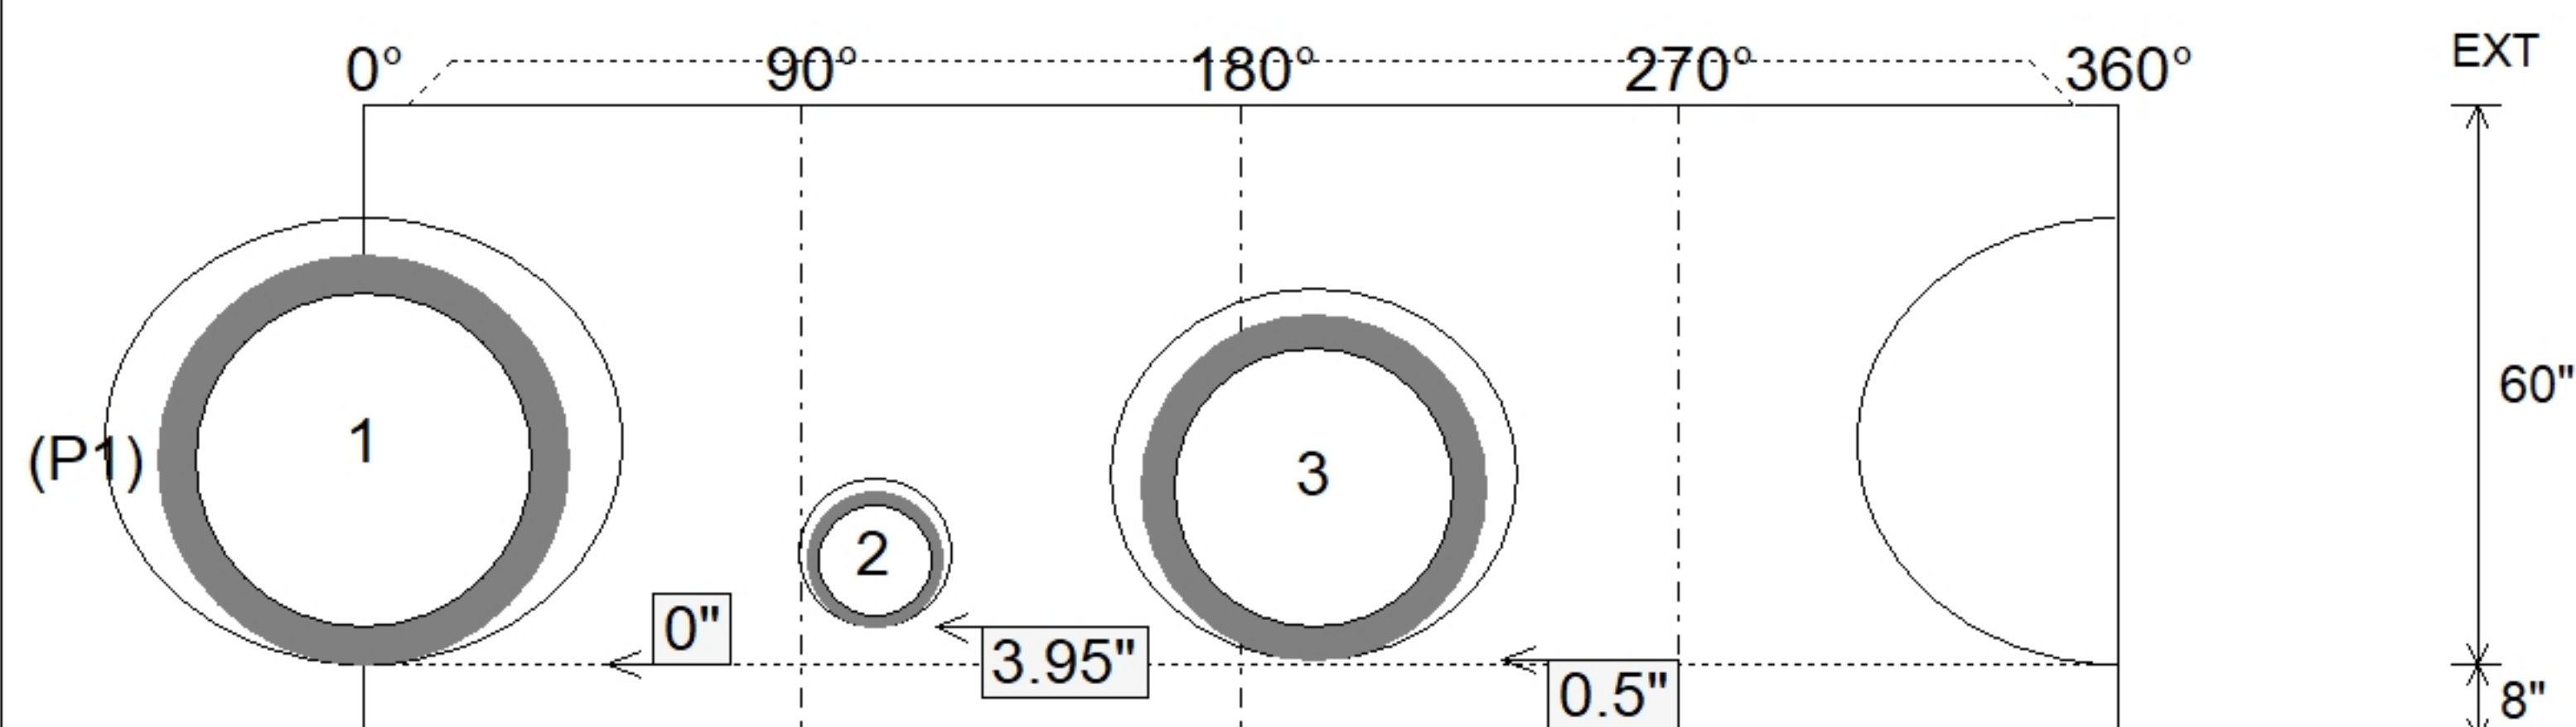

Submittal Drawing
9/29/2026 8:25:41 AM

SUBMITTAL
APPROVED BY: