

Contractor: RD Sitework LLC

TECH: Jared - F

Plant: 100



Slack: 0"


REINFORCING PER ASTM A615 (GRADE 60).

- TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W..
- RISER/WALLS (As .12)
- FLOOR (As .31) #5 BARS AT 12" C.C.E.W.


P3) 24" x 36" - CASTING HEIGHT - 6"
P2) 48" - MH FLAT TOP w/24"x36" Hole - 12"
P1) 48" - MH BASE Custom Ht - 45"
1) CASTING - HOE 525 SET FLAT GRATE (F/G/H)
1) 48" - Conseal CS-102 1.00"
1) 24" x 36" - Conseal CS-102 1.00"
1) Hole - 32
1) Hole - 26

0 lb
1300 lb
3877 lb
442 lb
0 lb
0 lb
0 lb
0 lb


Structure Total: 5619 lb

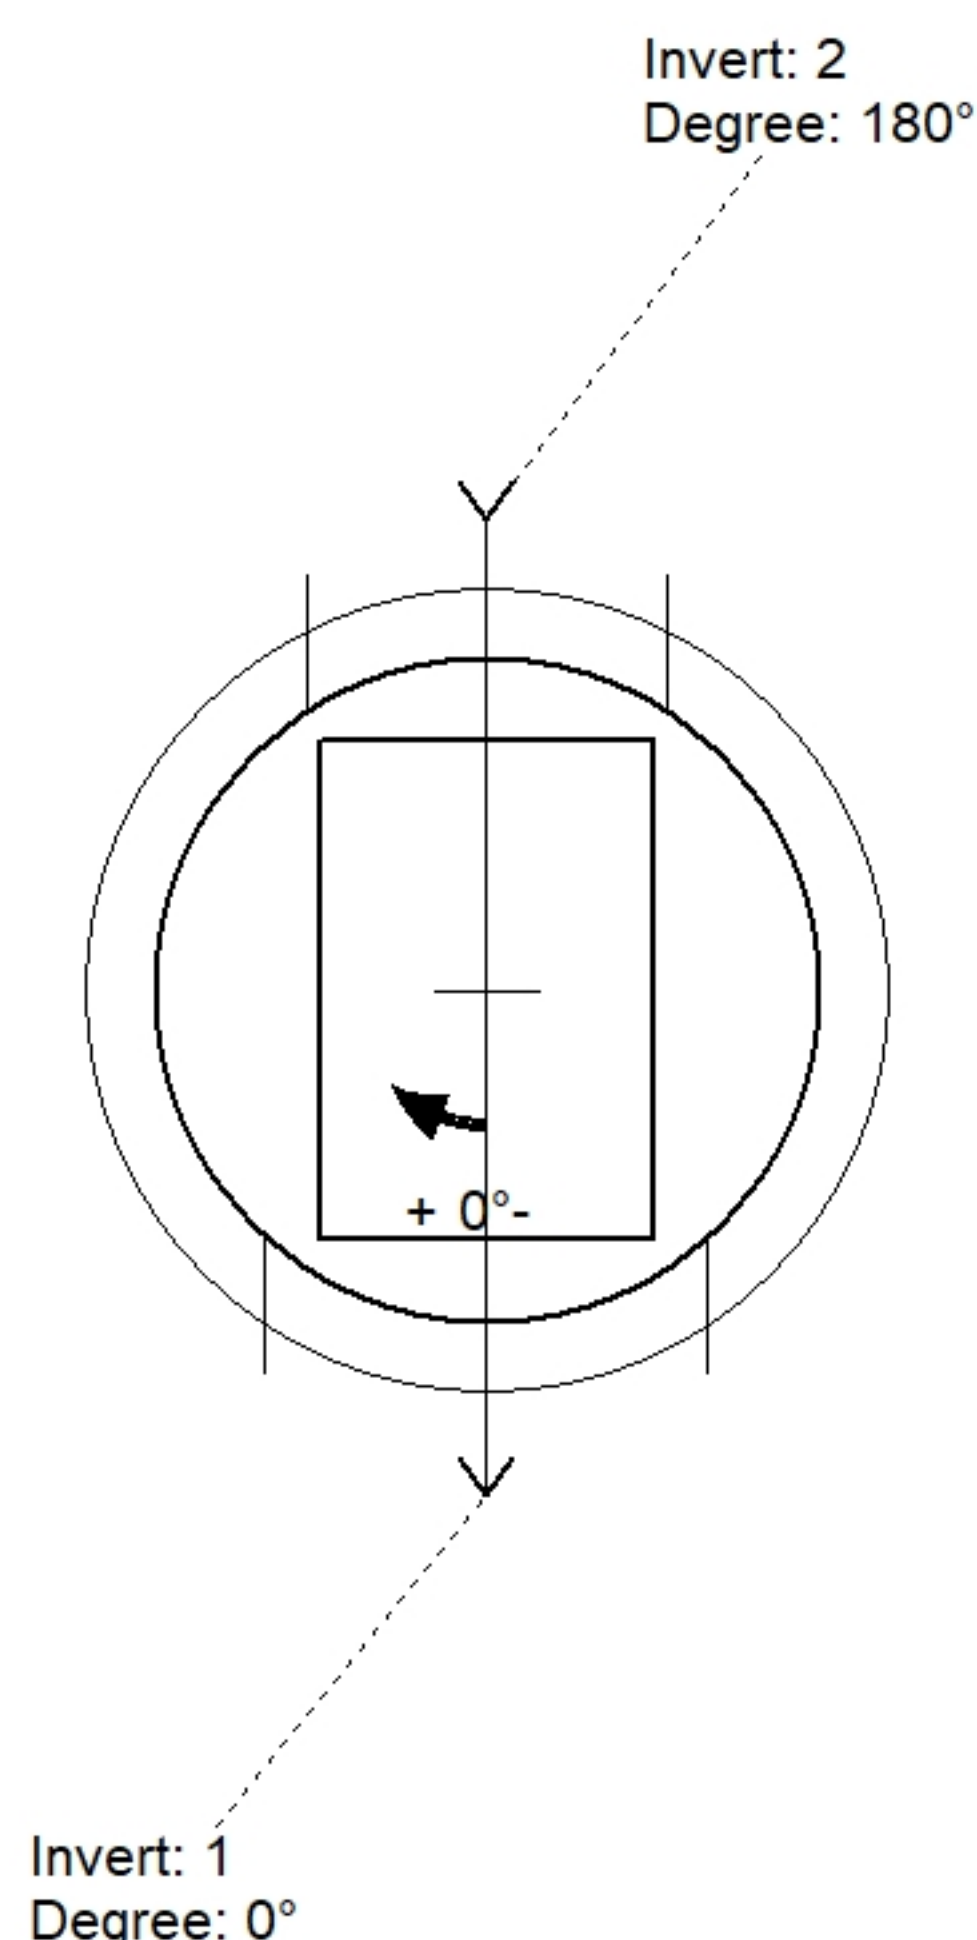

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up ()	Ref
Rim	688.28'							
Reducer								
Invert 1	683.28'	0°	24" RCP B WALL	30"	32"	Hole 32	0"	P1
Invert 2	683.28'	180°	18" RCP B WALL	23"	26"	Hole 26	0.5"	P1
Invert 3								
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

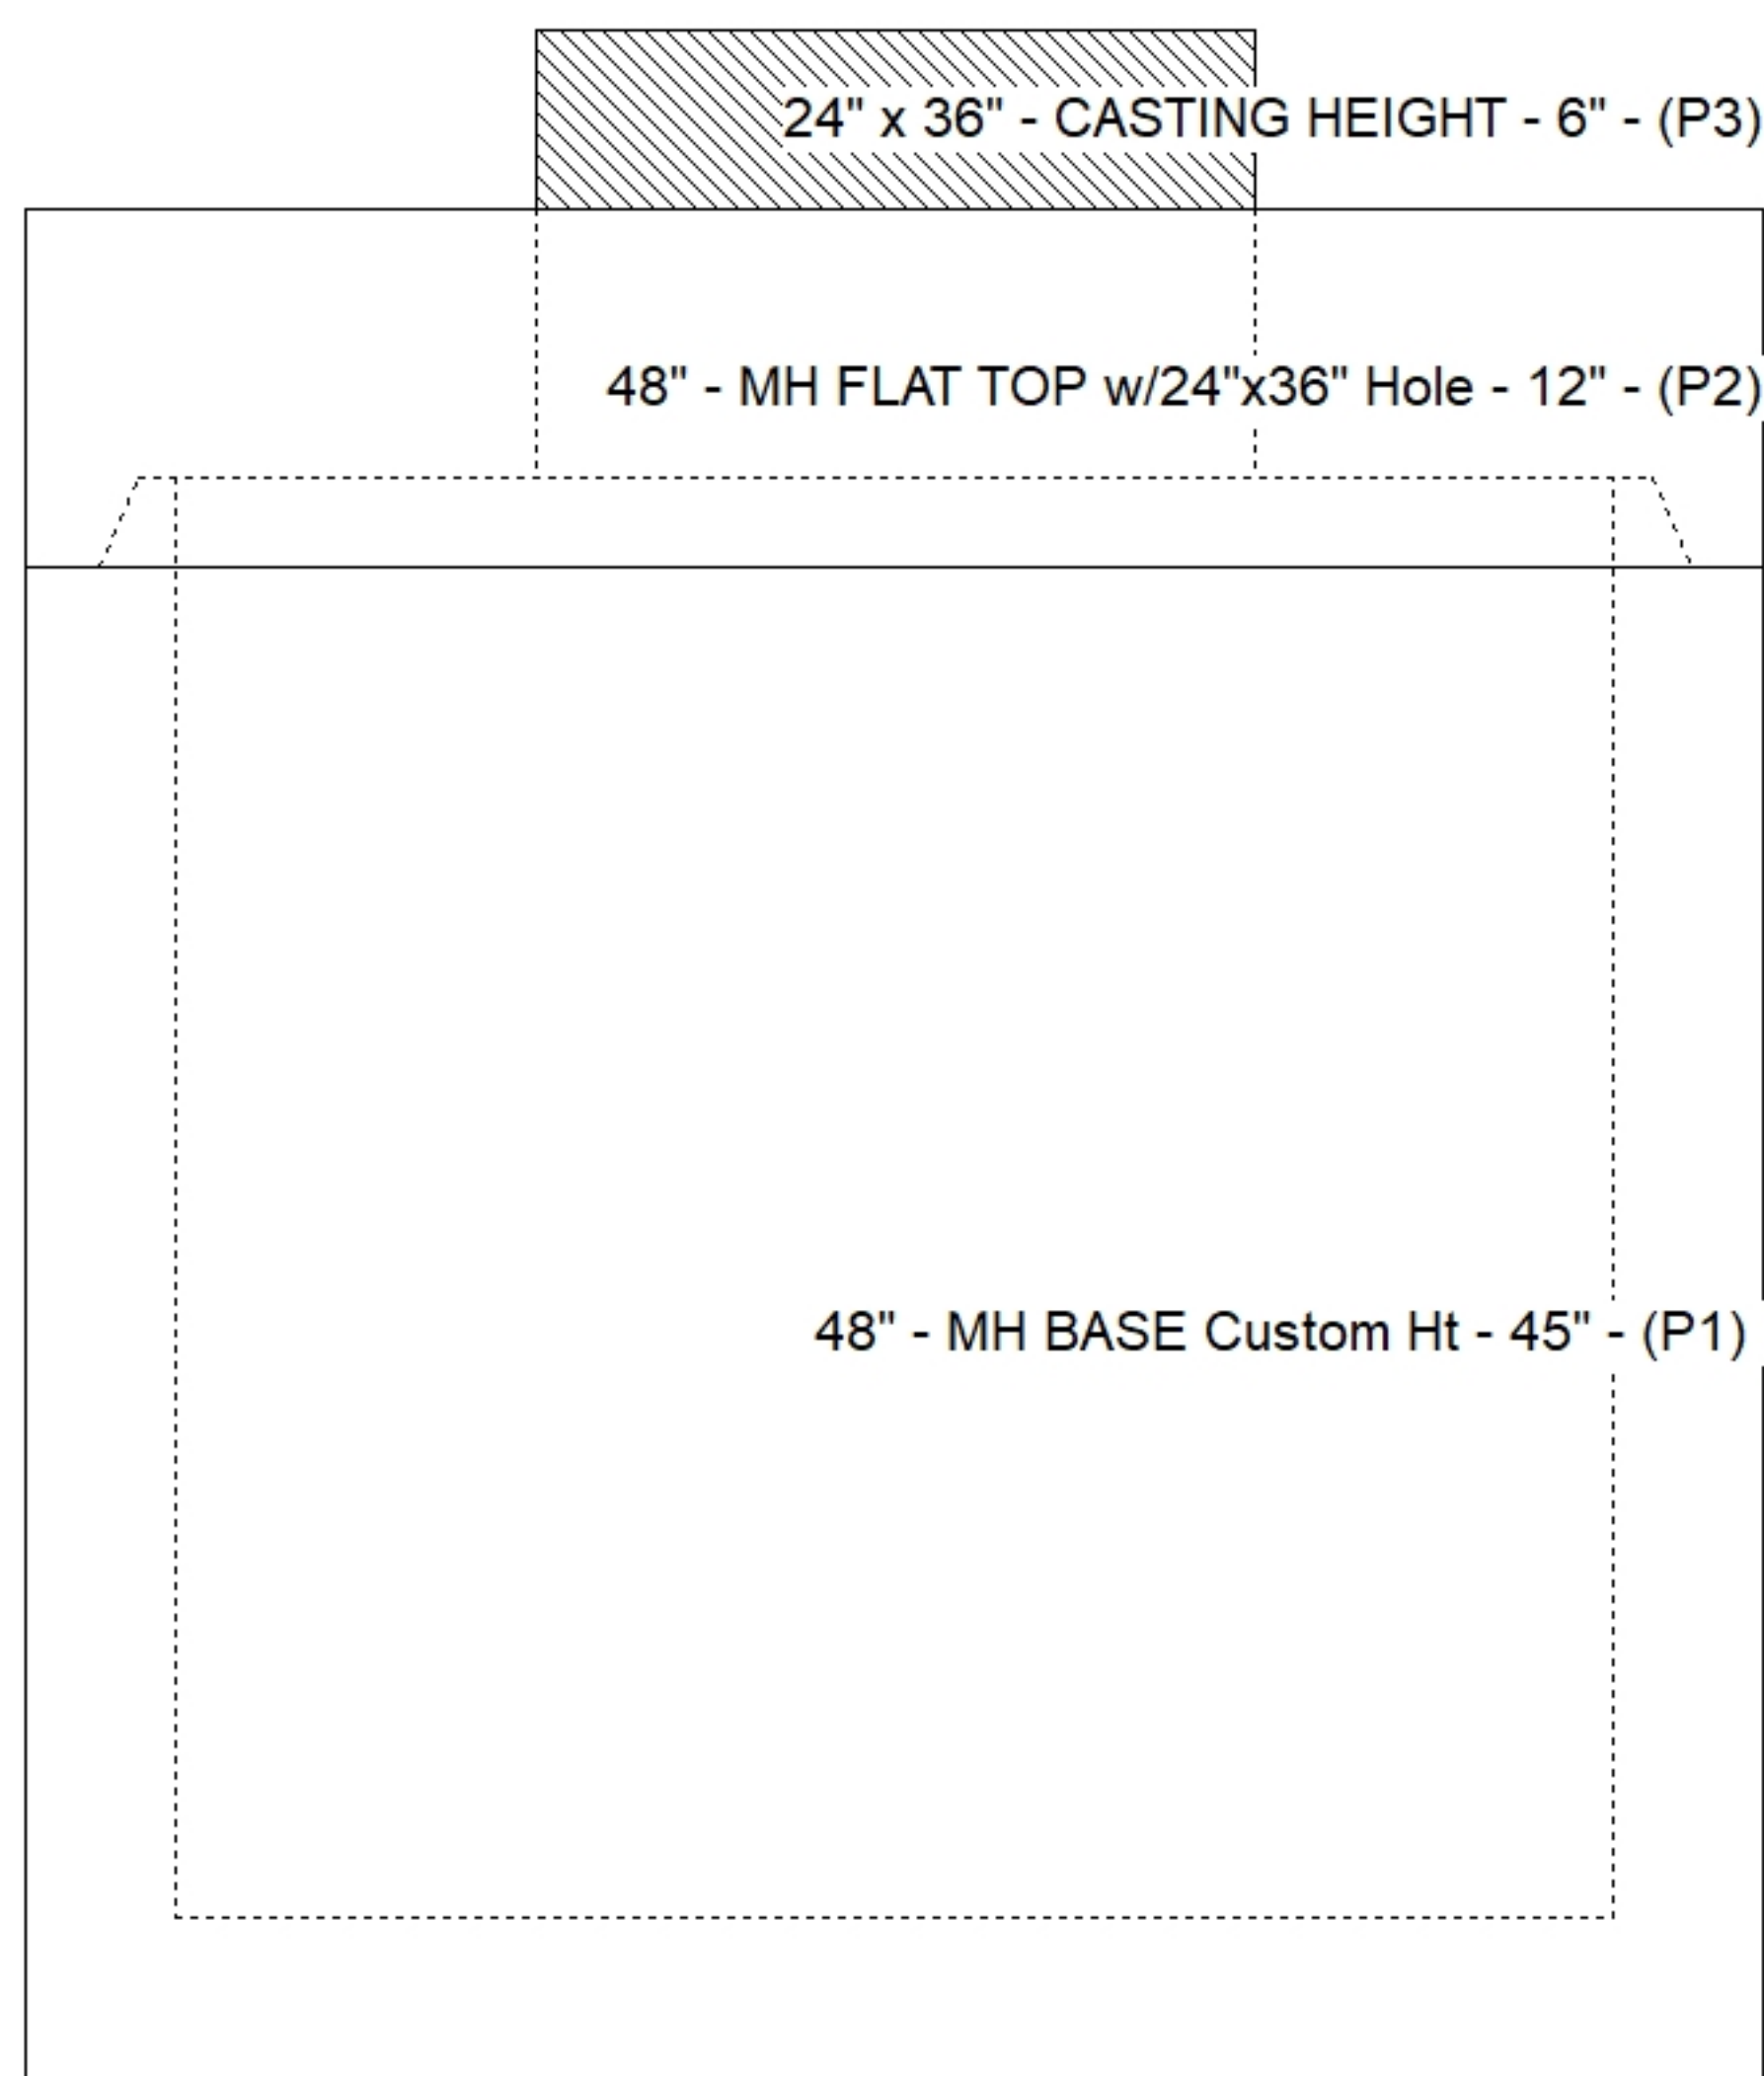

Default - Interior Dimensions

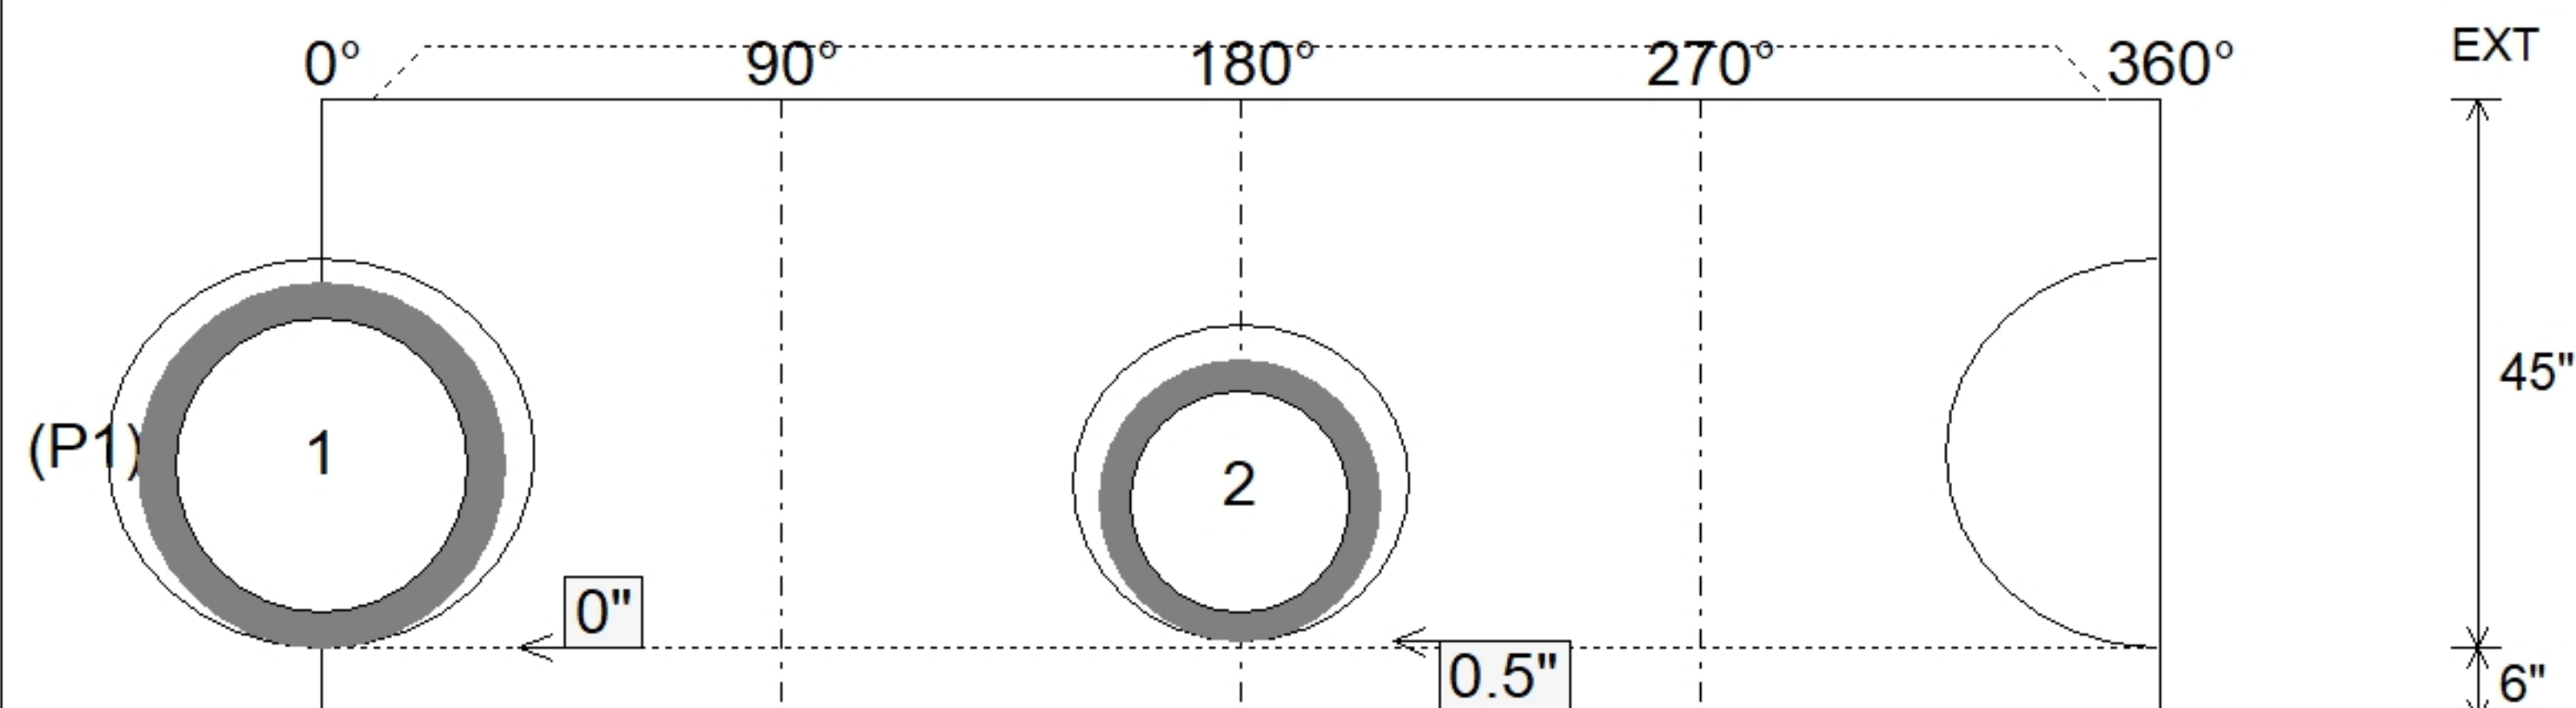

Submittal Drawing
6/8/2026 12:38:56 PM

SUBMITTAL
APPROVED BY: