

Job Name: 26-1961 - Dollar Tree
 Job Location: Hanson, KY
 Contractor: Steve Pleasant Excavating

Plant: 100
 4/30/2026 12:57:26 PM

Tech: Jared - F
 PC: E. Bradley



Structure ID: CB2 ST-CB

P1 BX2424-08BAVF

BOX BASE 8inW, 8inF, Variable Ht F/n

- P2) 24" x 24" - CASTING HEIGHT - 7"
- P1) 24" x 24" - BOX BASE 8inW, 8inF, Variable Ht F/n - 23"
- 1) CASTING - HOE MCB-375-B F/Bar Grt
- 1) 24" x 24" - Conseal CS-102 1.00"
- 1) Hole - 16
- 1) Hole - 10

0 lb
 2863 lb
 250 lb
 0 lb
 0 lb
 0 lb

 Structure Total: 3113 lb

- Structure Notes:**
1. PER ASTM C913 SPECIFICATIONS.
 2. CONCRETE = 4,000 PSI AT 28 DAYS.
 3. NO STEPS AND NO INVERT CHANNEL.
 4. CASTING BY ICAST(HOE MCB-375-B F/Bar Grt).




REINFORCING PER ASTM A615 (GRADE 60).
 - WALLS (As .12) #5 BARS AT 12" C.C.E.W.
 - FLOOR (As .12) #5 BARS AT 12" C.C.E.W.

Rim: 429.41' Rim to Invert: 2.46' Slack: 0.645" Sump: 1.125" Step Position:


Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset
Invert 1	426.95'	0°	20"	12" HP STORM	14.5"	Hole 16	16"	16"	0"	0"
Invert 2	427.28'	90°	20"	8" PVC SDR35	8.5"	Hole 10	10"	10"	4.875"	0"
Invert 3										
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										

RIGHT-SIDE UP VIEW (int. dimensions)

UPSIDE-DOWN VIEW (int. dimensions)

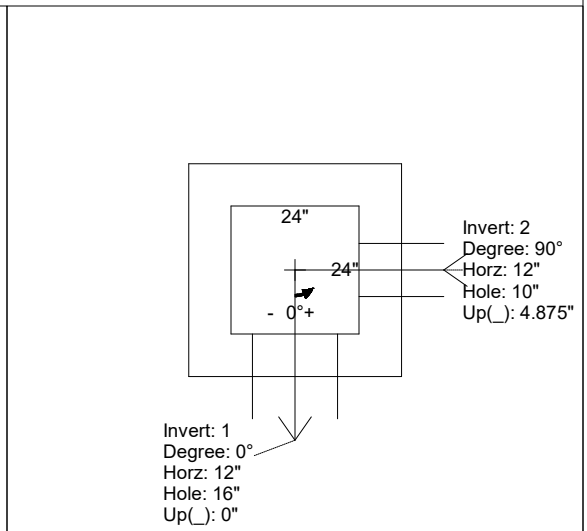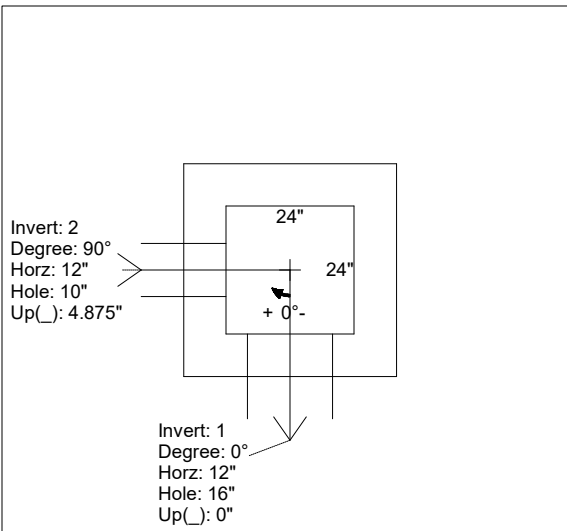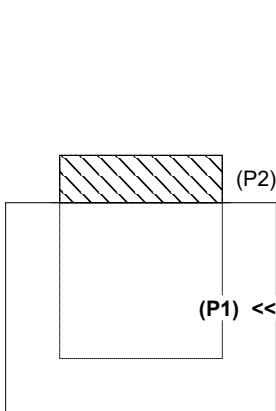

INSIDE WALL DIMENSIONS

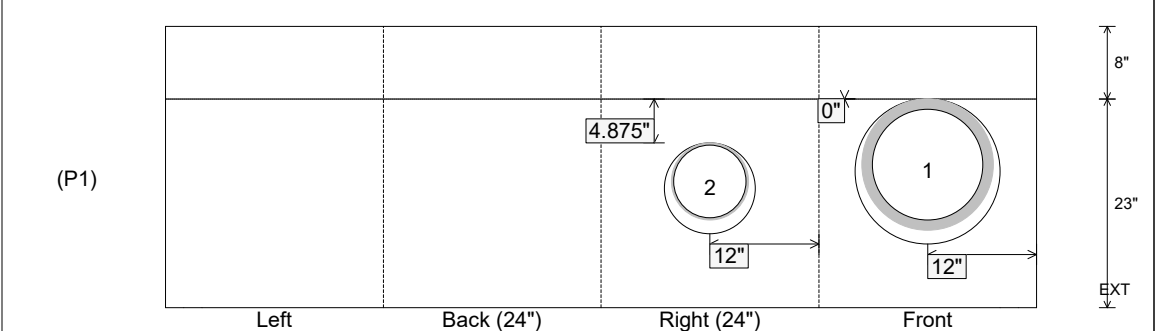

Coating (Int):
 Coating (Ext):

Seam Up: Flat
 Seam Dn: n/a

Wall Thickness: 8"
 Floor Height: 8"

Height (Int): 23"
 Height (Ext): 31"

Weight (Net): 2863 lb
 Volume (Net): 0.73cu.yd