
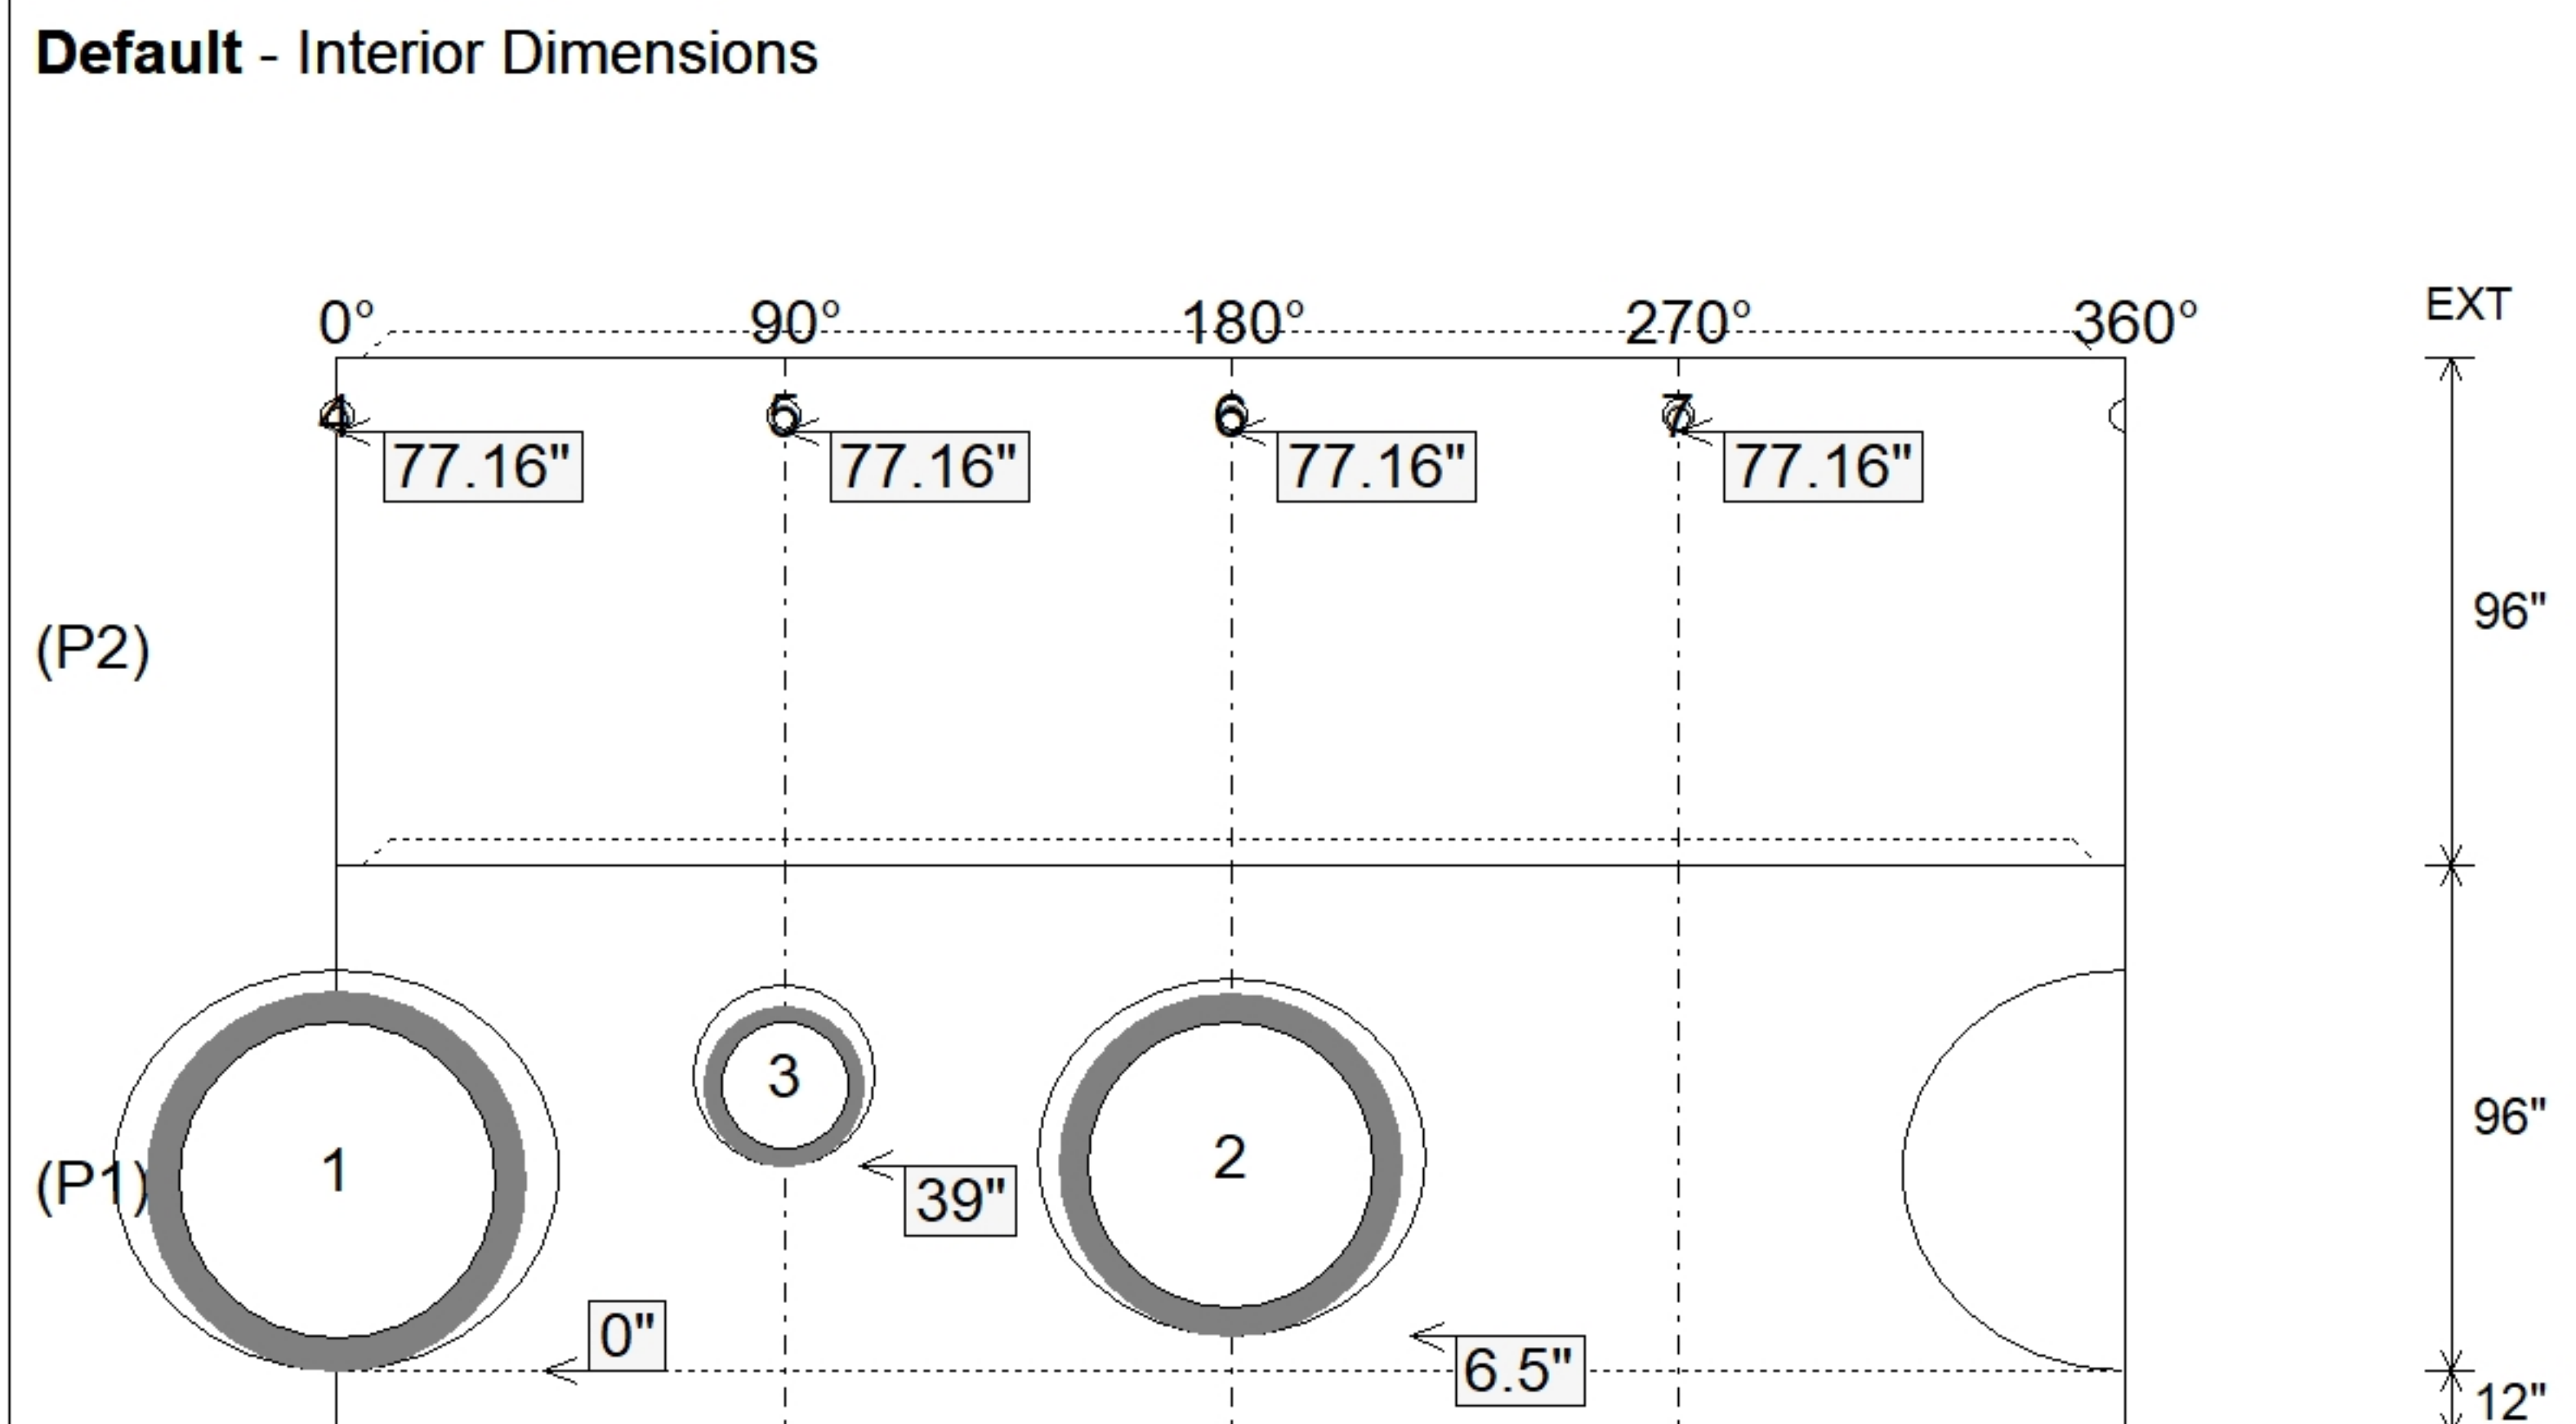


Structure Notes:	STRUCTURE SUMMARY:
1. (CASTING PROVIDED BY OTHERS)	P5) 24" - CASTING HEIGHT - 0"
2. PER ASTM C478 SPECIFICATIONS.	P4) 24" - GRADE RING - 4"
3. CONCRETE = 4,000 PSI AT 28 DAYS.	P3) 108" - MH FLAT TOP w/24" ECC Hole - 17"
4. REINFORCING PER ASTM A615 (GRADE 60).	P2) 108" - MH RISER - 96"
- TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W..	P1) 108" - MH BASE - 96"
- RISER/WALLS (As .36)	2) 108" - Conseal CS-102 1.00"
- FLOOR (As .47) #5 BARS AT 8" C.C.E.W.	2) 24" - Conseal CS-102 1.00"
	1) Hole - 76
	1) Hole - 68
	1) Hole - 34
	4) Hole - 6
	16) MH Step ML-10-TDS-NCR - 10"

	Structure Total:

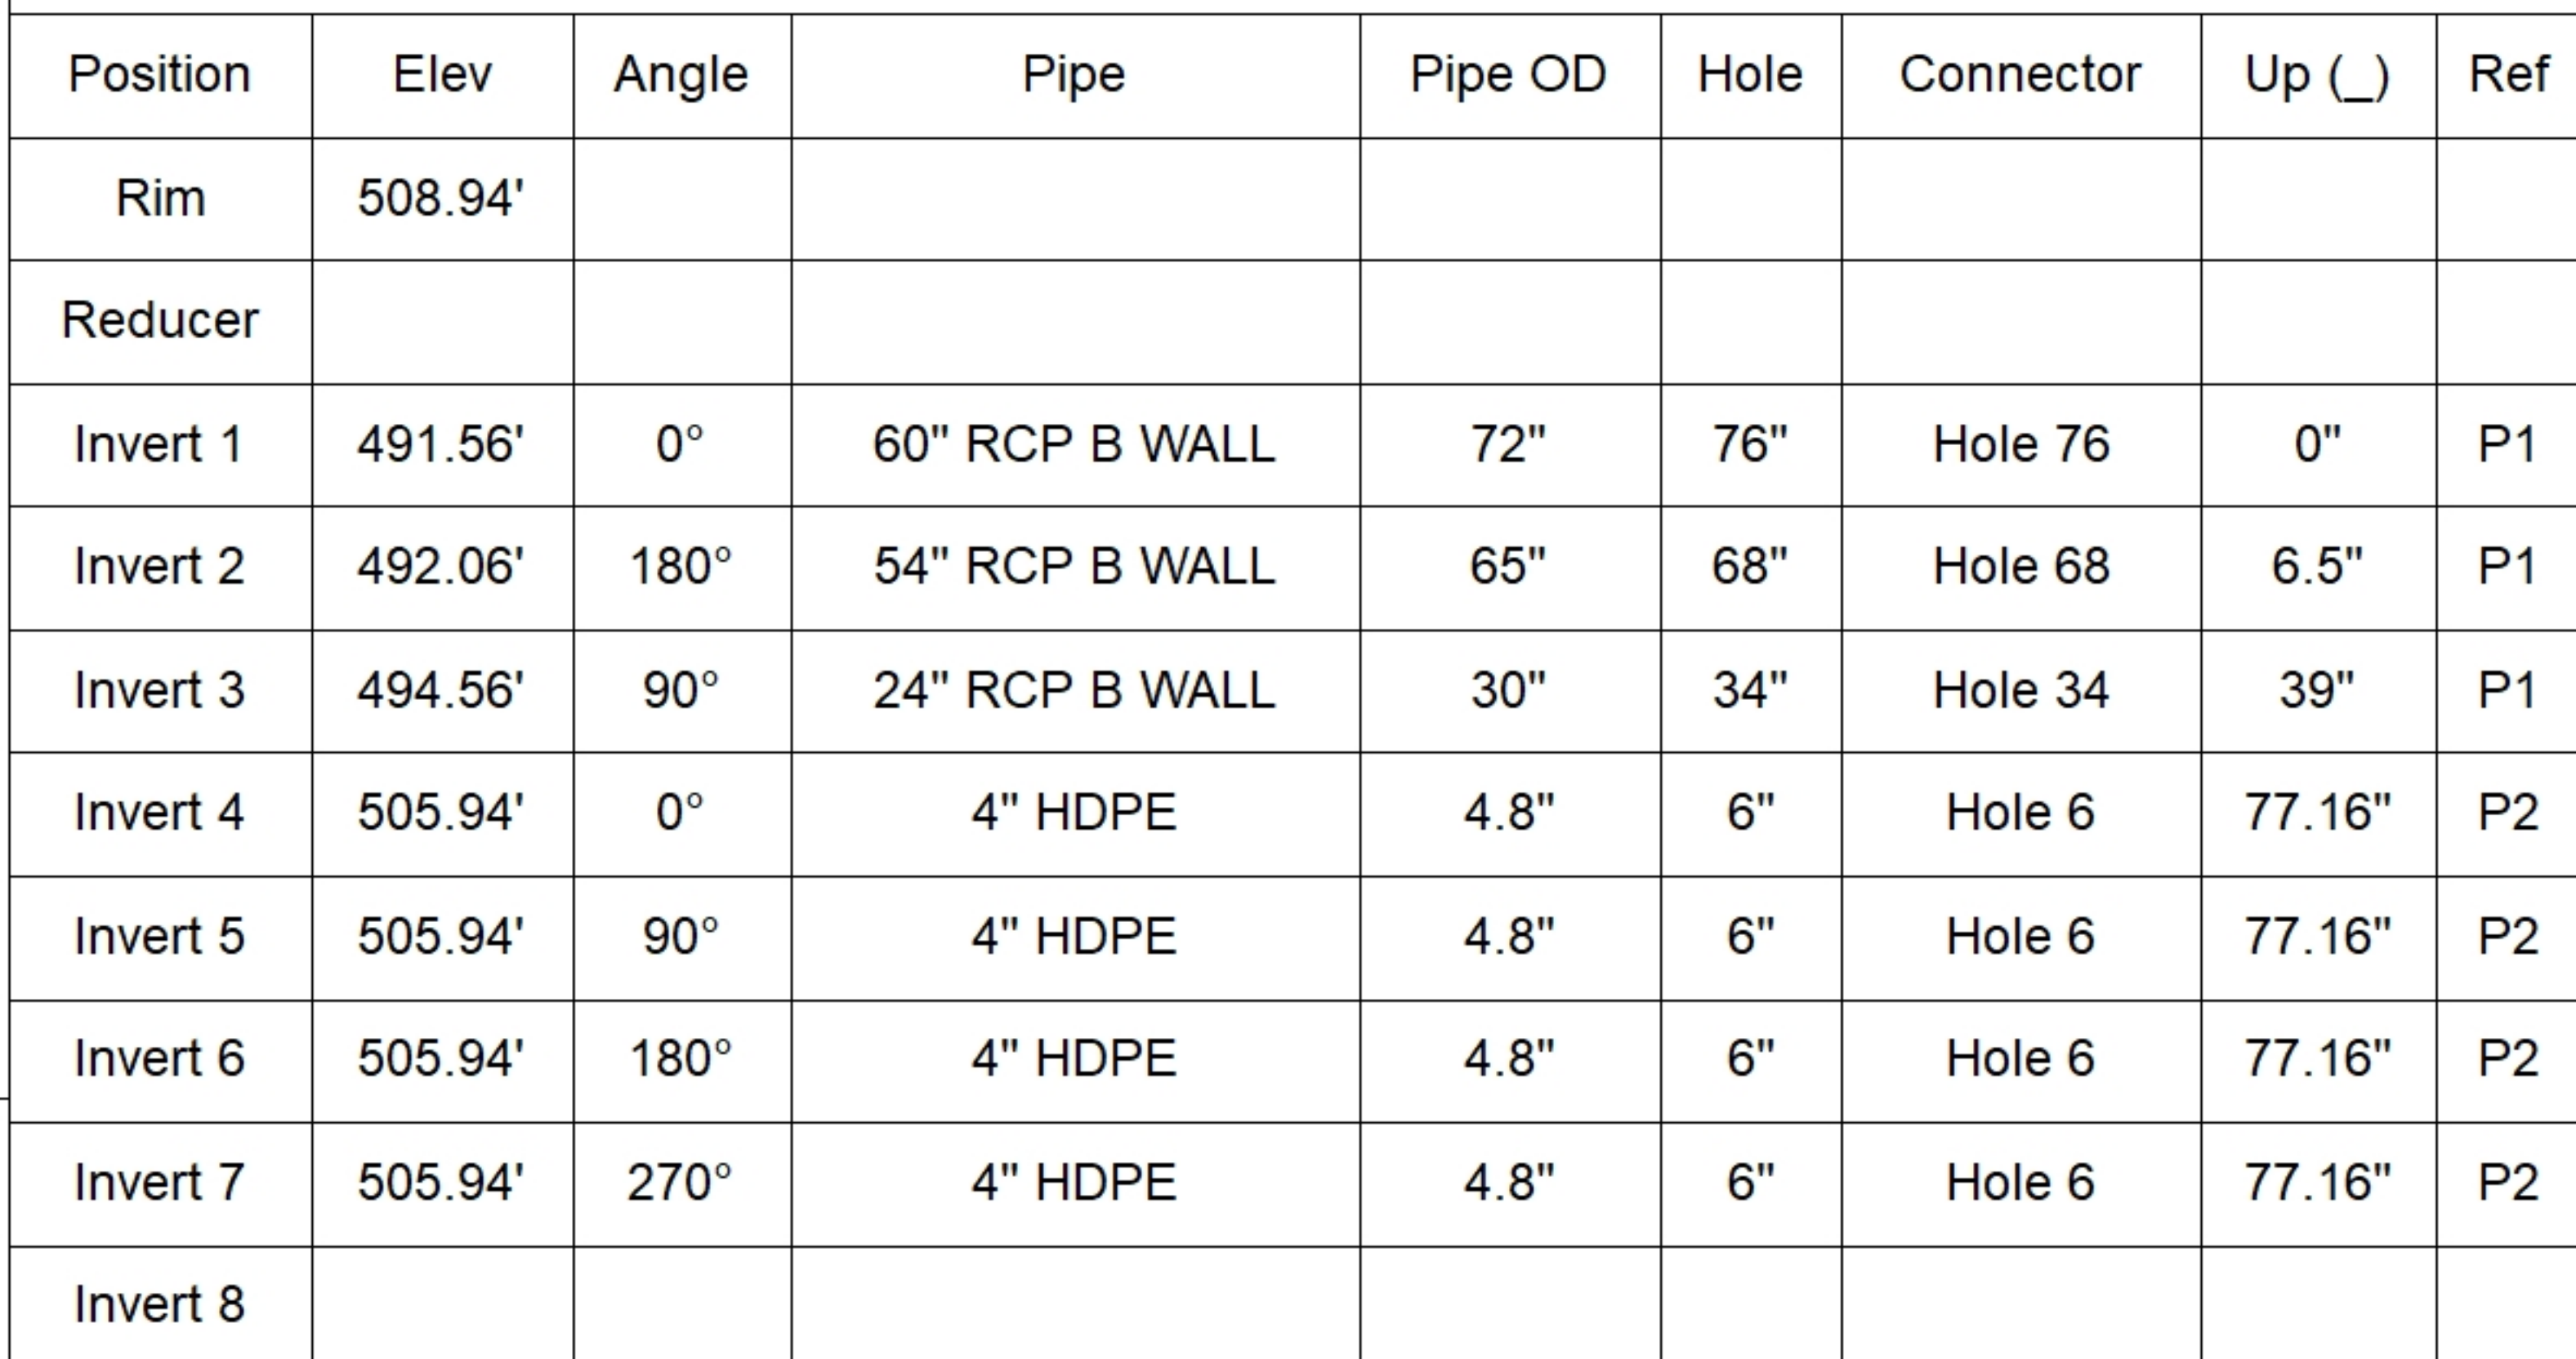

SUBMITTAL
APPROVED BY: