

Contractor: Winwater Hartford KY Co.

Plant: Beaver Dam




Slack: 0.56"

REINFORCING PER ASTM A615 (GRADE 60).


- TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W.
- RISER/WALLS (As .12)
- FLOOR (As .31) #5 BARS AT 12" C.C.E.W.

2) Hole - 6


Structure Total: 5944 lb

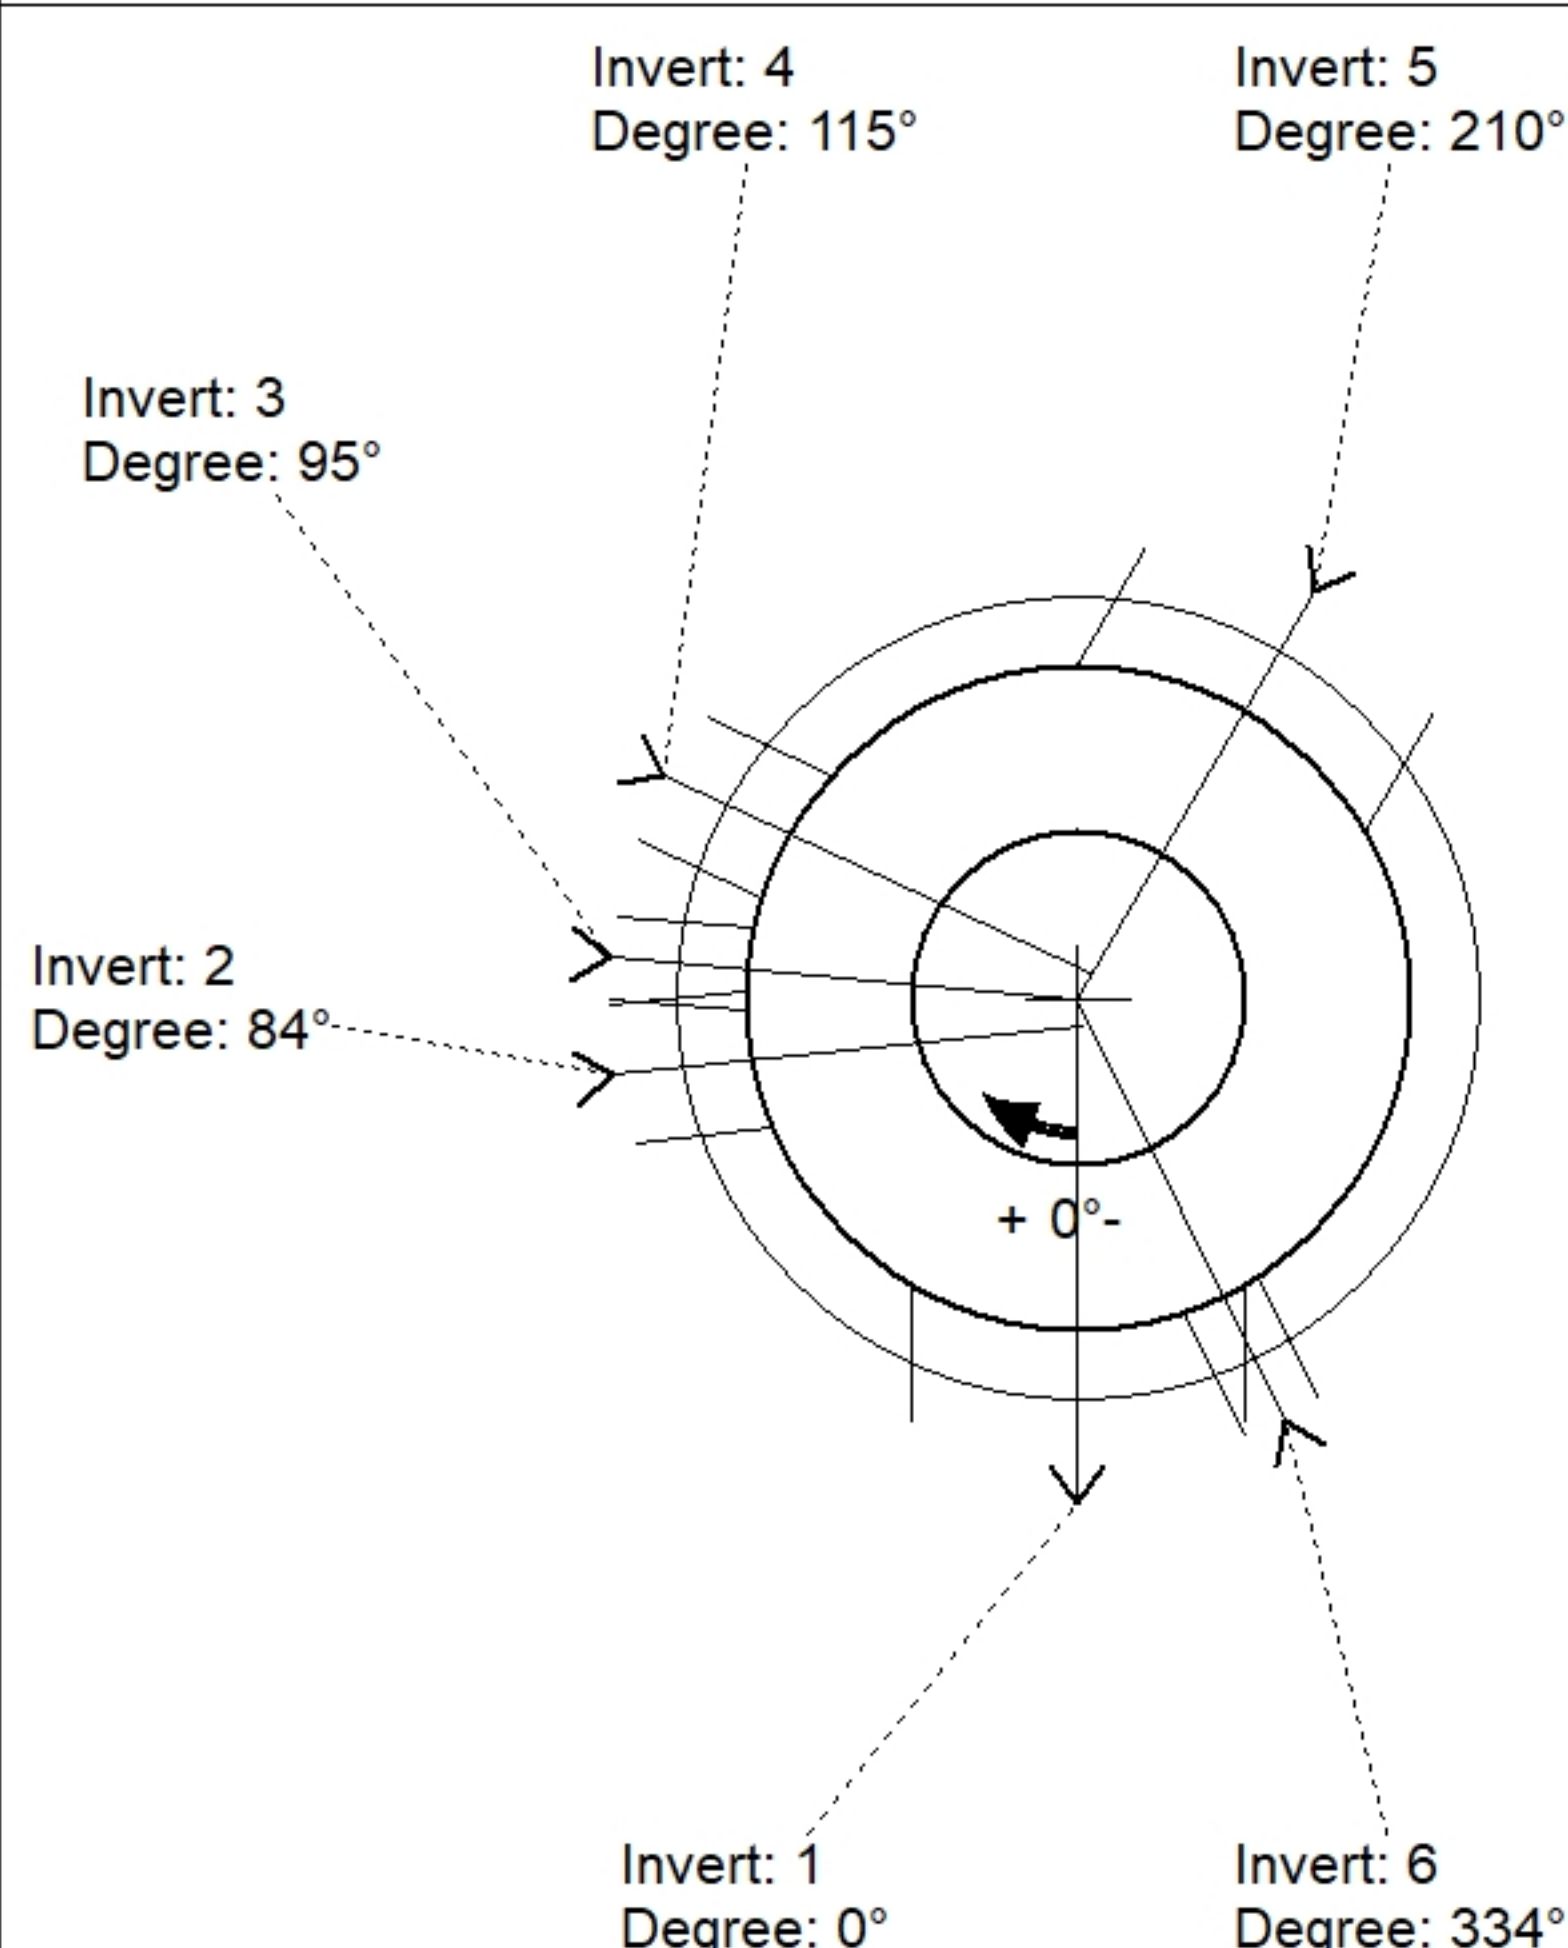

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up ()	Ref
Rim	412'							
Reducer								
Invert 1	407.17'	0°	18" HDPE	21.2"	24"	Hole 24	0"	P1
Invert 2	408.5'	84°	6" HDPE	6.9"	10"	Hole 10	17.11"	P1
Invert 3	409.75'	95°	4" HDPE	4.8"	6"	Hole 6	32.16"	P1
Invert 4	408.5'	115°	6" HDPE	6.9"	10"	Hole 10	17.11"	P1
Invert 5	407.22'	210°	18" HDPE	21.2"	24"	Hole 24	0.6"	P1
Invert 6	410'	334°	4" HDPE	4.8"	6"	Hole 6	35.16"	P1
Invert 7								
Invert 8								

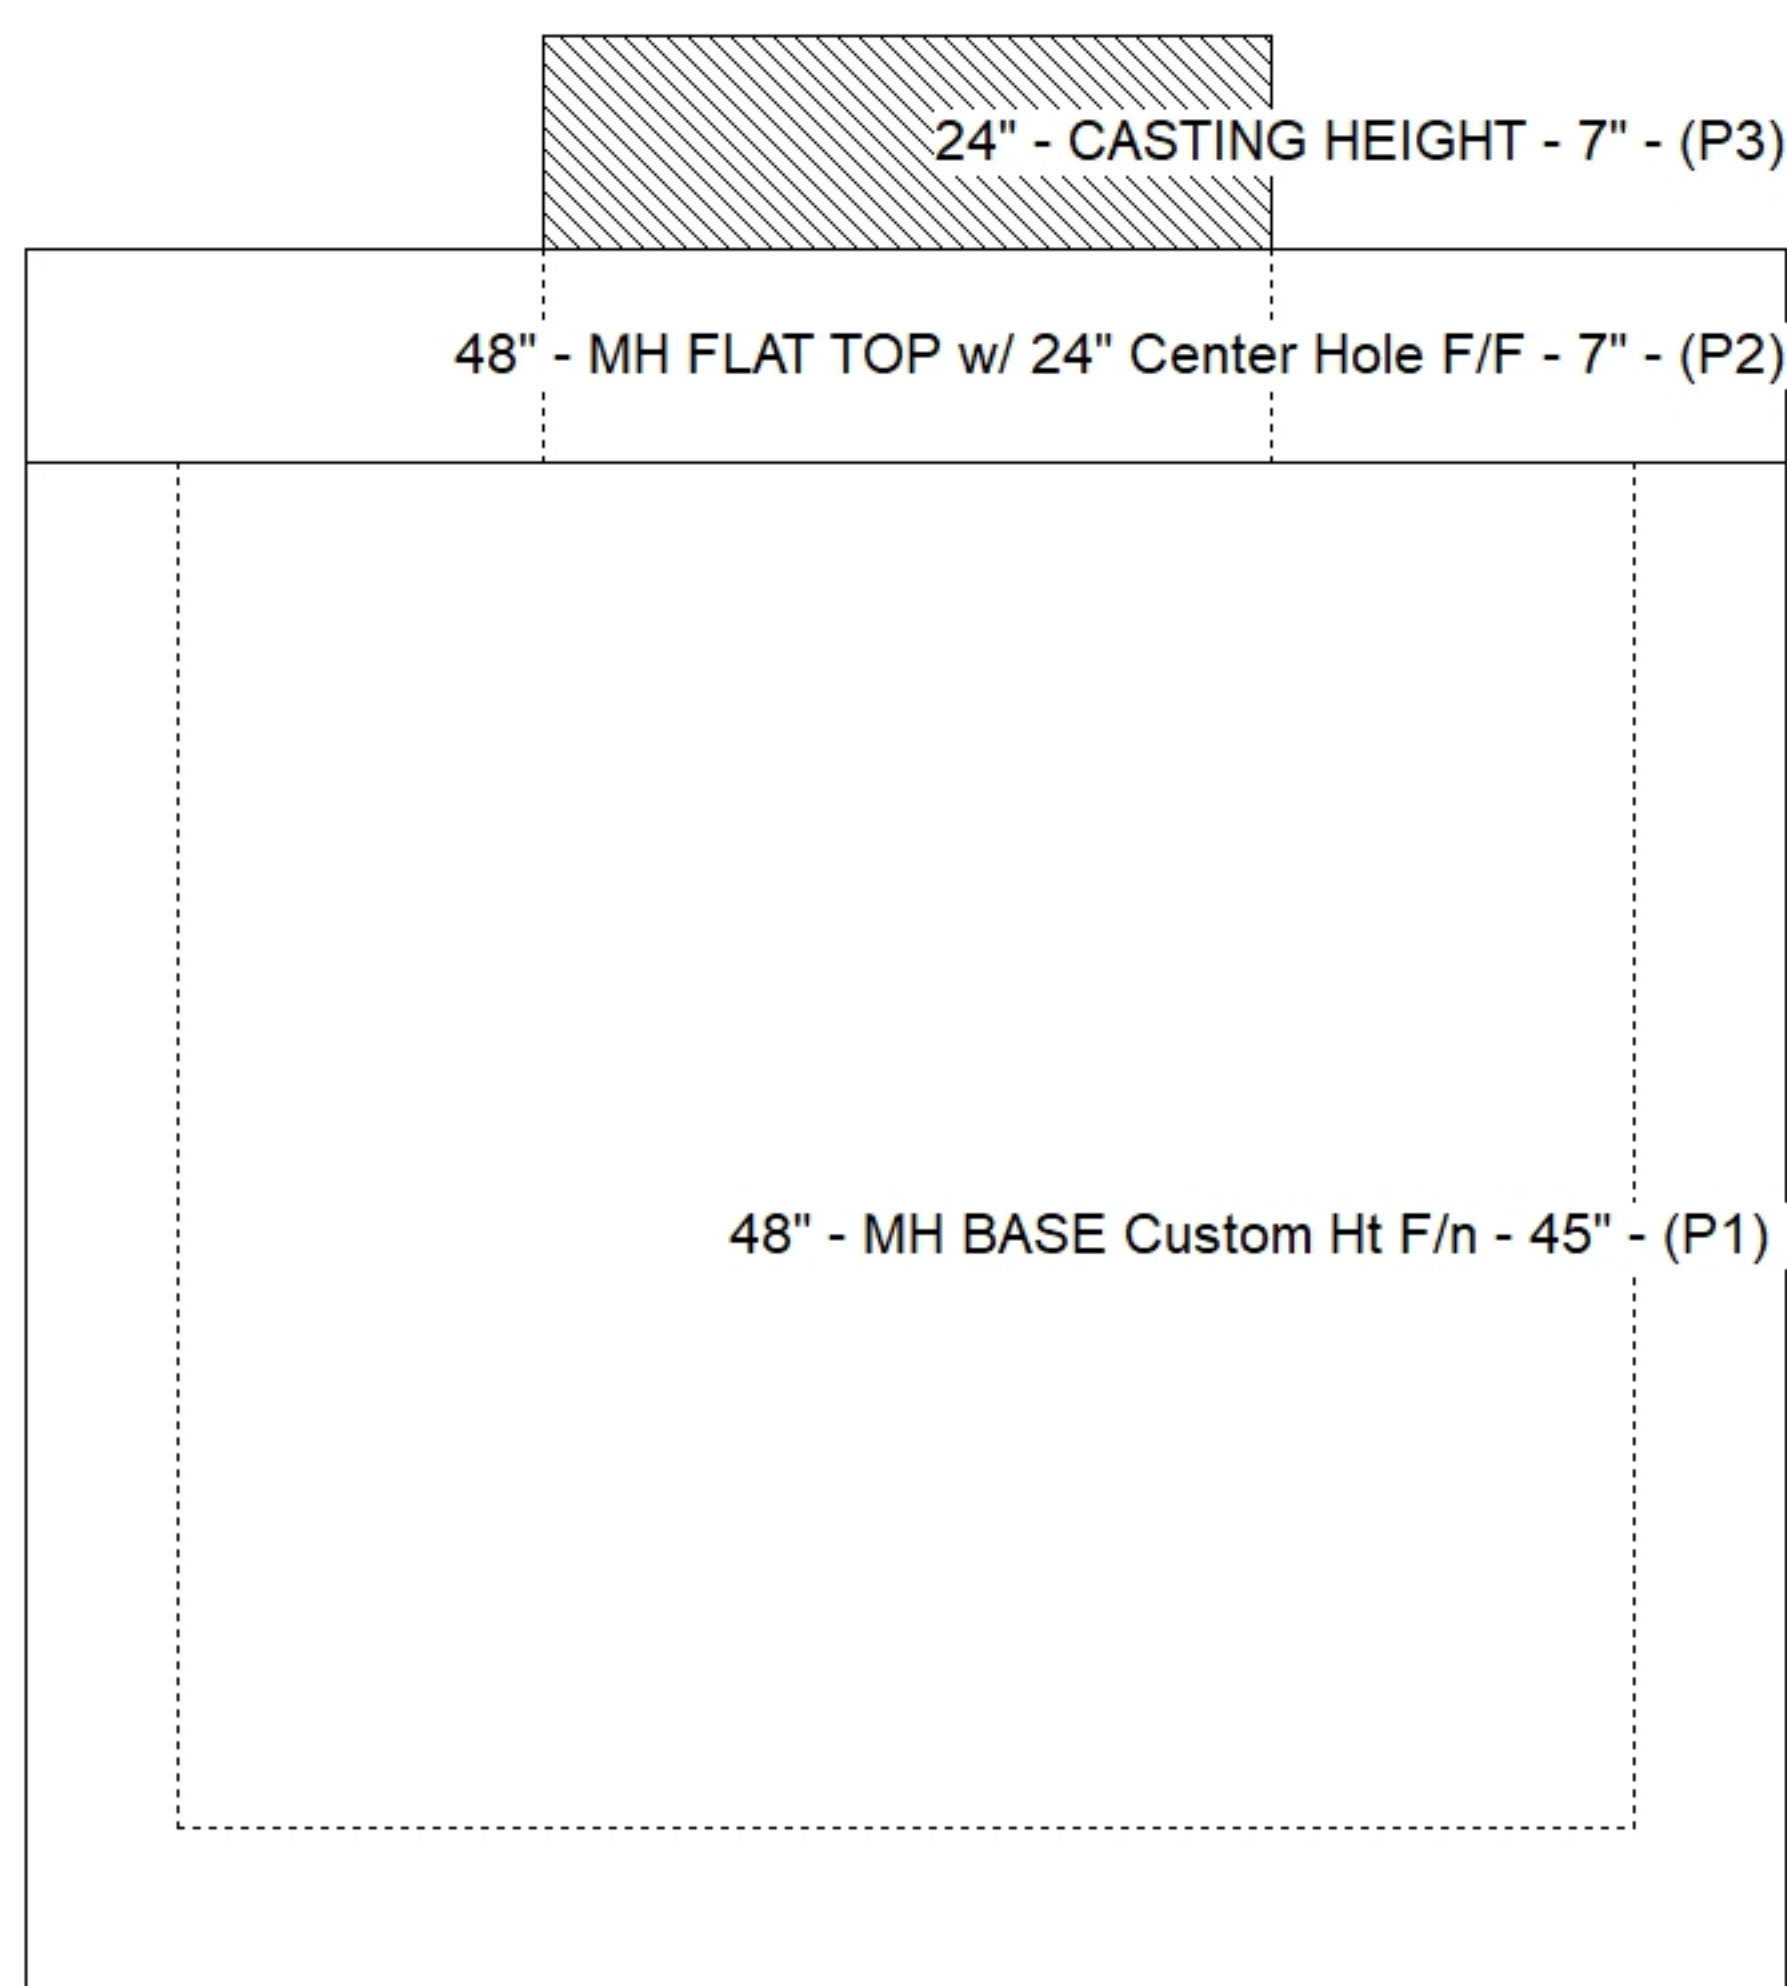

Default - Interior Dimensions

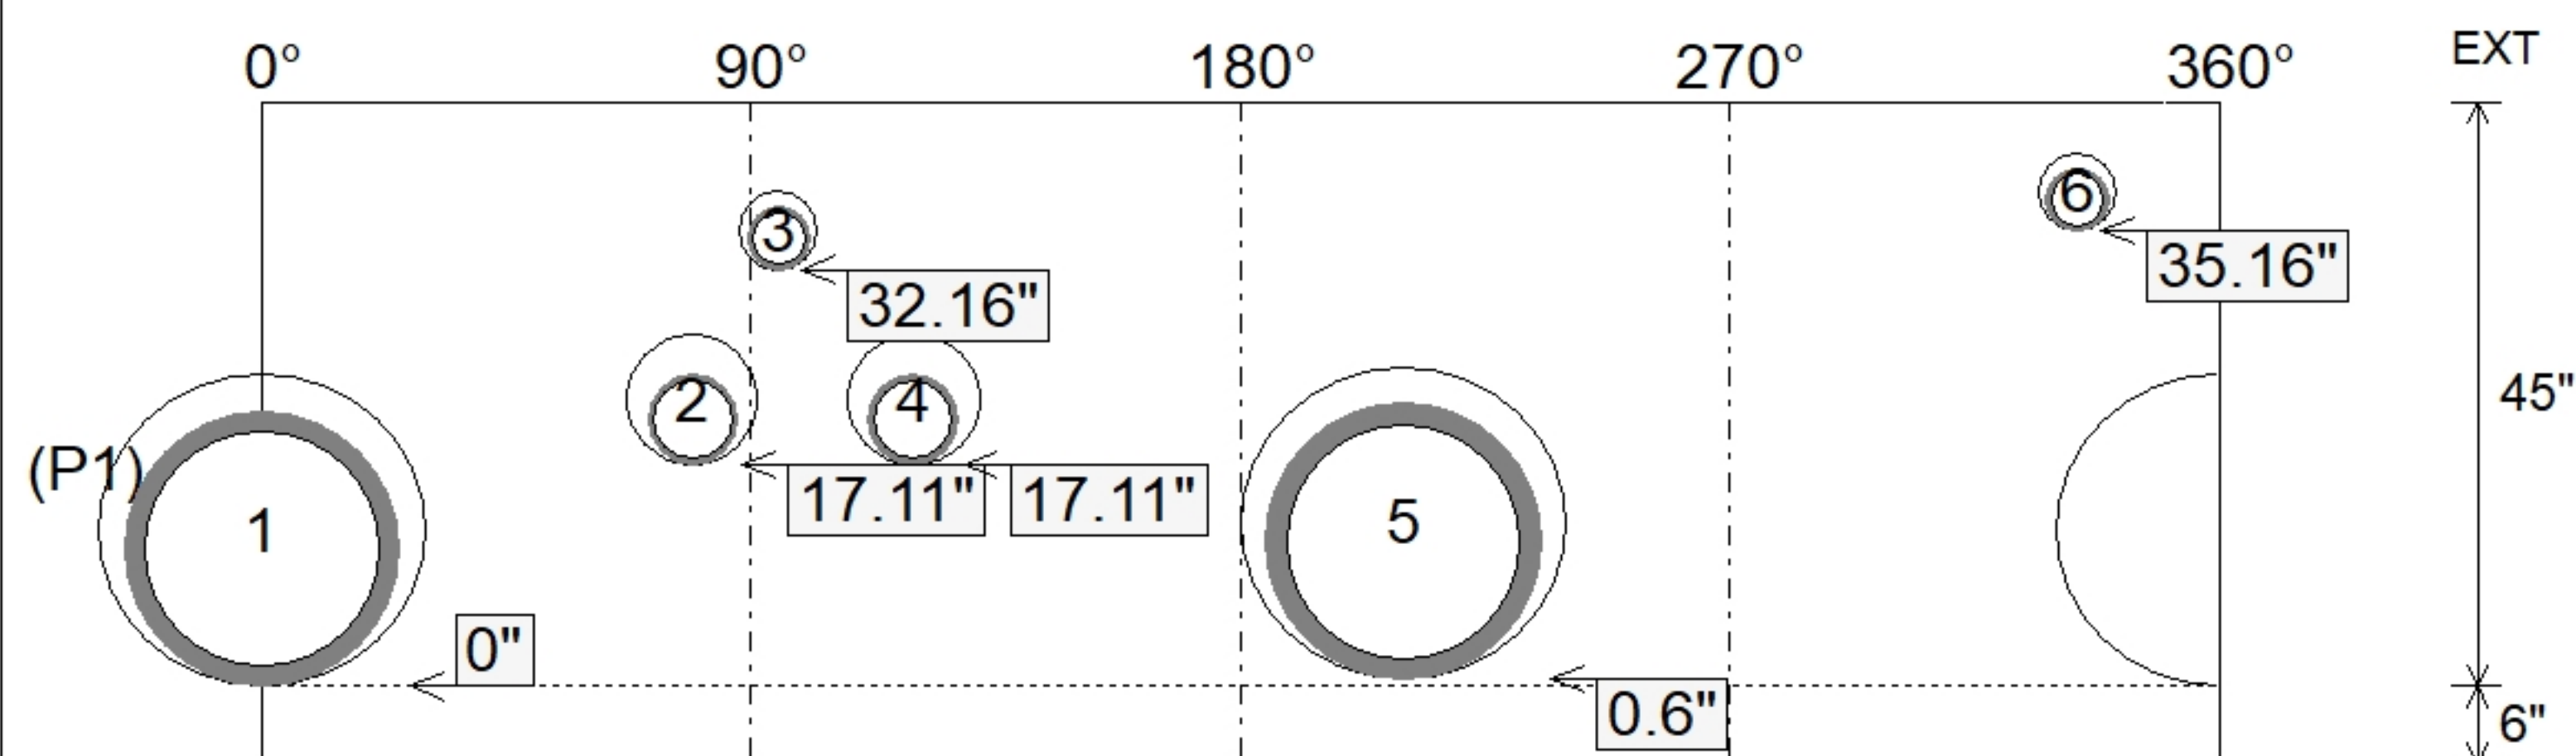

SUBMITTAL
APPROVED BY: