


P3) 50" x 252" - CASTING HEIGHT - 0"	0 lb	Structure Notes: A) PER ASTM C913. B) CONCRETE = 4,500 PSI AT 28 DAYS. C) REINFORCING PER ASTM A615 (GRADE 60).
P2) 50" x 252" - BOX RISER 6inW, Variable Ht - 28"	8802 lb	
P1) 50" x 252" - BX Separate Base Slab - 6"	8241 lb	
2) 50" x 252" - Conseal CS-102 1.00"	0 lb	
Structure Total:	17043 lb	

- GENERAL NOTES:**
- MANUFACTURED TO ASTM C-913 (LATEST REVISION)
 - CONCRETE: 5,000 PSI AT 28 DAYS
 - REINFORCEMENT - MIN. 1½" REBAR
CLEARANCE:
- TOP MAT: PER ATTACHED DWG 252_BASE_TOP_MAT
- BOTTOM MAT: PER ATTACHED DWG 252_BASE_BOTTOM_MAT
 - WEIGHTS: 8,241 LBS

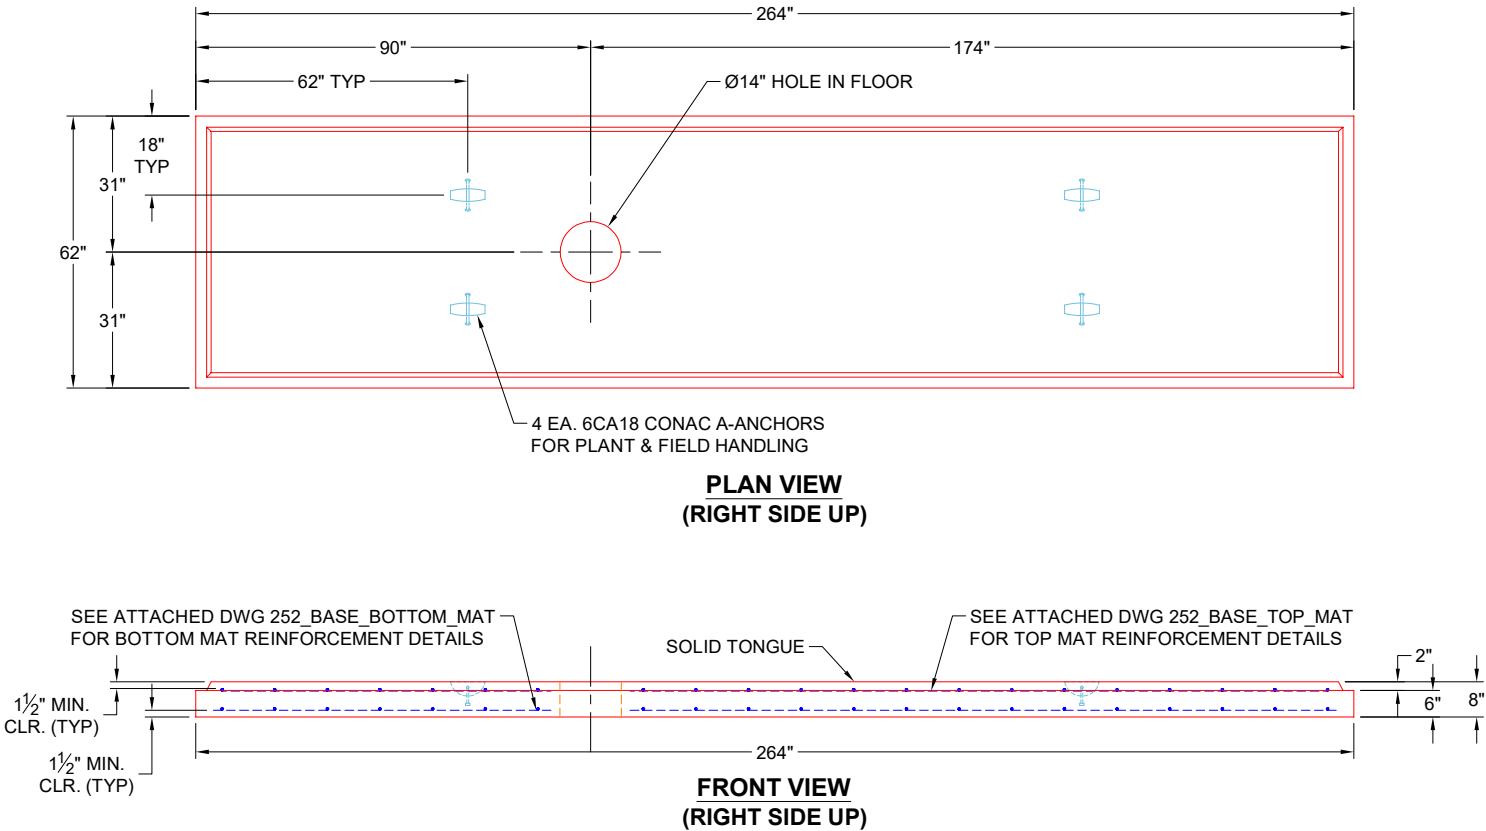

Coating (Int): Coating (Ext):	Seam Up: Tongue Seam Dn: n/a	Wall Thickness: 6" Floor Height: 6"	Height (Int): 0" Height (Ext): 0"	Weight (Net): 8241 lb Volume (Net): 2.1cu.yd
----------------------------------	---------------------------------	--	--------------------------------------	---

Job Name: 26-2048 - VSG 691257164
Job Location: CPU
Contractor: Endesol, Inc.

Plant: Beaver Dam
8/17/2026 2:53:09 PM

Tech: J. Coppage
PC: E. Bradley



Structure ID: 2-62048-1


P1 CVBS

BX Separate Base Slab

- P3) 50" x 252" - CASTING HEIGHT - 0"
P2) 50" x 252" - BOX RISER 6inW, Variable Ht - 28"
P1) 50" x 252" - BX Separate Base Slab - 6"
2) 50" x 252" - Conesal CS-102 1.00"

Structure Total: 17043 lb

- Structure Notes:
A) PER ASTM C913.
B) CONCRETE = 4,500 PSI AT 28 DAYS.
C) REINFORCING PER ASTM A615 (GRADE 60).

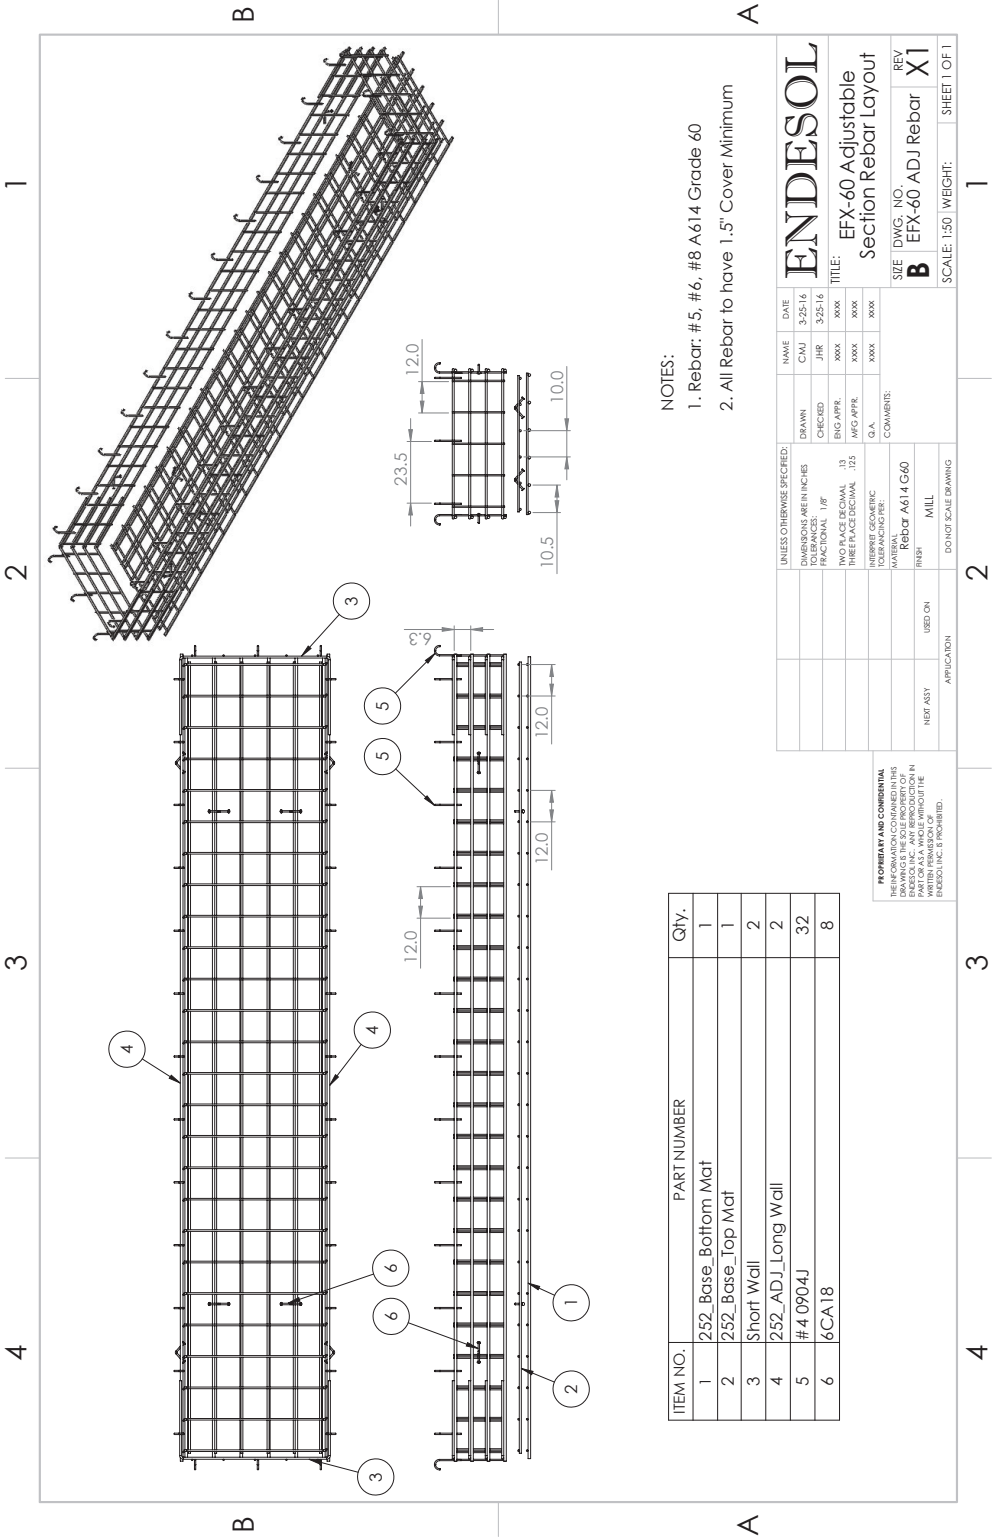

Coating (Int): Coating (Ext):	Seam Up: Tongue Seam Dn: n/a	Wall Thickness: 6" Floor Height: 6"	Height (Int): 0" Height (Ext): 0"	Weight (Net): 8241 lb Volume (Net): 2.1cu.yd
----------------------------------	---------------------------------	--	--------------------------------------	---

Job Name: 26-2048 - VSG 691257164
Job Location: CPU
Contractor: Endesol, Inc.

Plant: Beaver Dam
8/17/2026 2:53:09 PM

Tech: J. Coppage
PC: E. Bradley



Structure ID: 2-62048-1


P1 CVBS

BX Separate Base Slab

- P3) 50" x 252" - CASTING HEIGHT - 0"
- P2) 50" x 252" - BOX RISER 6inW, Variable Ht - 28"
- P1) 50" x 252" - BX Separate Base Slab - 6"
- 2) 50" x 252" - Con Seal CS-102 1.00"

0 lb
8802 lb
8241 lb
0 lb
Structure Total: 17043 lb

Structure Notes:
A) PER ASTM C913.
B) CONCRETE = 4,500 PSI AT 28 DAYS.
C) REINFORCING PER ASTM A615 (GRADE 60).

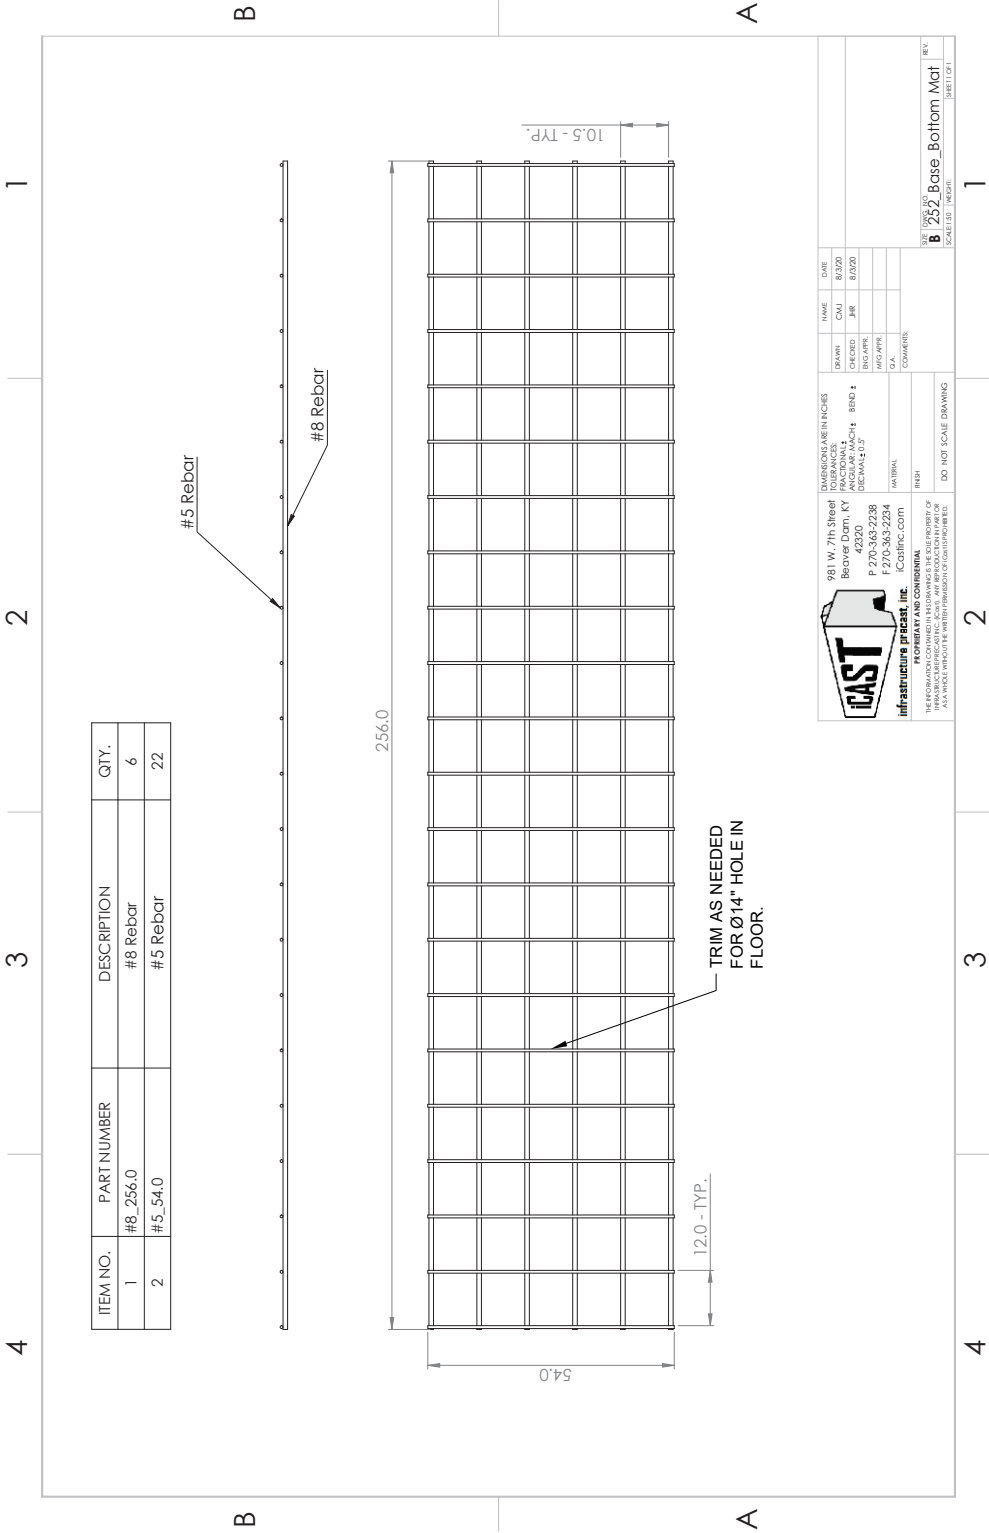

Coating (Int): Coating (Ext):	Seam Up: Tongue Seam Dn: n/a	Wall Thickness: 6" Floor Height: 6"	Height (Int): 0" Height (Ext): 0"	Weight (Net): 8241 lb Volume (Net): 2.1cu.yd
----------------------------------	---------------------------------	--	--------------------------------------	---

Job Name: 26-2048 - VSG 691257164
Job Location: CPU
Contractor: Endesol, Inc.

Plant: Beaver Dam
8/17/2026 2:53:09 PM

Tech: J. Coppage
PC: E. Bradley



Structure ID: 2-62048-1

P1 CVBS


BX Separate Base Slab


- P3) 50" x 252" - CASTING HEIGHT - 0"
P2) 50" x 252" - BOX RISER 6inW, Variable Ht - 28"
P1) 50" x 252" - BX Separate Base Slab - 6"
2) 50" x 252" - Conseal CS-102 1.00"

0 lb
8802 lb
8241 lb
0 lb

Structure Notes:
A) PER ASTM C913.
B) CONCRETE = 4,500 PSI AT 28 DAYS.
C) REINFORCING PER ASTM A615 (GRADE 60).

Structure Total: 17043 lb

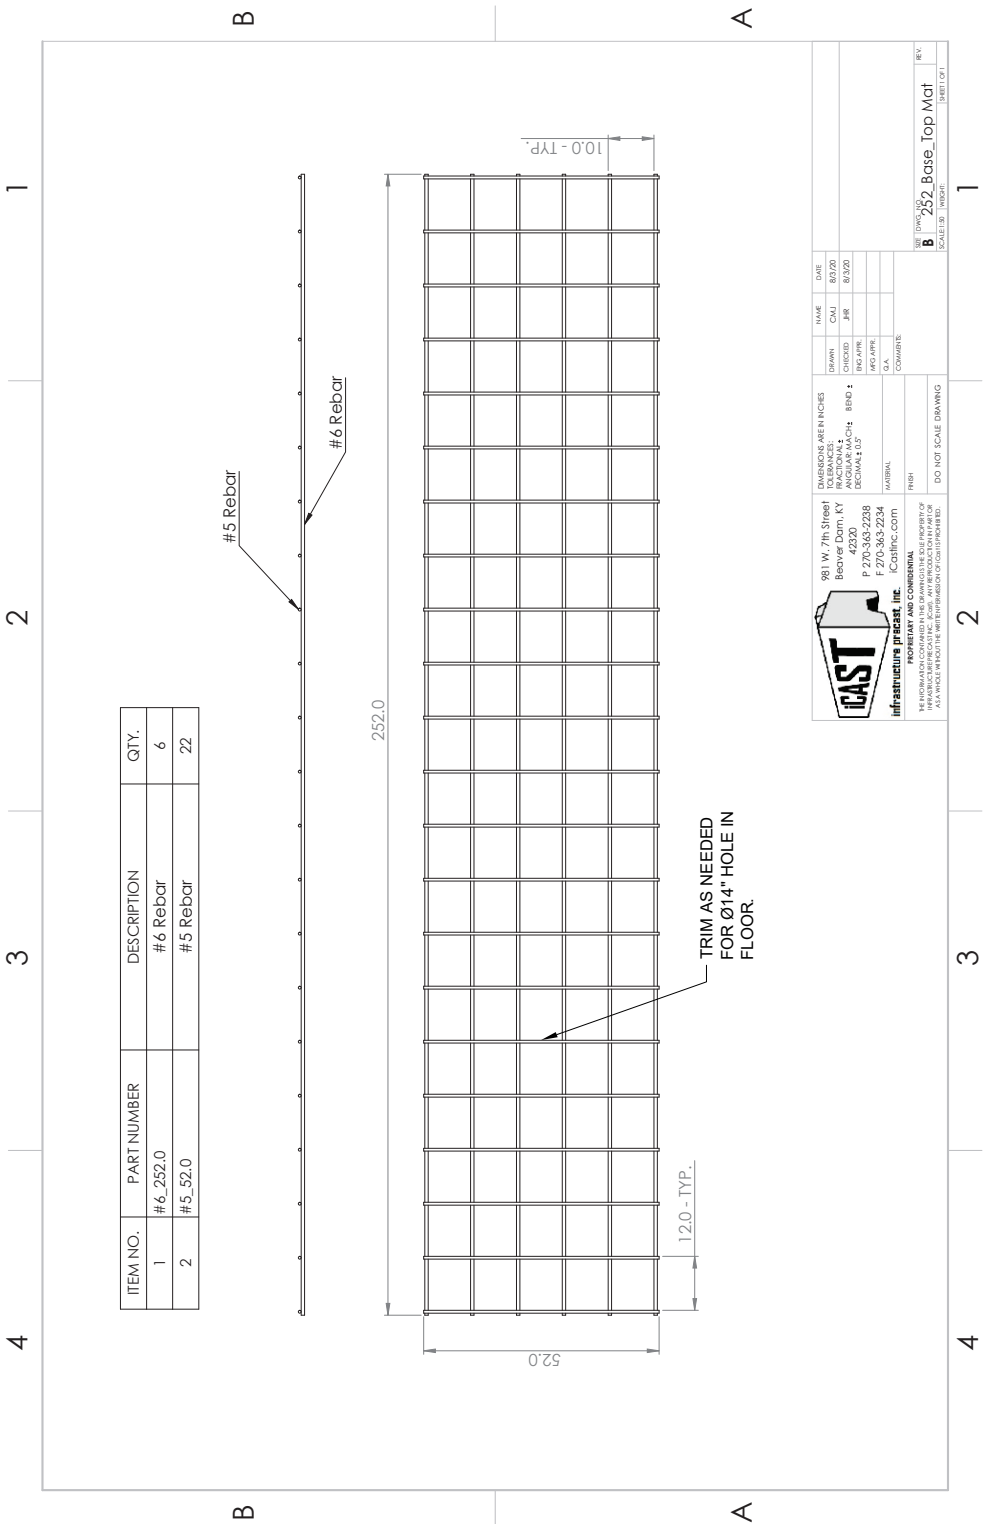

 ICAST Industrial Casting & Steel Inc. Columbus, OH 43221	981 W. 7th Street Beverly Dam, KY 40320 P 270-363-2238 F 270-363-2234 ICasting.com		DATE 8/17/20		NAME CAJ	DATE 8/17/20
	TOLERANCES ARE IN INCHES DIMENSIONS: ±.0625 ANGLES: ±.0625 DECIMALS: ±.005		DRAWN JMR	CHECKED JMR	DATE 8/17/20	
	REVISIONS 1.00 2.00 3.00 4.00 5.00 6.00 7.00 8.00 9.00 10.00 11.00 12.00 13.00 14.00 15.00 16.00 17.00 18.00 19.00 20.00 21.00 22.00 23.00 24.00 25.00 26.00 27.00 28.00 29.00 30.00 31.00 32.00 33.00 34.00 35.00 36.00 37.00 38.00 39.00 40.00 41.00 42.00 43.00 44.00 45.00 46.00 47.00 48.00 49.00 50.00 51.00 52.00 53.00 54.00 55.00 56.00 57.00 58.00 59.00 60.00 61.00 62.00 63.00 64.00 65.00 66.00 67.00 68.00 69.00 70.00 71.00 72.00 73.00 74.00 75.00 76.00 77.00 78.00 79.00 80.00 81.00 82.00 83.00 84.00 85.00 86.00 87.00 88.00 89.00 90.00 91.00 92.00 93.00 94.00 95.00 96.00 97.00 98.00 99.00 100.00		REVISIONS 1.00 2.00 3.00 4.00 5.00 6.00 7.00 8.00 9.00 10.00 11.00 12.00 13.00 14.00 15.00 16.00 17.00 18.00 19.00 20.00 21.00 22.00 23.00 24.00 25.00 26.00 27.00 28.00 29.00 30.00 31.00 32.00 33.00 34.00 35.00 36.00 37.00 38.00 39.00 40.00 41.00 42.00 43.00 44.00 45.00 46.00 47.00 48.00 49.00 50.00 51.00 52.00 53.00 54.00 55.00 56.00 57.00 58.00 59.00 60.00 61.00 62.00 63.00 64.00 65.00 66.00 67.00 68.00 69.00 70.00 71.00 72.00 73.00 74.00 75.00 76.00 77.00 78.00 79.00 80.00 81.00 82.00 83.00 84.00 85.00 86.00 87.00 88.00 89.00 90.00 91.00 92.00 93.00 94.00 95.00 96.00 97.00 98.00 99.00 100.00			
			DRAWN JMR	CHECKED JMR	DATE 8/17/20	
		ENG APPR. JMR	DATE 8/17/20			
		MATERIAL G.I.A.	COMMENTS			
		FRESH				
		DO NOT SCALE DRAWING				
		THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF ICAST. NO PART OF THIS DRAWING IS TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT PERMISSION IN WRITING FROM ICAST.				
		DRAWN BY: JMR CHECKED BY: JMR DATE: 8/17/20				
		SCALE: 1" = 1" (AS SHOWN)				
		SHEET 1 OF 1				

Coating (Int):	Seam Up: Tongue	Wall Thickness: 6"	Height (Int): 0"	Weight (Net): 8241 lb
Coating (Ext):	Seam Dn: n/a	Floor Height: 6"	Height (Ext): 0"	Volume (Net): 2.1cu.yd