



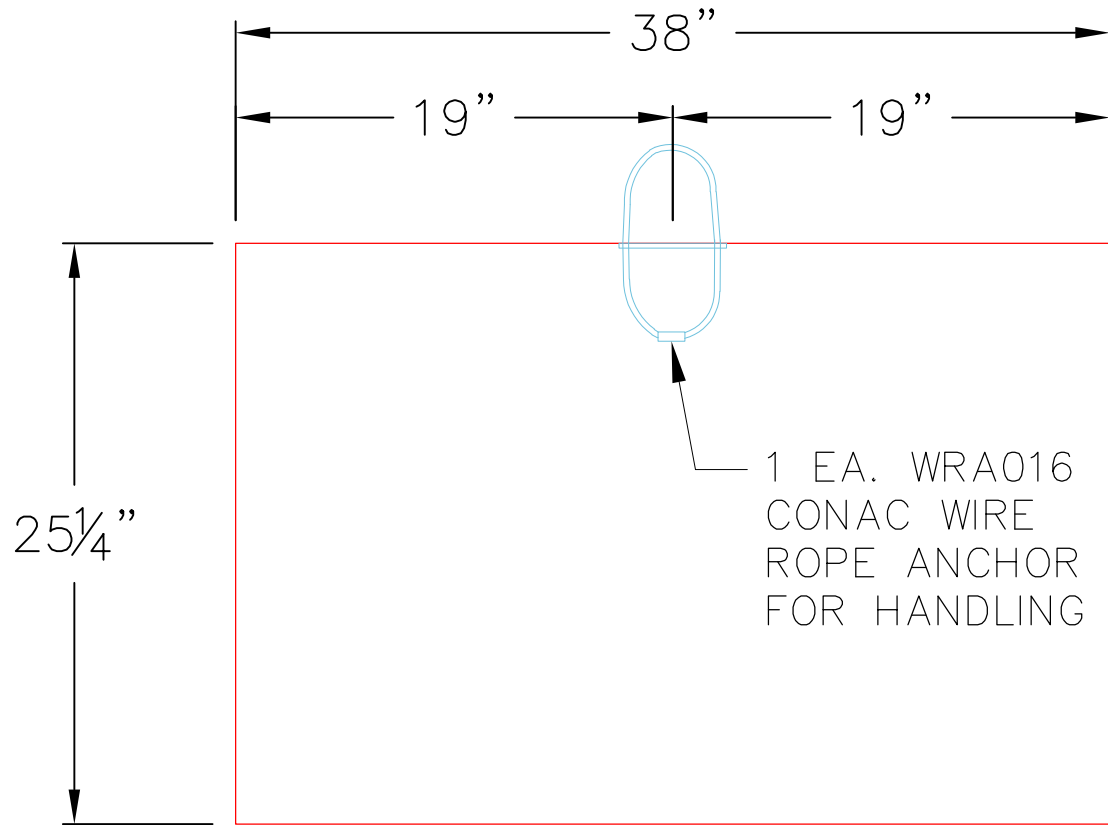

PLAN VIEW

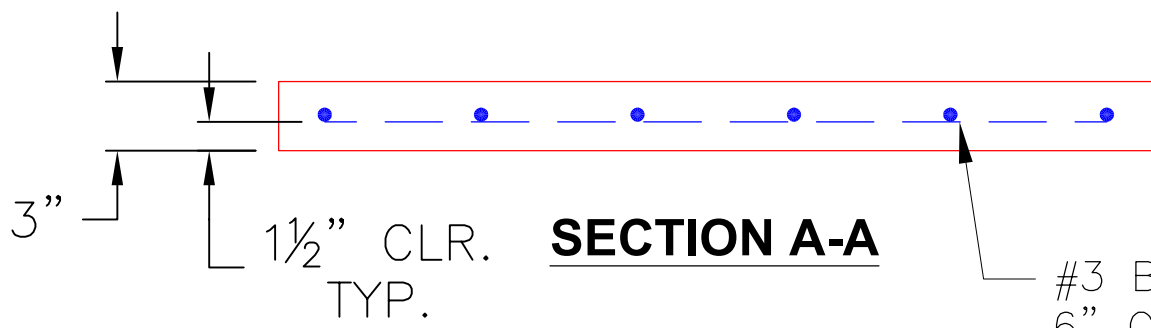

SECTION A-A

GENERAL NOTES:

1. MANUFACTURED TO ASTM C-913 (LATEST REVISION).
2. CONCRETE: 5,000 PSI AT 28 DAYS.
3. REINFORCING: PER ASTM A615. (GRADE 60).
 - BASE #3 BAR @ 6" O.C.E.W. - 1 1/2" MIN. REBAR CLEARANCE (TYP)
5. WEIGHT: 241 LBS

#3 BAR @
6" C.C.E.W.
(GRADE 60)

PRODUCTION WORK ORDER		PRODUCT I.D.: CVW	DESCRIPTION: 38" X 3" X 25 1/4" TALL WEIR WALL		
	QUALITY CONTROL CHECKLIST	PRODUCT VIEW: RIGHT SIDE UP	CUSTOMER: CONVERGENT WATER TECHNOLOGIES		
	☐ ALL DIMENSIONS CORRECT.	PLANT: BEAVER DAM, KY.	PROJECT: GALLATIN PRETX-LT		
	☐ LIFTERS INSTALLED.	WEIGHT: 241 LBS.	STRUCTURE: QL1 ST-CB (1)		
	☐ HOLE LOCATION(S) CORRECT.	TOP SECTION JOINT: N/A	ORDER NO: 26-2112		
	☐ REINFORCING CORRECT.	BASE SECTION JOINT: N/A	PC: C. GOFF		DRAWING: S. FELLETTER
	☐ SURFACE QUALITY ACCEPTABLE.	QC CHECK INITIALS:	DATE: 08/17/26	SCALE: NTS	PG. 1 of 1
	☐ EDGES CHAMFERED.				
☐ ALL PATCHWORK ACCEPTABLE.					