



Job Name: 26-2146 - Fairview Apartments Job Location: Russell Springs, KY 42642 Contractor: Dirt Design Construction LLC				Plant: 100 8/3/2026 11:45:30 AM		Tech: J. Horsley PC: M. Sullivan				
Structure ID: 09 ST-DCB										
P1 BX2436-08BVF				BOX BASE 8inW, 8inF, Variable Ht						
P3) 18" x 36" - CASTING HEIGHT - 5.5" P2) 24" x 36" - CB FLAT TOP 8"W (18"x36" HOLE) - 8" P1) 24" x 36" - BOX BASE 8inW, 8inF, Variable Ht - 22" 1) 24" x 36" - Conseal CS-102 1.00" 2) Hole - 16"						0 lb 961 lb 3371 lb 0 lb 0 lb ----- Structure Total: 4332 lb		Structure Notes: 1. PER ASTM C913 SPECIFICATIONS. 2. CONCRETE = 4,000 PSI AT 28 DAYS. 3. CASTING BY OTHERS (HOE 580 F/G) REINFORCING PER ASTM A615 (GRADE 60). - TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W. - WALLS (As .31) #5 BARS AT 12" C.C.E.W. - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.		
Rim: 1069.85' Rim to Invert: 2.97' Slack: 0.14" Sump: 0" Step Position:										
Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset
Invert 1	1066.88'	90°	26"	12" HDPE	14.5"	Hole 16	16"	16"	-1.25"	0"
Invert 2	1066.88'	180°	20"	12" HDPE	14.5"	Hole 16	16"	16"	-1.25"	0"
Invert 3										
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										




(P3)
(P2)
(P1) <<


RIGHT-SIDE UP VIEW (int. dimensions)

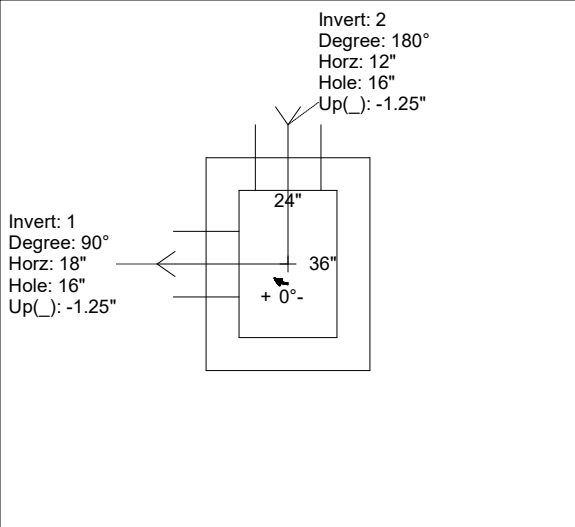

UPSIDE-DOWN VIEW (int. dimensions)

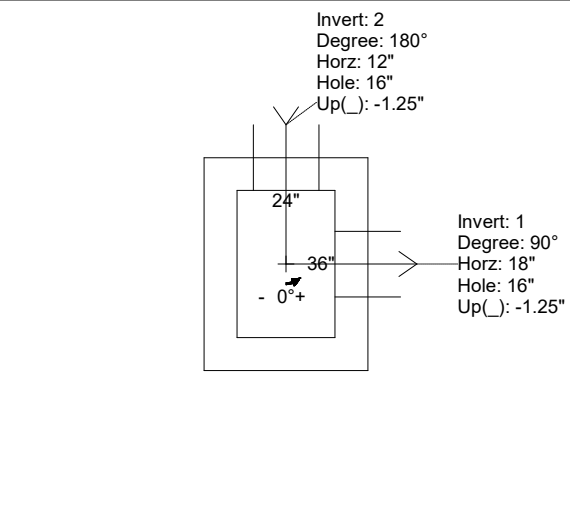

INSIDE WALL DIMENSIONS

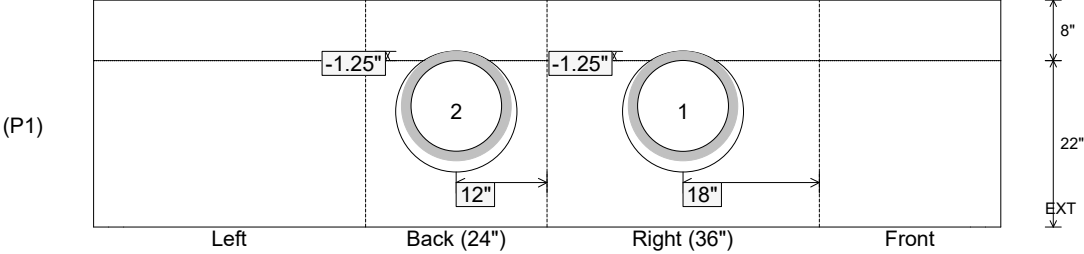

Coating (Int): Coating (Ext):	Seam Up: Flat Seam Dn: n/a	Wall Thickness: 8" Floor Height: 8"	Height (Int): 22" Height (Ext): 30"	Weight (Net): 3371 lb Volume (Net): 0.86cu.yd
----------------------------------	-------------------------------	--	--	--