



Job Name: 26-2146 - Fairview Apartments Job Location: Russell Springs, KY 42642 Contractor: Dirt Design Construction LLC				Plant: 100 8/3/2026 11:45:35 AM		Tech: J. Horsley PC: M. Sullivan				
Structure ID: 17 ST-DCB										
P1 MH048BA30				MH BASE						
P3) 18" x 36" - CASTING HEIGHT - 5.5" P2) 48" - MH FLAT TOP w/18"x36" Hole - 7" P1) 48" - MH BASE - 30" 1) 48" - Conseal CS-102 1.00" 1) Hole - 24 1) Hole - 20 1) Hole - 16						0 lb 1171 lb 3008 lb 0 lb 0 lb 0 lb 0 lb ----- Structure Total: 4179 lb		Structure Notes: 1. PER ASTM C478 SPECIFICATIONS. 2. CONCRETE = 4,000 PSI AT 28 DAYS. 3. CASTING BY OTHERS (HOE 580 F/G) REINFORCING PER ASTM A615 (GRADE 60). - TOP SLAB = H20 LOADING. - RISER (As .12) - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.		
Rim: 1058.88' Rim to Invert: 3.63' Slack: 1.06" Sump: 0" Step Position:										
Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset
Invert 1	1055.25'	0°	0"	18" HDPE	21.2"	Hole 24	24"	25.133"	-1.6"	0"
Invert 2	1055.25'	150°	75.922"	15" HDPE	17.6"	Hole 20	20"	20.629"	-1.3"	0"
Invert 3	1055.25'	233°	117.932"	12" HDPE	14.5"	Hole 16	16"	16.312"	-1.25"	0"
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										


RIGHT-SIDE UP VIEW (int. dimensions)

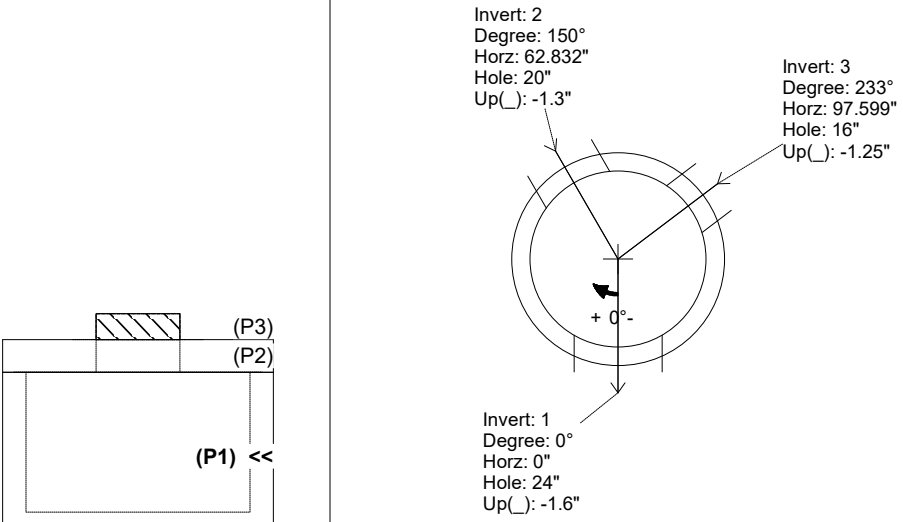

UPSIDE-DOWN VIEW (int. dimensions)

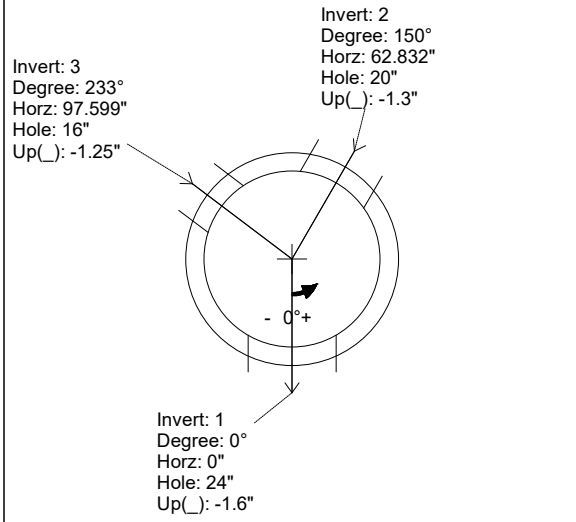

INSIDE WALL DIMENSIONS

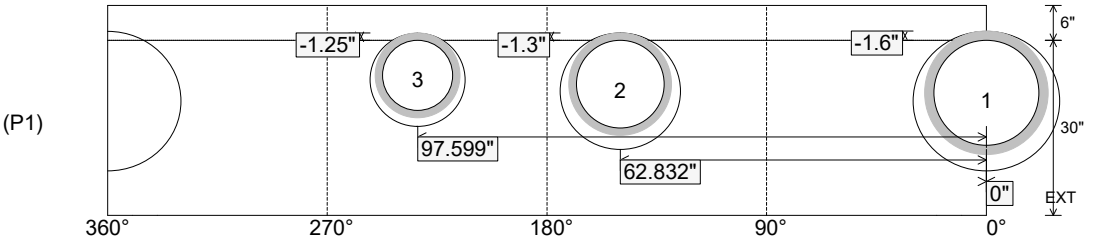

Coating (Int): Coating (Ext):	Seam Up: Flat Seam Dn: n/a	Wall Thickness: 5" Floor Height: 6"	Height (Int): 30" Height (Ext): 36"	Weight (Net): 3008 lb Volume (Net): 0.77cu.yd
----------------------------------	-------------------------------	--	--	--