




Job Name: 26-2146 - Fairview Apartments Job Location: Russell Springs, KY 42642 Contractor: Dirt Design Construction LLC				Plant: 100 8/3/2026 11:45:37 AM		Tech: J. Horsley PC: M. Sullivan				
Structure ID: 20 ST-DCB										
P1 BX2436-08BVF				BOX BASE 8inW, 8inF, Variable Ht						
P3) 18" x 36" - CASTING HEIGHT - 5.5" P2) 24" x 36" - CB FLAT TOP 8"W (18"x36" HOLE) - 8" P1) 24" x 36" - BOX BASE 8inW, 8inF, Variable Ht - 20" 1) 24" x 36" - Conseal CS-102 1.00" 2) Hole - 20"						0 lb 961 lb 3015 lb 0 lb 0 lb ----- Structure Total: 3977 lb		Structure Notes: 1. PER ASTM C913 SPECIFICATIONS. 2. CONCRETE = 4,000 PSI AT 28 DAYS. 3. CASTING BY OTHERS (HOE 580 F/G) REINFORCING PER ASTM A615 (GRADE 60). - TOP SLAB = H20 LOADING - WALLS (As .31) #5 BARS AT 12" C.C.E.W. - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.		
Rim: 1067.15' Rim to Invert: 2.8' Slack: 0.1" Sump: 0" Step Position:										
Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset
Invert 1	1064.35'	90°	26"	15" HDPE	17.6"	Hole 20	20"	20"	-1.3"	0"
Invert 2	1064.35'	270°	26"	15" HDPE	17.6"	Hole 20	20"	20"	-1.3"	0"
Invert 3										
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										




RIGHT-SIDE UP VIEW (int. dimensions)

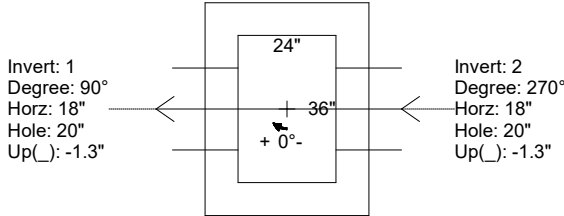

UPSIDE-DOWN VIEW (int. dimenions)

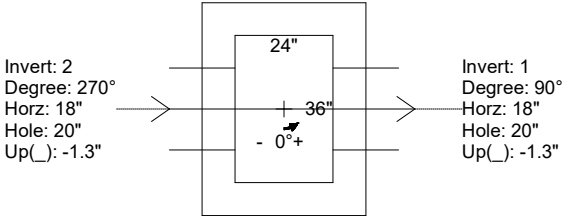

INSIDE WALL DIMENSIONS

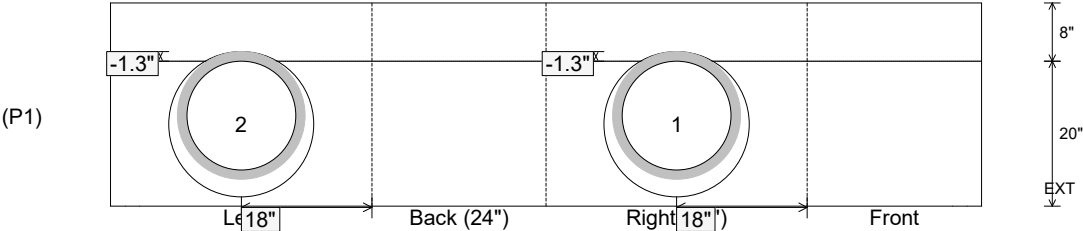

Coating (Int): Coating (Ext):	Seam Up: Flat Seam Dn: n/a	Wall Thickness: 8" Floor Height: 8"	Height (Int): 20" Height (Ext): 28"	Weight (Net): 3015 lb Volume (Net): 0.77cu.yd
----------------------------------	-------------------------------	--	--	--