


Job Name: 26-2171 - Lake Malone Campground Multi Park West Job Location: Lewisburg, KY Contractor: Sensabaugh Design & Construction, LLC					Plant: 100 6/11/2026 3:15:51 PM		Tech: Jared - F PC: M. Sullivan				
Structure ID: SSMH-E2											
P2 MH048RS36			MH RISER T/G								
P4) 24" - CASTING HEIGHT - 7" P3) 48" - ECC CONE w/ 24" HOLE F/G - 36" P2) 48" - MH RISER T/G - 36" P1) 48" - MH BASE T/n - 24" 1) JOINT WRAP - 0.065"x6"x50' CONSEAL CS212 1) JOINT WRAP PRIMER - CONSEAL CS-75 (1 gal.) 1) 48" - MH INVERT CHANNEL - FULL HEIGHT 1) CASTING - HOE MC-315 F/C Sanitary 2) 48" - Conseal CS-102 1.00" (Double) 1) 24" - Conseal CS-102 1.00" (Double) 2) PSX - 12-06 NYLO 1) PSX - 8QRS-S NYLO 7) MH Step ML-10-TDS-NCR - 10"					0 lb 3000 lb 2515 lb 2890 lb 0 lb 0 lb 1440 lb 258 lb 0 lb 0 lb 16 lb 6 lb 0 lb ----- 10125 lb		Structure Notes: . 1. PER ASTM C478 SPECIFICATIONS. 2. CONCRETE = 4,000 PSI AT 28 DAYS. 3. CASTING SUPPLIED BY ICAST (HOE MC-315 F/C "SANITARY"). REINFORCING PER ASTM A615 (GRADE 60). - CONE (As .12) - RISER/WALLS (As .12) - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.				
Rim: 568.38' Rim to Invert: 8.38' Slack: 0.56" Sump: 3" Step Position: 0°											
Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up (_)	Offset	
Invert 1											
Invert 2											
Invert 3											
Invert 4											
Invert 5											
Invert 6											
Invert 7											
Invert 8											

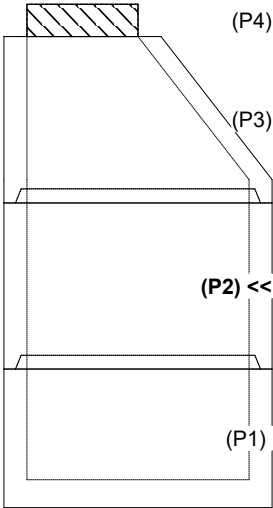


(P4)

(P3)

(P2) <<


(P1)

RIGHT-SIDE UP VIEW (int. dimensions)

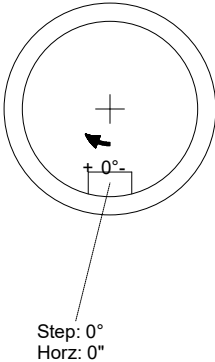

Step: 0°
Horz: 0°

INSIDE WALL DIMENSIONS

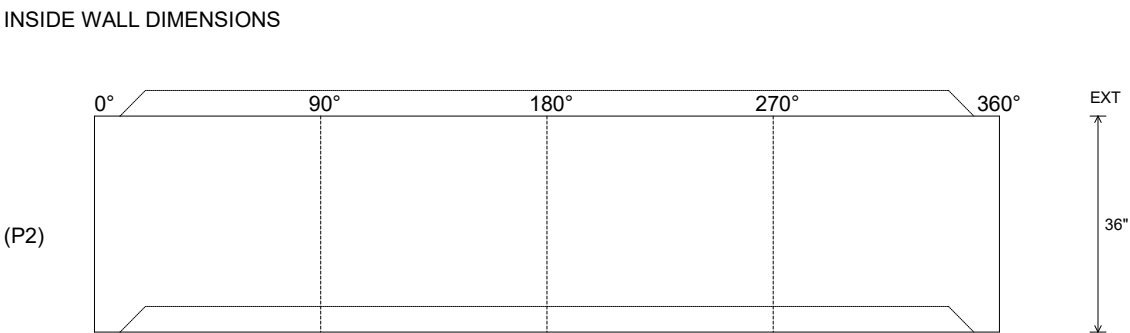

(P2)

36"

EXT

Coating (Int): Coating (Ext):	Seam Up: Tongue Seam Dn: Groove	Wall Thickness: 5" Floor Height: 0"	Height (Int): 36" Height (Ext): 36"	Weight (Net): 2515 lb Volume (Net): 0.64cu.yd
----------------------------------	------------------------------------	--	--	--