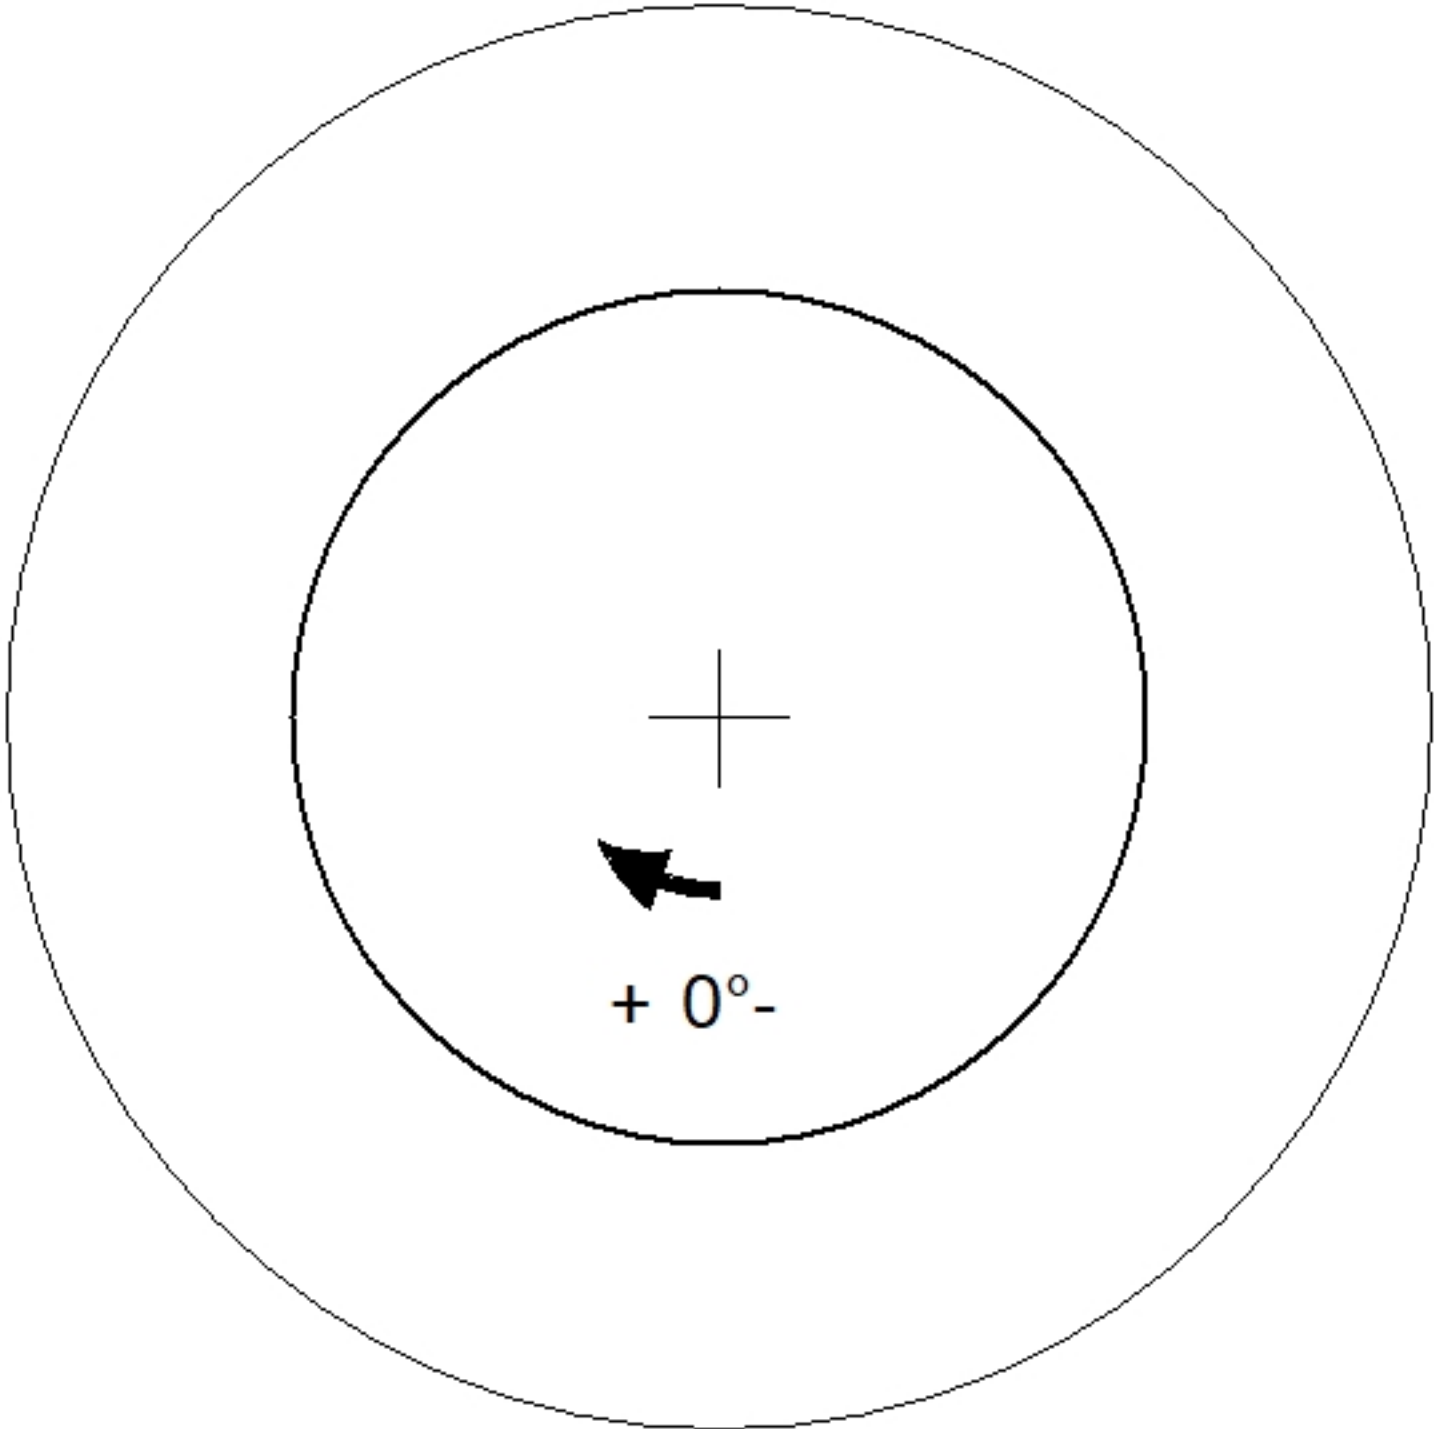


Job Name: 26-2260 - Bowling Green JR High School		Plant: 100	Tech: J. Horsley	
Job Location: Bowling Green, KY Contractor: Scott & Ritter, Inc.		7/15/2026 1:38:06 PM	PC: M. Sullivan	
Structure ID: 2 SS-MH				
P3 GR3		GRADE RING F/F		
P4) 24" - CASTING HEIGHT - 7" P3) 24" - GRADE RING F/F - 3" P2) 48" - MH FLAT TOP w/ 24" ECC Hole F/G - 12" P1) 48" - MH BASE T/n - 42" 1) 48" - MH INVERT CHANNEL - FULL HEIGHT 1) JOINT WRAP - 0.065"x6"x50' CONSEAL CS212 1) JOINT WRAP PRIMER - CONSEAL CS-75 (1 gal.) 1) 48" - Conseal CS-102 1.00" (Double) 2) PSX - 16Y DD (DBL Bands) 3) PSX - 8QRS DD (DBL Bands) 2) MH Step ML-10-TDS-NCR - 10"		0 lb 202 lb 1561 lb 4029 lb 1440 lb 0 lb 0 lb 0 lb 0 lb 15 lb 20 lb 0 lb ----- 7267 lb Structure Total:	Structure Notes: . 1. PER ASTM C478 SPECIFICATIONS. 2. CONCRETE = 4,000 PSI AT 28 DAYS. 3. CASTING BY OTHERS (HOE MC-375 F/C). . REINFORCING PER ASTM A615 (GRADE 60). - CONE (As .12) - RISER/WALLS (As .12) - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.	
				
24" - GRADE RING F/F - 3" - (P3)				
Coating (Int): Coating (Ext):	Seam Up: Flat Seam Dn: Flat	Wall Thickness: 8"	Height (Ext): 3"	Weight (Net): 202 lb Volume (Net): 0.05cu.yd