


Job Name: 26-2260 - Bowling Green JR High School
Job Location: Bowling Green, KY
Contractor: Scott & Ritter, Inc.

Plant: 100

7/15/2026 1:38:07 PM

Tech: J. Horsley

PC: M. Sullivan



Structure ID: QL7 GT1500

P2 BX072144-08LD06S


CB FLAT TOP 6"W w/(2) 24" HOLES (Grease Trap) F/F

- P3) 24" - CASTING HEIGHT - 7"
P2) 72" x 144" - CB FLAT TOP 6"W w/(2) 24" HOLES (Grease Trap) F/F - 8"
P1) 72" x 144" - BOX BASE 6inW, 6inF, Variable Ht F/n - 48"
1) 72" x 46" - BAFFLE WALL (GT-1500 GAL.) - 4"
1) 72" x 144" - Conseal CS-102 1.00"
1) PSX - 12-06 DD
1) PSX - 8QRS DD


0 lb
8190 lb
17535 lb
1073 lb
0 lb
8 lb
6 lb

Structure Total: 26813 lb

Structure Notes: 1. PER ASTM C913 SPECIFICATIONS.
2. CONCRETE = 4,000 PSI AT 28 DAYS.
3. NO FLOW CHANNEL.
4. HOE MC-315 F/C - SHIPPED LOOSE.
5. SECONDARY POUR REQ'D - BAFFLE WALL.
REINFORCING PER ASTM A615 (GRADE 60).
- TOP SLAB (As .47) #5 BARS AT 8" C.C.E.W.
- WALLS (As .47) #5 BARS AT 8" C.C.E.W.
- FLOOR (As .47) #5 BARS AT 8" C.C.E.W.

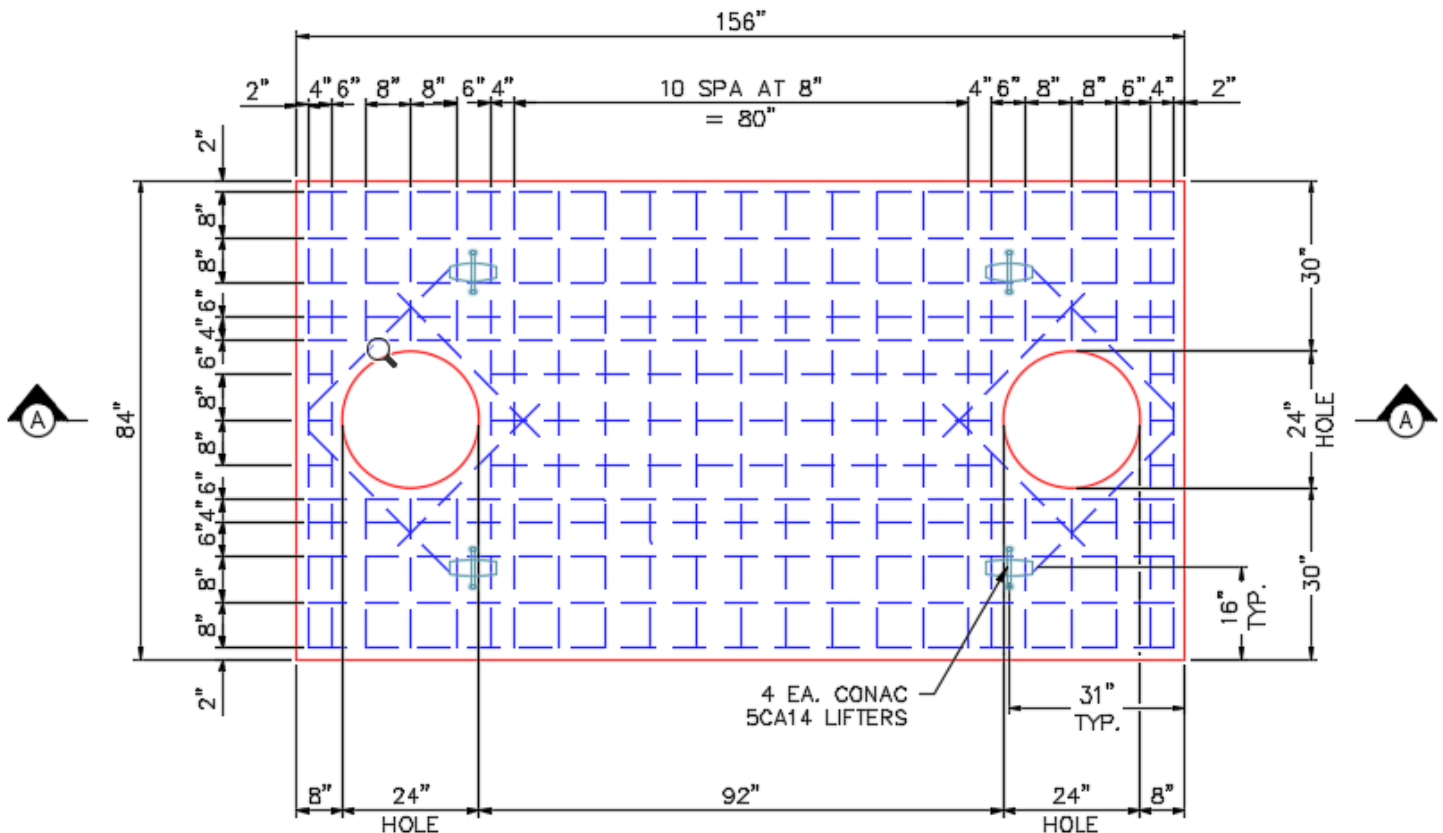

PLAN VIEW

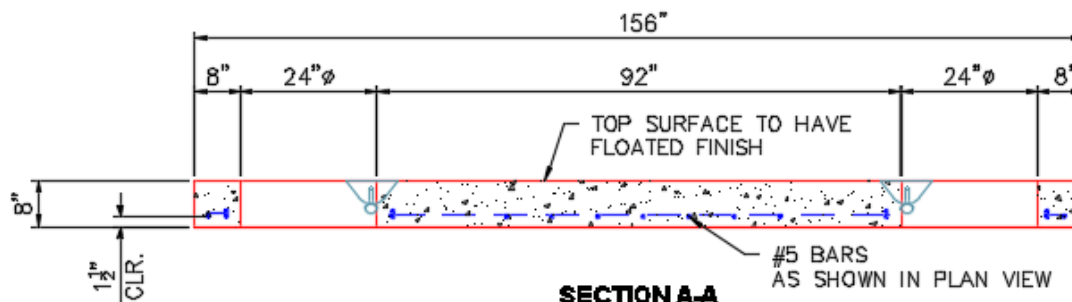

SECTION A-A

#BAR LIST

- 17 ea @ 80" LONG
10 ea @ 152" LONG
3 ea @ 84" LONG
8 ea @ 36" LONG

Coating (Int):
Coating (Ext):

Seam Up: Flat
Seam Dn: Flat

Wall Thickness: 6"

Height (Ext): 8"

Weight (Net): 8190 lb
Volume (Net): 2.09cu.yd