

Contractor: Hayes Pipe Supply

Plant: 100




Slack: 0.236"

REINFORCING PER ASTM A615 (GRADE 60).
- WALLS (As .31) #5 BARS AT 12" C.C.E.W.
- FLOOR (As .31) #5 BARS AT 12" C.C.E.W.

P2) 28" x 28" - CASTING HEIGHT - 7.50"
P1) 28" x 28" - BOX BASE 6inW, 6inF, Variable Ht - 31"
1) 28" x 28" - Conseal CS-102 1.00"
2) Hole - 26



0 lb
2394 lb
0 lb
0 lb

Structure Total: 2394 lb

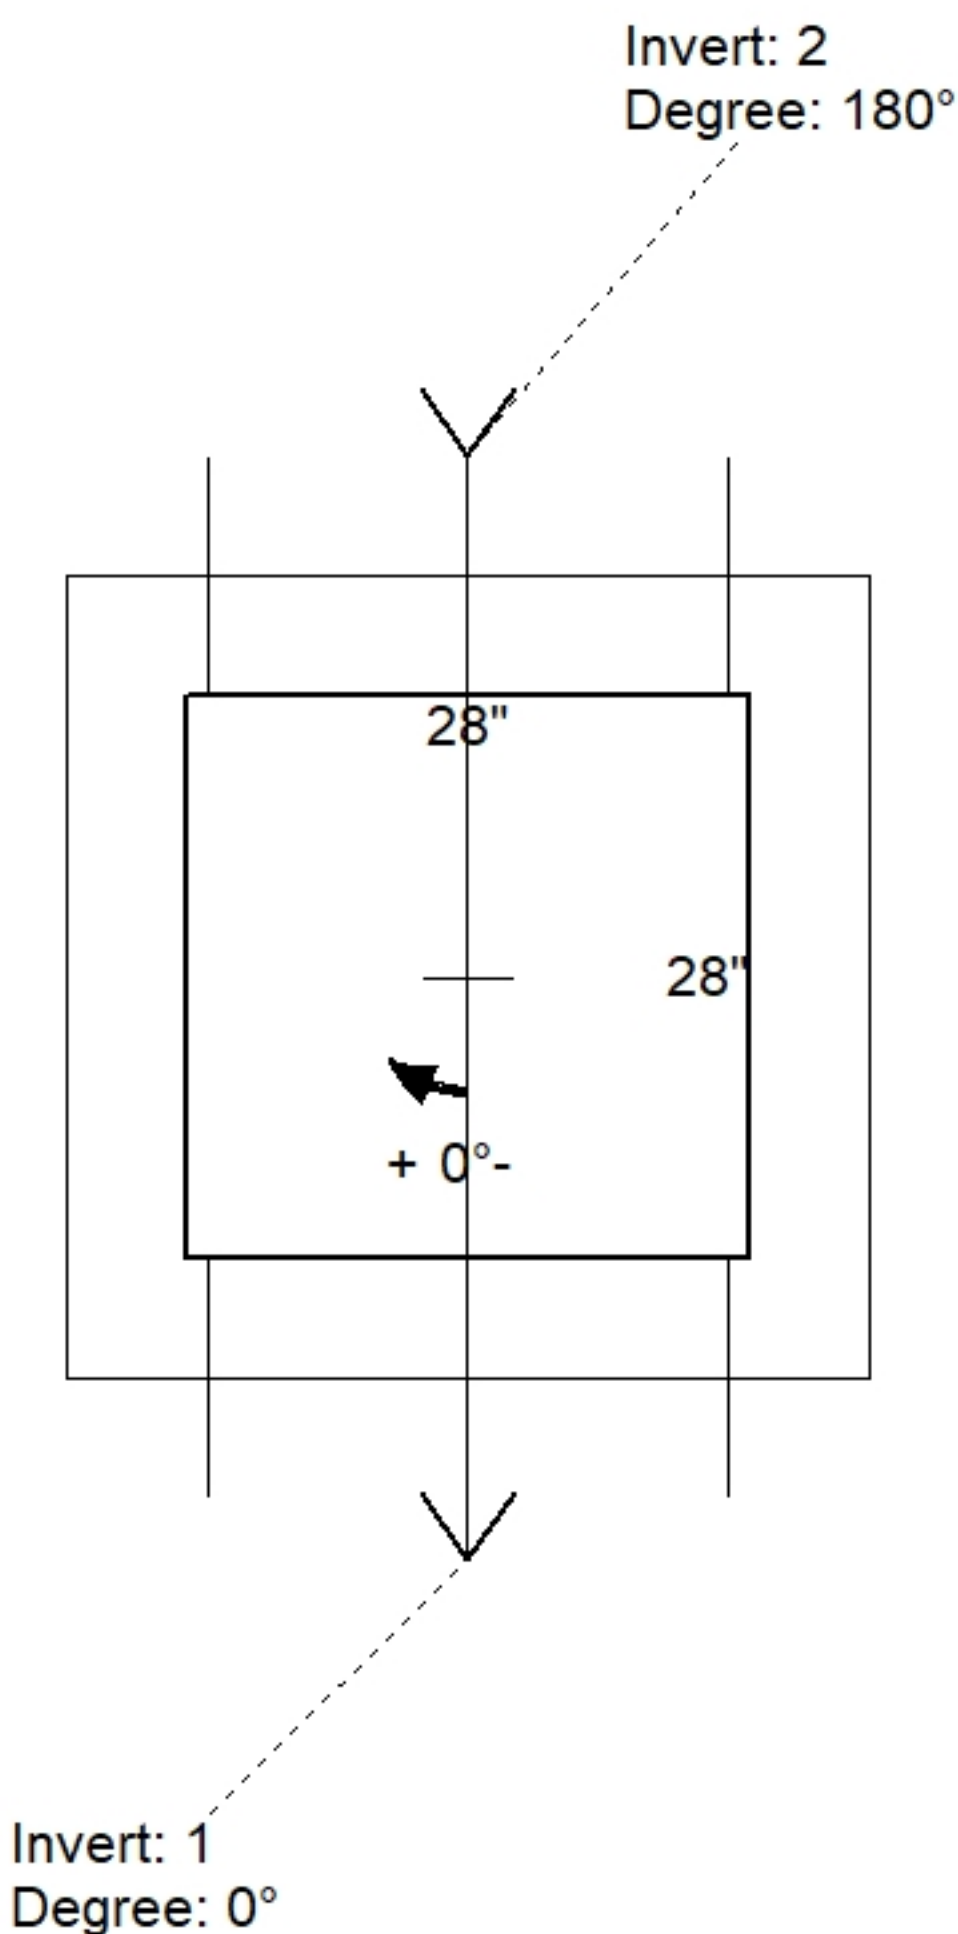

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up (')	Ref
Rim	422'							
Reducer								
Invert 1	418.98'	0°	18" RCP B WALL	23"	26"	Hole 26	-0.004"	P1
Invert 2	418.98'	180°	18" RCP B WALL	23"	26"	Hole 26	-0.004"	P1
Invert 3								
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

Default - Interior Dimensions

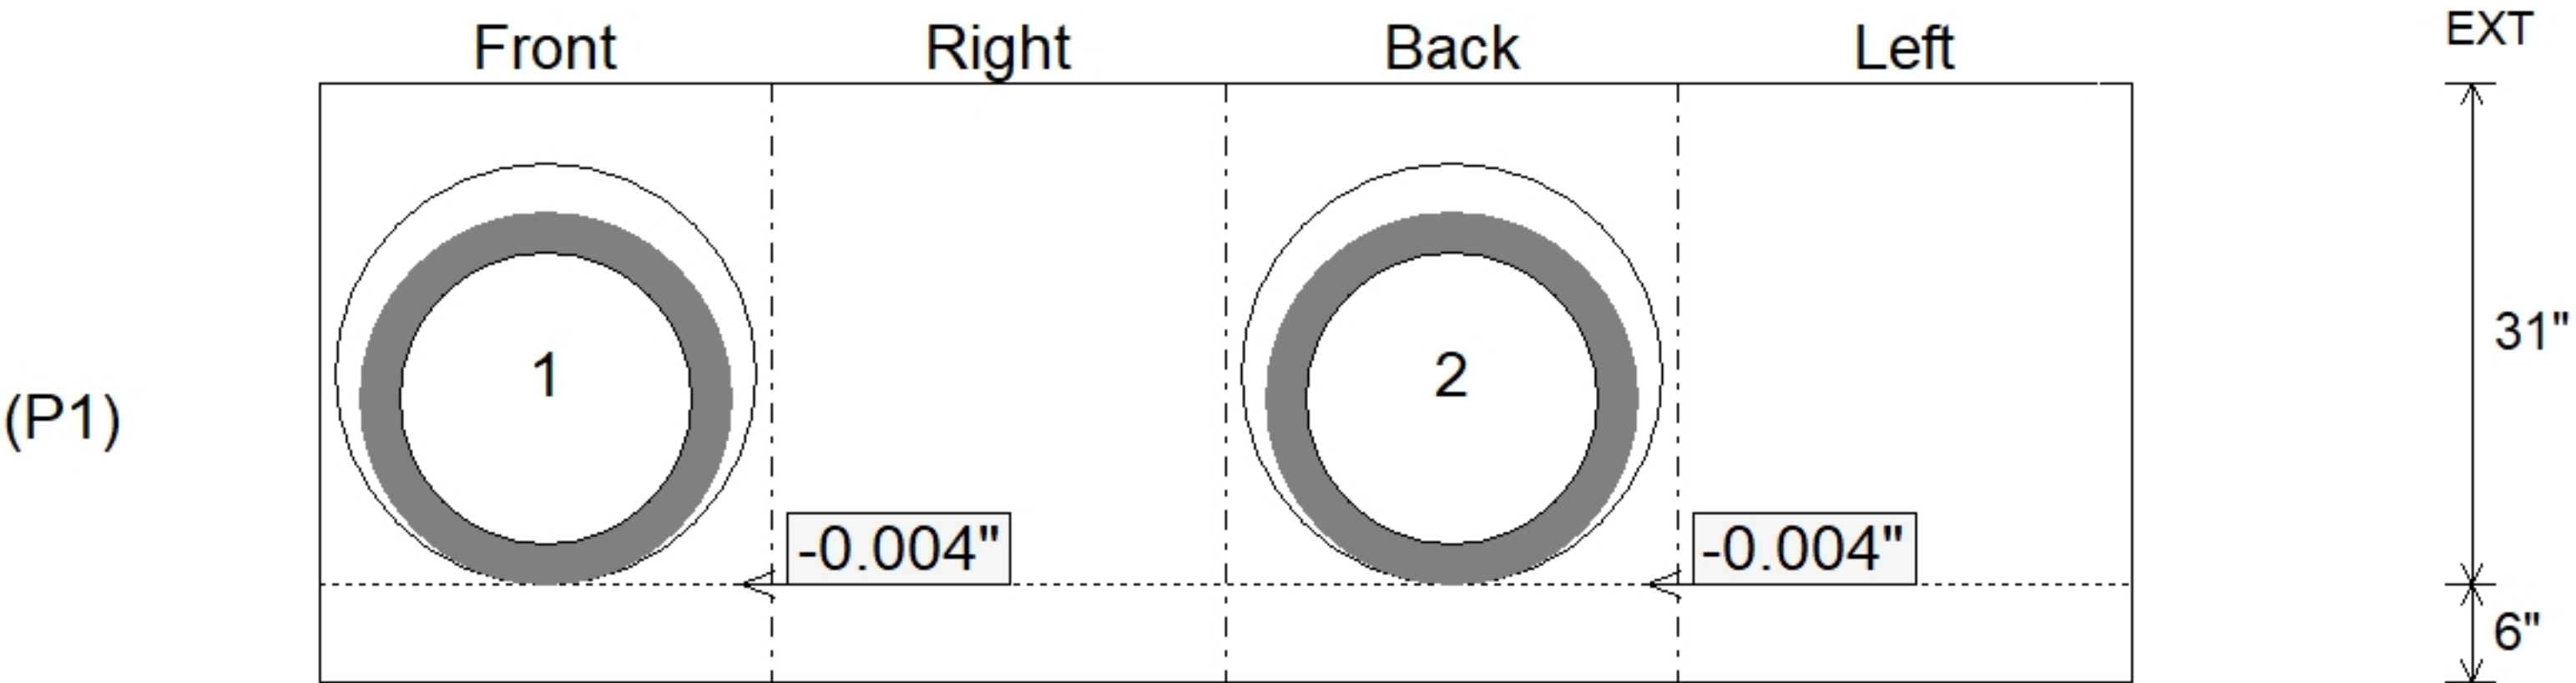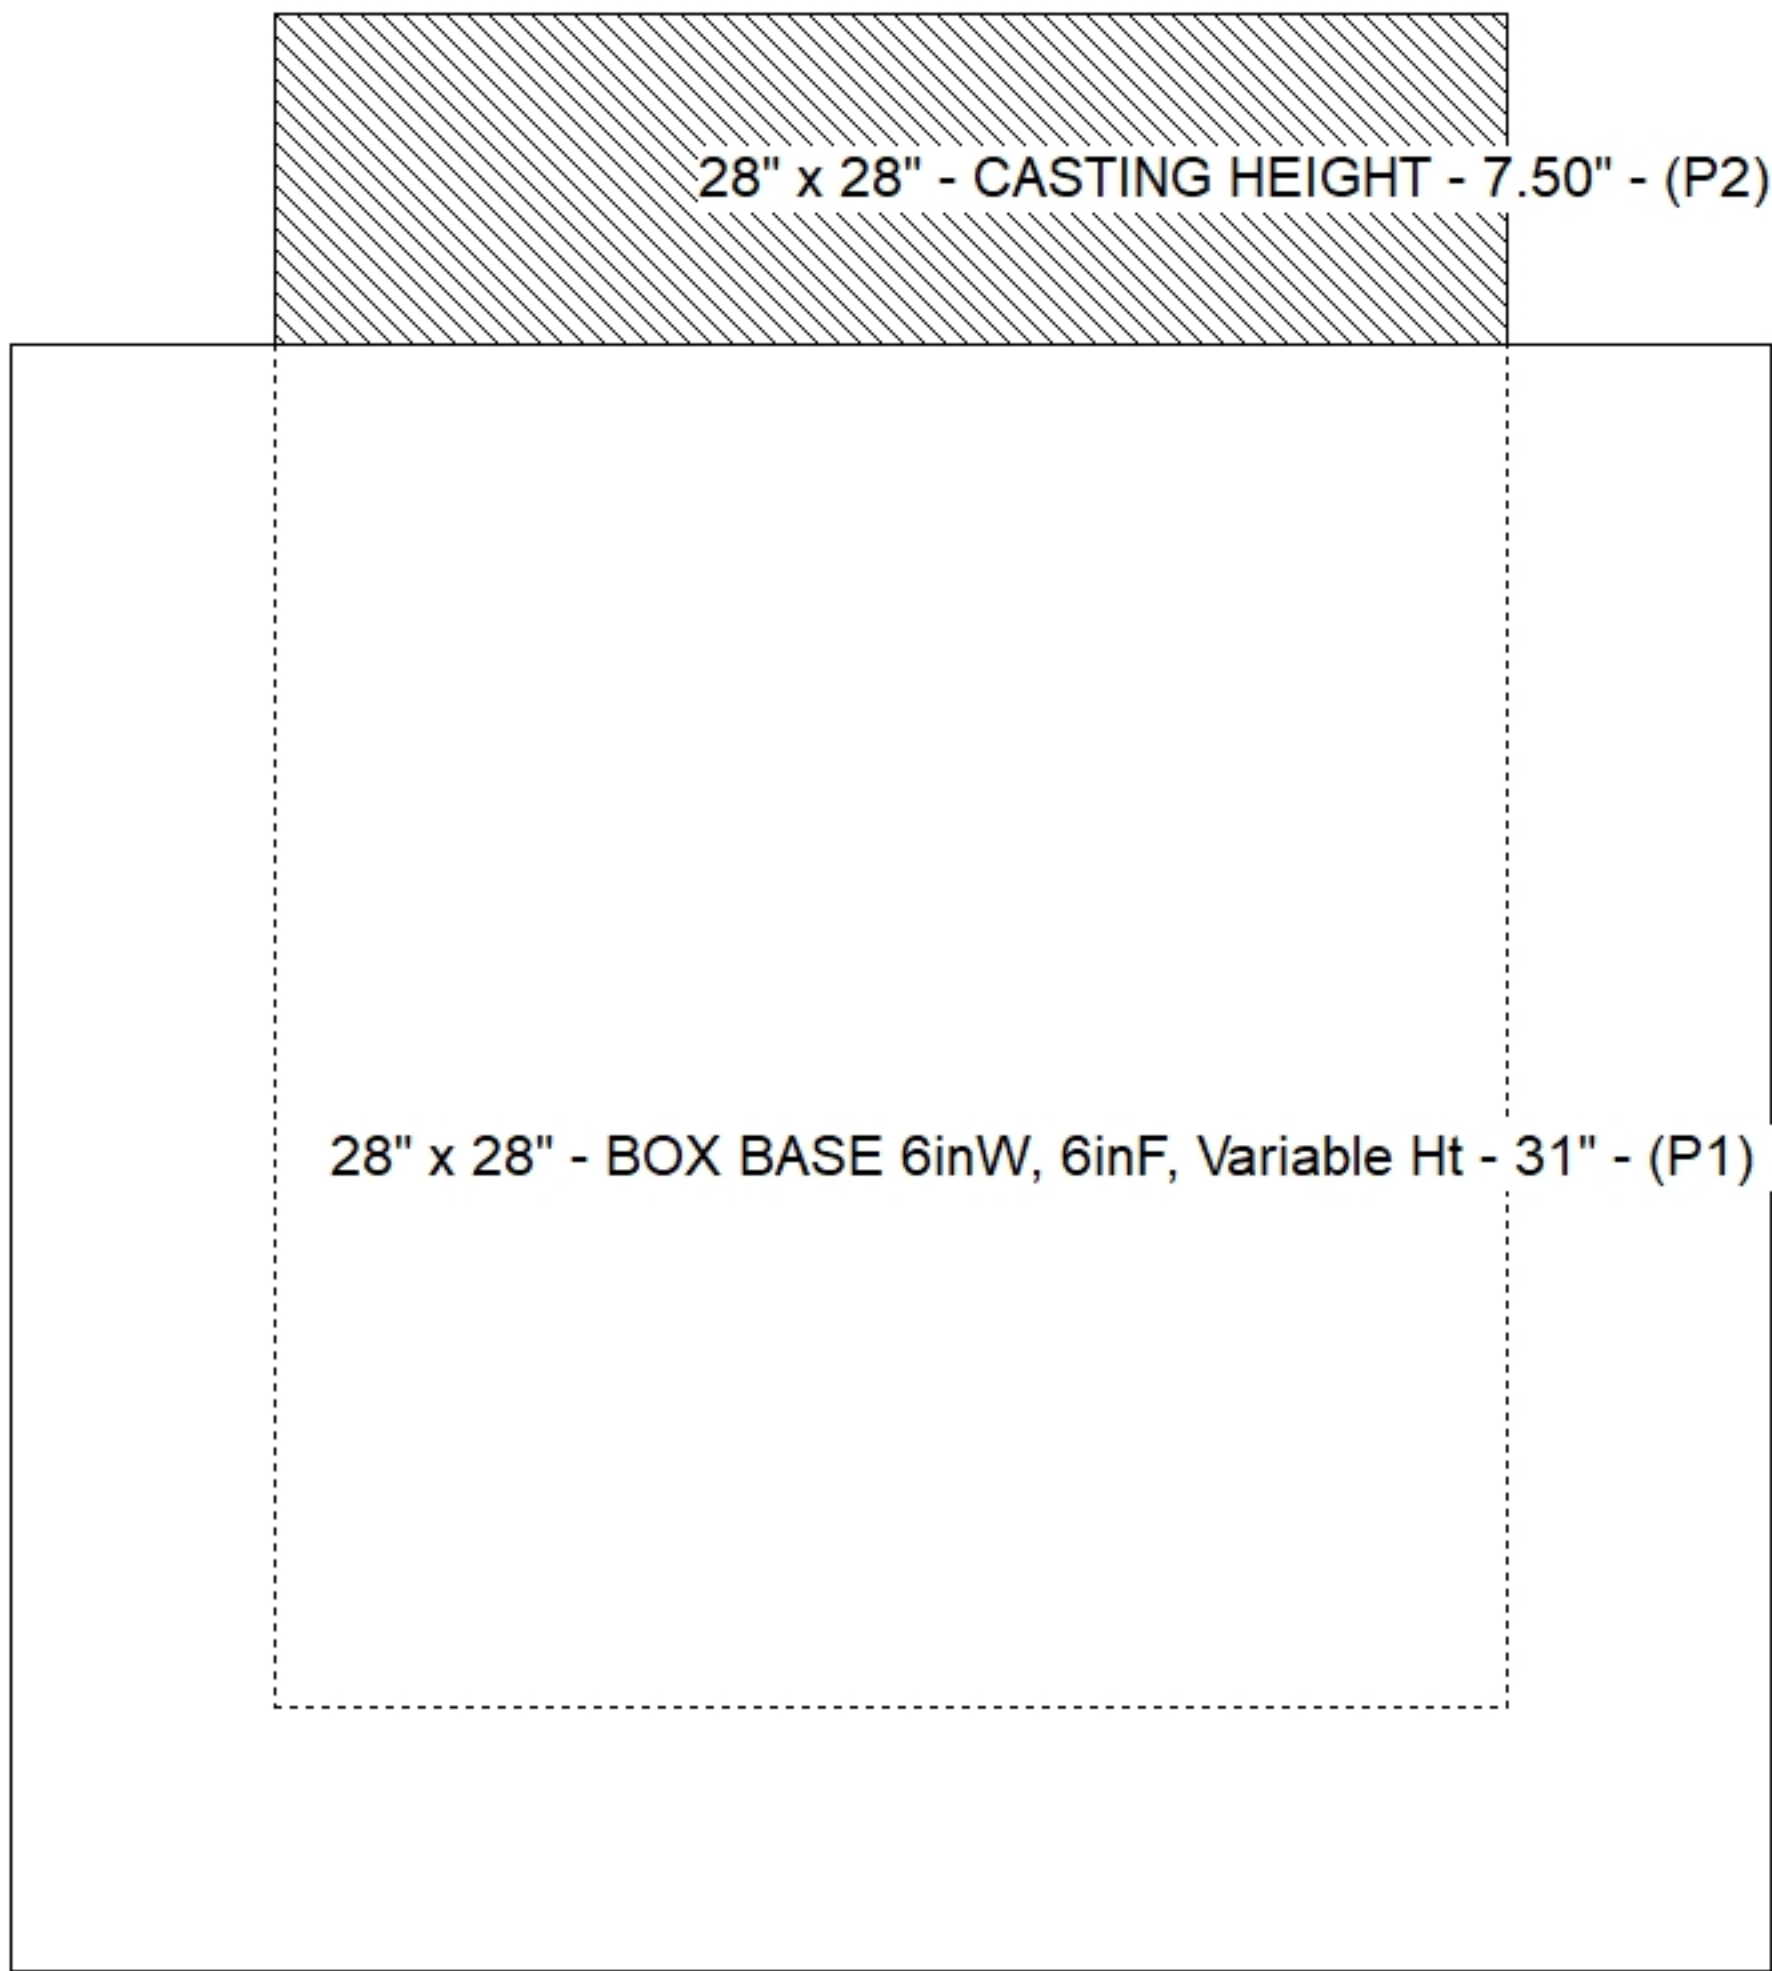

Submittal Drawing
6/16/2026 9:05:48 AM

SUBMITTAL
APPROVED BY: