



Job Name: 26-2310 - 3rd & Madison Townhomes - Ph. 1 Job Location: Nashville, TN 37208 Contractor: Hayes Pipe Supply					Plant: 100 6/15/2026 10:58:56 AM		Tech: Jared - F PC: E. Bradley				
Structure ID: A6 ST-CI											
P1		BX28280606VH		BOX BASE 6inW, 6inF, Variable Ht F/n							
P2) 28" x 28" - CASTING HEIGHT - 7.50" P1) 28" x 28" - BOX BASE 6inW, 6inF, Variable Ht F/n - 35" 1) 28" x 28" - Conseal CS-102 1.00" 2) Hole - 26 1) Hole - 16					0 lb 2566 lb 0 lb 0 lb 0 lb ----- 0 lb		Structure Notes: 1. PER ASTM C913 SPECIFICATIONS. 2. CONCRETE = 4,000 PSI AT 28 DAYS. 3. NO STEPS AND NO INVERT CHANNEL. 4. CASTING SUPPLIED BY OTHERS (JBS 3300-V F/G/H - SINGLE CURB INLET). REINFORCING PER ASTM A615 (GRADE 60). - WALLS (As .31) #5 BARS AT 12" C.C.E.W. - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.				
Rim: 423.35' Rim to Invert: 3.4' Slack: 0.8" Sump: 2.5" Step Position:											
Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset	
Invert 1	419.95'	0°	20"	18" RCP B WALL	23"	Hole 26	26"	26"	0"	0"	
Invert 2	419.95'	90°	20"	12" HDPE	14.5"	Hole 16	16"	16"	1.25"	0"	
Invert 3	419.95'	180°	20"	18" RCP B WALL	23"	Hole 26	26"	26"	0"	0"	
Invert 4											
Invert 5											
Invert 6											
Invert 7											
Invert 8											


RIGHT-SIDE UP VIEW (int. dimensions)

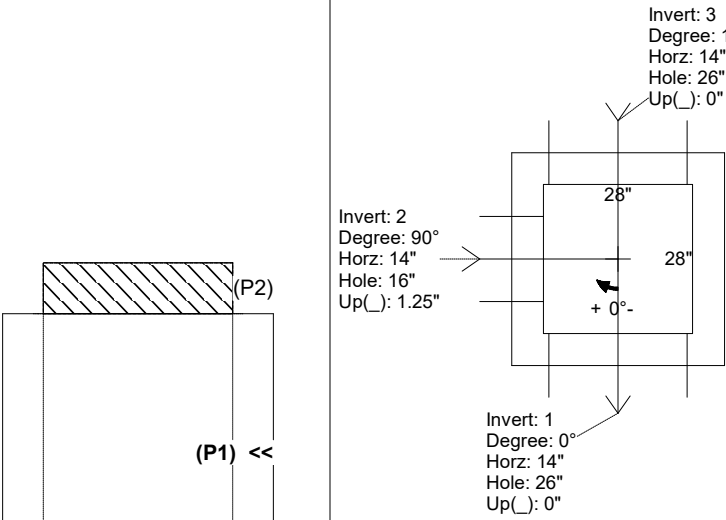

UPSIDE-DOWN VIEW (int. dimensions)

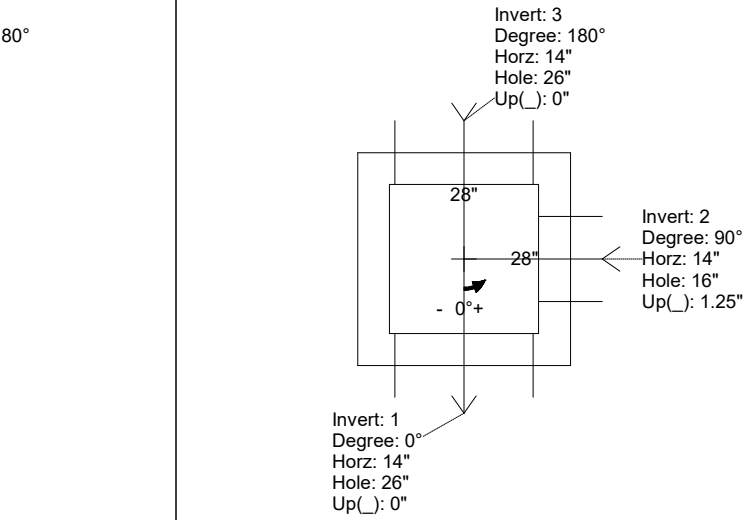

INSIDE WALL DIMENSIONS

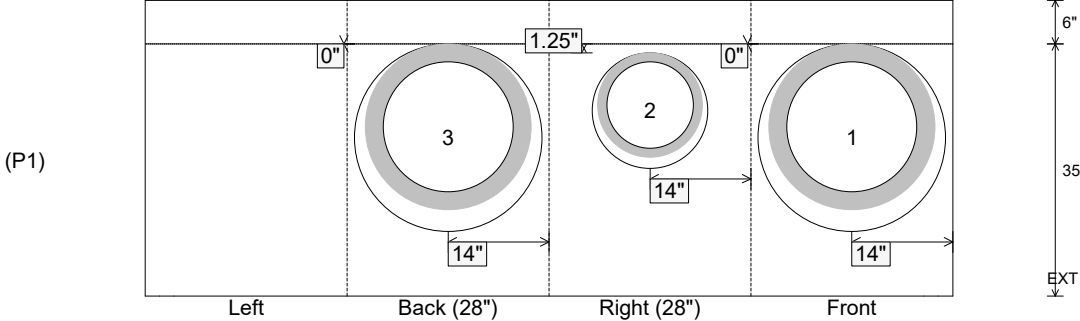

Coating (Int): Coating (Ext):	Seam Up: Flat Seam Dn: n/a	Wall Thickness: 6" Floor Height: 6"	Height (Int): 35" Height (Ext): 41"	Weight (Net): 2566 lb Volume (Net): 0.66cu.yd
----------------------------------	-------------------------------	--	--	--