




Job Name: 26-2310 - 3rd & Madison Townhomes - Ph. 1 Job Location: Nashville, TN 37208 Contractor: Hayes Pipe Supply					Plant: 100 6/15/2026 10:58:59 AM		Tech: Jared - F PC: E. Bradley			
Structure ID: C1 ST-CB										
P1		BX2828-06BA48		BOX BASE 6inW, 6inF F/n						
P3) 28" x 28" - CASTING HEIGHT - 6" P2) 28" x 28" - GRADE RING F/F - 3" P1) 28" x 28" - BOX BASE 6inW, 6inF F/n - 48" 2) 28" x 28" - Conseal CS-102 1.00" 1) Hole - 16 1) Hole - 14					0 lb 290 lb 3913 lb 0 lb 0 lb 0 lb ----- Structure Total: 4203 lb		Structure Notes: . 1. PER ASTM C913 SPECIFICATIONS. 2. CONCRETE = 4,000 PSI AT 28 DAYS. 3. NO STEPS AND NO INVERT CHANNEL. 4. CASTING SUPPLIED BY OTHERS (JBS 4300 F/G). REINFORCING PER ASTM A615 (GRADE 60). - WALLS (As .31) #5 BARS AT 12" C.C.E.W. - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.			
Rim: 425.52' Rim to Invert: 4.69' Slack: 0.53' Sump: 1.25' Step Position:										
Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset
Invert 1	420.83'	0°	20"	12" HDPE	14.5"	Hole 16	16"	16"	0"	0"
Invert 2	420.83'	180°	20"	10" HDPE	11.4"	Hole 14	14"	14"	0.5"	0"
Invert 3										
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										

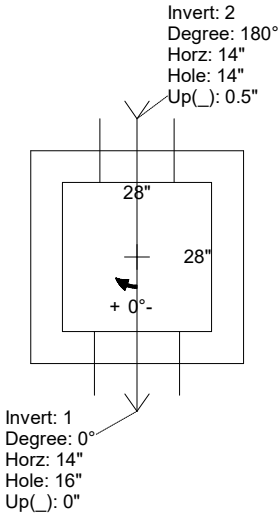

RIGHT-SIDE UP VIEW (int. dimensions)

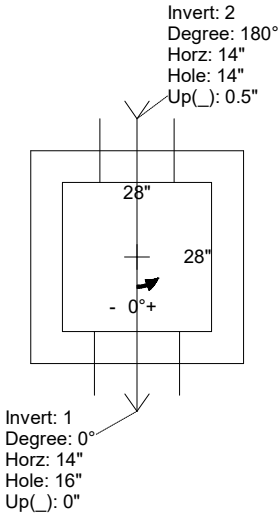

UPSIDE-DOWN VIEW (int. dimensions)

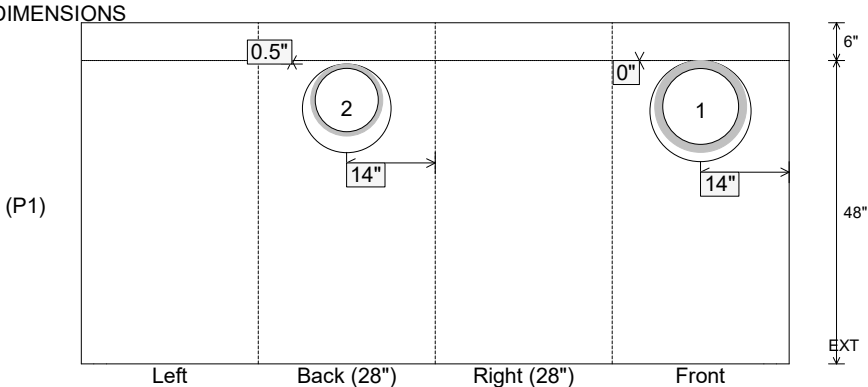

INSIDE WALL DIMENSIONS

Coating (Int): Coating (Ext):	Seam Up: Flat Seam Dn: n/a	Wall Thickness: 6" Floor Height: 6"	Height (Int): 48" Height (Ext): 54"	Weight (Net): 3913 lb Volume (Net): 1cu.yd
----------------------------------	-------------------------------	--	--	---