



Structure ID: QL3 HW (4)


P1 HWTDOT3-1TU36

36" - HW TDOT 3:1 Type U Cross Drain Endwall F/F


GENERAL NOTES

1. DRAWING TO BE USED FOR ALL 12" THROUGH 48" SIDE DRAIN CONCRETE ENDWALLS.
2. MANUFACTURING, FOR CROSS DRAINS ONLY.
3. CONCRETE: $F_c' = 4,500$ PSI @ 28 DAYS.
4. REINFORCING STEEL: ASTM A615, $F_y=60,000$ PSI.
5. SEE STD. DWGS. D-PE-15A, D-PE-18, D-PE-24A, D-PE-30A, D-PE-36A, D-PE-42A & D-PE-48A FOR BILL OF STEEL.
6. SPLICING OF REINFORCEMENT IS ACCEPTABLE PROVIDED THAT A MINIMUM 21" SPLICE LENGTH IS USED.
7. APPROPRIATE SIZING AND LOCATIONS OF THE LIFTING INSERTS WILL BE THE RESPONSIBILITY OF INFRASTRUCTURE PRECAST, INC.
8. LIFTING INSERT POCKETS SHALL BE GROUTED ON SITE BY THE CONTRACTOR AFTER THE ENDWALL IS SET AS PER TDOT REQUIREMENTS.
9. DIMENSIONAL AND REINFORCING TOLERANCES WILL BE AS SHOWN IN STANDARD OPERATING PROCEDURE (SOP) 5-3.
10. PIPE OPENINGS FOR HEADWALLS ARE BASED ON REINFORCED CONCRETE PIPE WITH TYPE "B" WALL AS PER AMERICAN CONCRETE PIPE ASSOCIATION (ACPA). OUTSIDE DIAMETER + 3" - 4".
11. TOE WALL BACK SLOPE MAY BE CONSTRUCTED VARIABLE FROM VERTICAL UP TO 15°.


Customer: Rinker Underground
Project: TDOT EW's
TDOT PIN#: 207036.00
State Project#: 79LPLM-F3-034

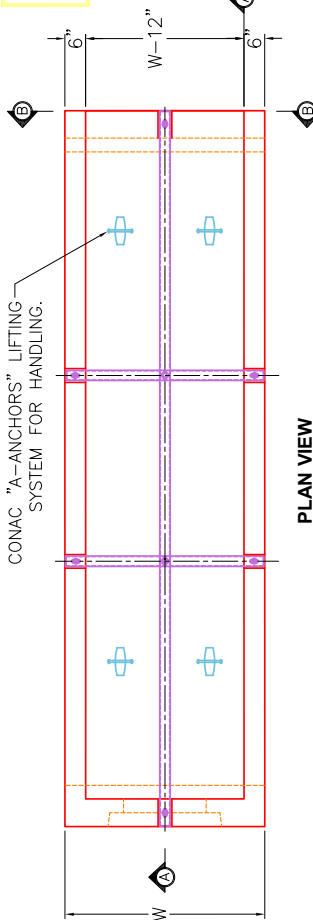



PLAN VIEW

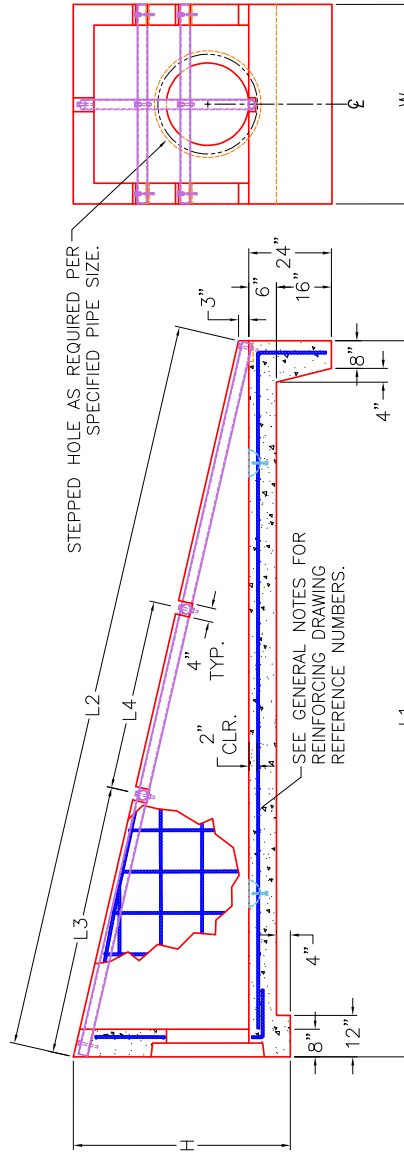

SECTION A-A

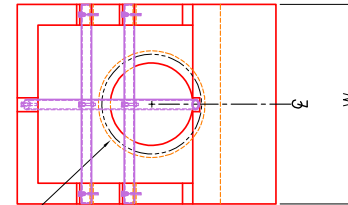


ELEVATION B-B

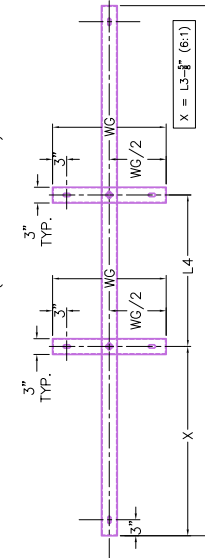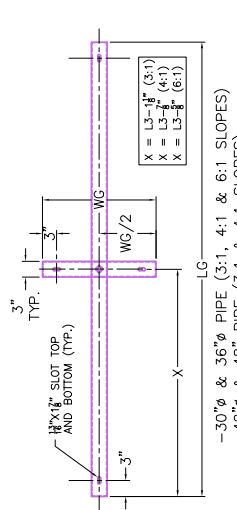

STEEL PIPE GRATE PLAN VIEWS

(SEE D-PE-99 FOR MOUNTING STEEL GRATES)

*Pipe grates supplied by others



INFRASTRUCTURE PRECAST, INC.
981 WEST 7TH ST., BEAVER DAM, KY. 42320
PHONE: (270) 363-2238, FAX: (270) 298-7424

TDOT TYPE "U" CROSS DRAIN ENDWALL WITH STEEL
PIPE GRATE FOR 15" THROUGH 48" PIPES

DRAWING NO.: ET-TDOT-202
DATE: 11-24-25
DRAWN BY: N. RICHARDS

SCALE: NTS

WEB: WWW.ICASTINC.COM

DIMENSIONS & QUANTITIES FOR ONE ENDWALL 4:1									
PIPE DIA. (D)	CONCRETE ENDWALL DIMENSIONS				GRATE DISPLACEMENT DIMENSIONS			STRUCT. STEEL	WEIGHT LBS.
	H	W	L1	L2	L3	L4	L5		
15"	2'-11"	2'-8"	8'-0"	8'-3"	N/A	N/A	N/A	N/A	3,484
18"	3'-2"	2'-11"	8'-8"	8'-11"	N/A	N/A	N/A	N/A	4,228
24"	3'-9"	3'-6"	11'-0"	11'-4"	N/A	N/A	N/A	N/A	6,303
30"	4'-5"	4'-1"	13'-8"	14'-1"	6'-1"	N/A	N/A	137	9,083
36"	5'-0"	4'-8"	16'-0"	16'-3"	8'-2"	N/A	N/A	160	12,058
42"	5'-6"	5'-3"	18'-0"	18'-6"	9'-2"	N/A	N/A	180	15,073
48"	6'-1"	5'-10"	20'-4"	20'-11"	10'-3"	N/A	N/A	203	18,910

DIMENSIONS & QUANTITIES FOR ONE ENDWALL 3:1									
PIPE DIA. (D)	CONCRETE ENDWALL DIMENSIONS				GRATE DISPLACEMENT DIMENSIONS			STRUCT. STEEL	WEIGHT LBS.
	H	W	L1	L2	L3	L4	L5		
15"	2'-11"	2'-8"	6'-0"	6'-3"	N/A	N/A	N/A	N/A	2,819
18"	3'-2"	2'-11"	6'-8"	7'-0"	N/A	N/A	N/A	N/A	3,406
24"	3'-9"	3'-6"	8'-5"	8'-10"	N/A	N/A	N/A	N/A	5,011
30"	4'-5"	4'-1"	10'-5"	10'-11"	5'-2"	N/A	N/A	114	7,204
36"	5'-0"	4'-8"	12'-2"	12'-9"	6'-4"	N/A	N/A	132	9,513
42"	5'-6"	5'-3"	13'-8"	14'-4"	7'-4"	N/A	N/A	148	11,862
48"	6'-1"	5'-10"	15'-5"	16'-3"	7'-4"	N/A	N/A	167	14,838

STEEL PIPE GRATE DIMENSIONS									
PIPE DIA.	ALL SLOPES				CONCRETE ENDWALL DIMENSIONS				WEIGHT LBS.
	H	W	L1	L2	L3	L4	L5	L6	
15"	2'-11"	2'-8"	8'-0"	8'-3"	N/A	N/A	N/A	N/A	3,484
18"	3'-2"	2'-11"	8'-8"	8'-11"	N/A	N/A	N/A	N/A	4,228
24"	3'-9"	3'-6"	11'-0"	11'-4"	N/A	N/A	N/A	N/A	6,303
30"	4'-5"	4'-1"	13'-8"	14'-1"	6'-1"	N/A	N/A	N/A	9,083
36"	5'-0"	4'-8"	16'-0"	16'-3"	8'-2"	N/A	N/A	N/A	12,058
42"	5'-6"	5'-3"	18'-0"	18'-6"	9'-2"	N/A	N/A	N/A	15,073
48"	6'-1"	5'-10"	20'-4"	20'-11"	10'-3"	N/A	N/A	N/A	18,910

DIMENSIONS & QUANTITIES FOR ONE ENDWALL 6:1									
PIPE DIA. (D)	CONCRETE ENDWALL DIMENSIONS				GRATE DISPLACEMENT DIMENSIONS			STRUCT. STEEL	WEIGHT LBS.
	H	W	L1	L2	L3	L4	L5		
15"	2'-11"	2'-8"	11'-2"	11'-3"	N/A	N/A	N/A	N/A	4,737
18"	3'-2"	2'-11"	12'-8"	12'-10"	N/A	N/A	N/A	N/A	5,833
24"	3'-9"	3'-6"	16'-2"	16'-4"	N/A	N/A	N/A	N/A	8,848
30"	4'-5"	4'-1"	20'-2"	20'-5"	10'-1"	N/A	N/A	186	12,880
36"	5'-0"	4'-8"	23'-8"	23'-11"	12'-0"	N/A	N/A	217	17,186
42"	5'-6"	5'-3"	26'-8"	27'-0"	14'-1"	N/A	N/A	284	21,532
48"	6'-1"	5'-10"	30'-2"	30'-7"	16'-1"	N/A	N/A	320	27,092