

Contractor: Hahn Excavating, Inc.

TECH: Jared - F

Plant: 100



Slack: 6"


Structure Notes: 1. PER ASTM C913 SPECIFICATIONS.
2. CONCRETE = 4,000 PSI AT 28 DAYS.
3. NO INVERT CHANNEL.
4. REINFORCING PER ASTM A615 (GRADE 60).
- TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W.
- WALLS (As .12) #5 BARS AT 12" C.C.E.W.
- FLOOR (As .12) #5 BARS AT 12" C.C.E.W.

STRUCTURE SUMMARY:

P1) 15" - FLARED END SECTION SPIGOT (INLET) - 15"

1160 lb

Structure Total: 1160 lb

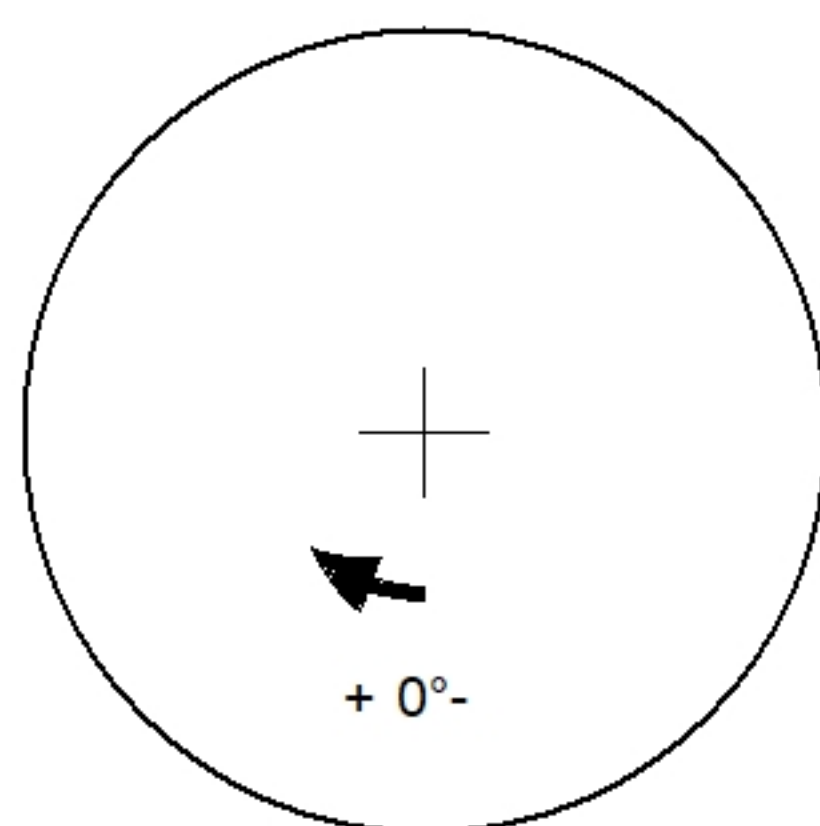


Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up (↓)	Ref
Rim	1.75'							
Reducer								
Invert 1								
Invert 2								
Invert 3								
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

Default - Interior Dimensions

15" - FLARED END SECTION SPIGOT (INLET) - 15" - (P1)

(P1)

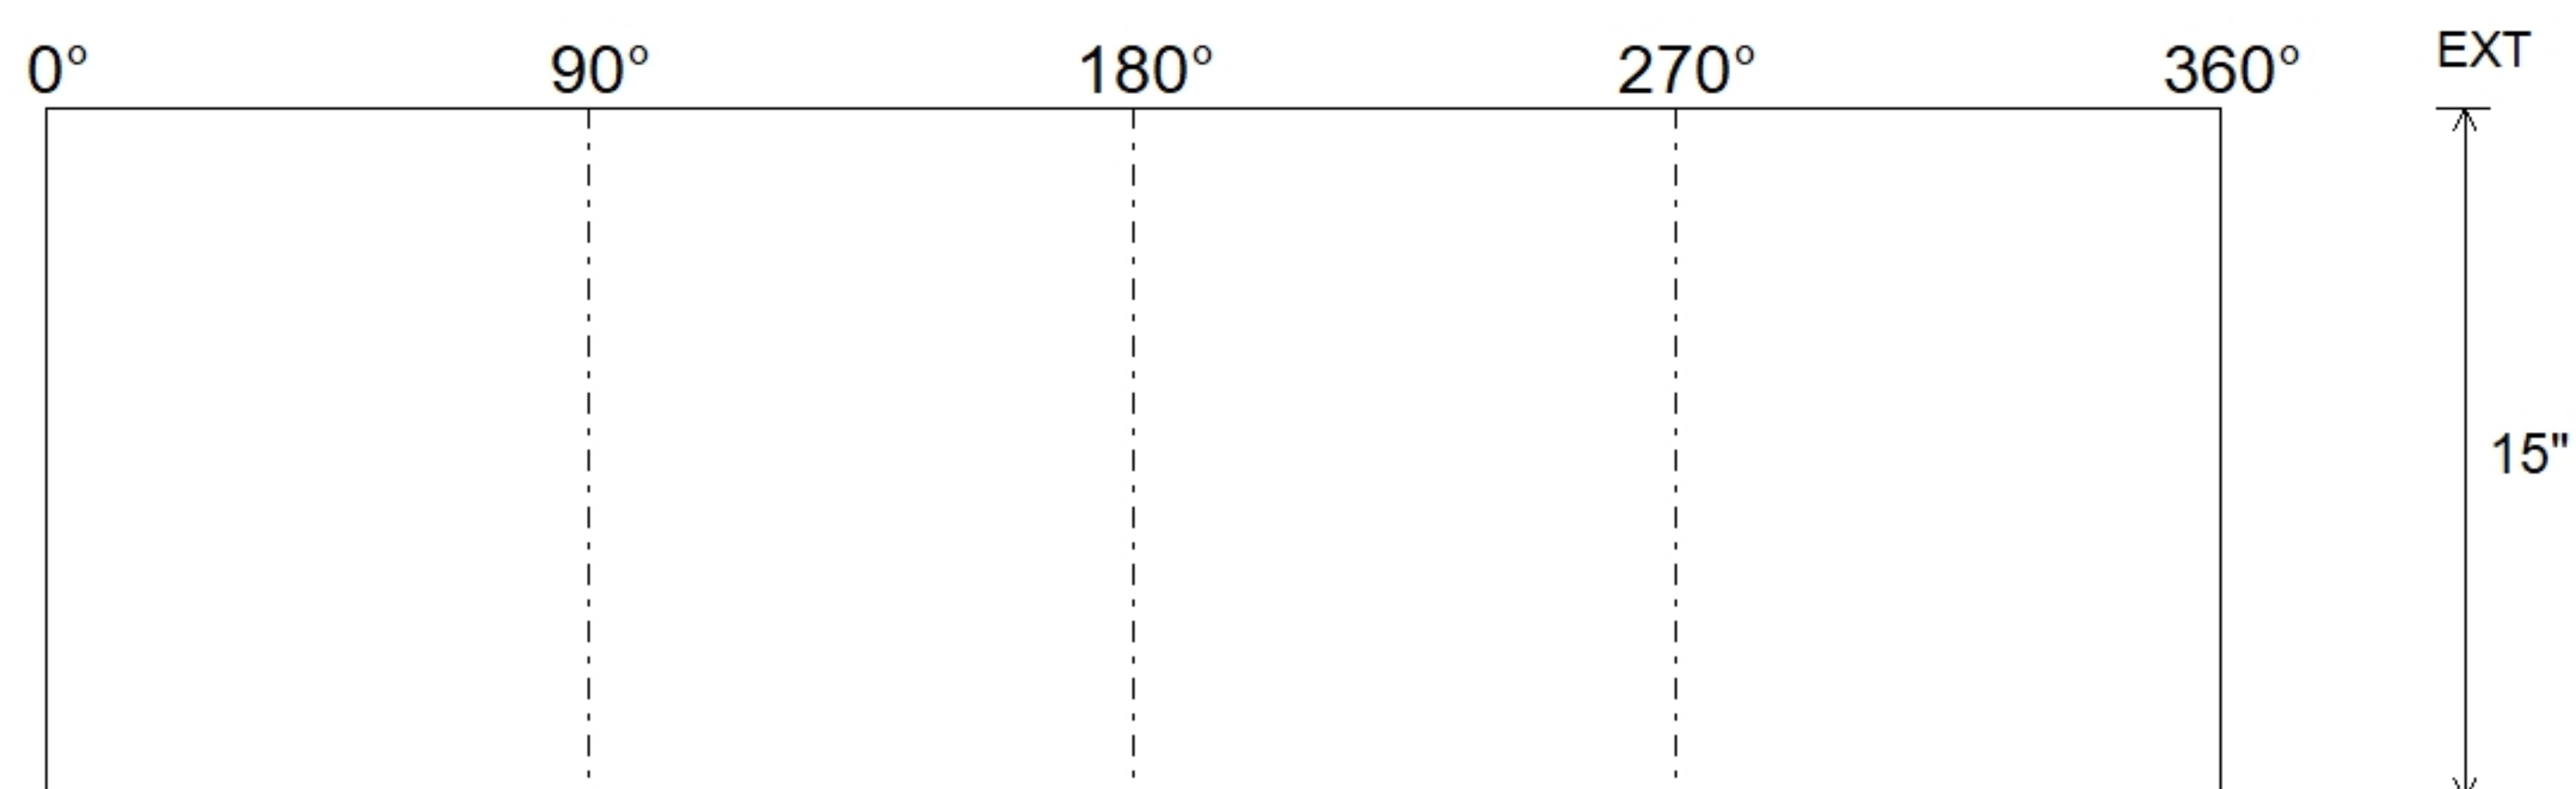

Submittal Drawing
7/15/2026 10:25:06 AM

SUBMITTAL
APPROVED BY: