

Job Name: 26-2370 - Greystone Subd.
Job Location: Madisonville, KY
Contractor: Steve Pleasant Excavating, LLC

Plant: 100

5/25/2026 11:01:37 AM

Tech: Jared - F
PC: E. Bradley



Structure ID: 8 SS-MH

P2 MH048CN42

ECC CONE w/ 24" HOLE F/G

- P3) 24" - CASTING HEIGHT - 7"
P2) 48" - ECC CONE w/ 24" HOLE F/G - 42"
P1) 48" - MH BASE T/n - 30"
1) 48" - MH INVERT CHANNEL - FULL HEIGHT
1) JOINT WRAP - 12" WD x 048" MAC WRAP
1) Inflow Dish FOR MC-315
1) CASTING - HOE MC-315 F/C Sanitary
1) 48" - Conseal CS-102 1.00" (Double)
1) 24" - Conseal CS-102 1.00" (Double)
1) PSX - 12-08 NYLO
4) PSX - 12-06 NYLO
6) MH Step ML-10-TDS-NCR - 10"

0 lb
3200 lb
3187 lb
1440 lb
0 lb
2 lb
258 lb
0 lb
0 lb
8 lb
32 lb
0 lb



Structure Total: 8127 lb

Structure Notes:

1. PER ASTM C478 SPECIFICATIONS.
2. CONCRETE = 4,000 PSI AT 28 DAYS.
3. CASTING BY ICAST (HOE MC-315 F/C "SANITARY").

REINFORCING PER ASTM A615 (GRADE 60).

- CONE (As .12)
- RISER/WALLS (As .12)
- FLOOR (As .31) #5 BARS AT 12" C.C.E.W.

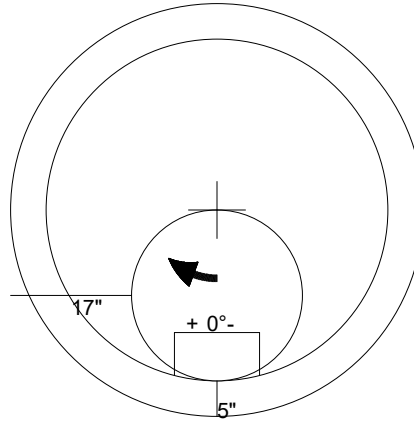

48" - ECC CONE w/ 24" HOLE F/G - 42" - (P2)

Coating (Int):
Coating (Ext):

Seam Up: Flat
Seam Dn: Groove

Wall Thickness: 5"

Height (Ext): 42"

Weight (Net): 3200 lb
Volume (Net): 0.5cu.yd