

Contractor: Hahn Excavating, Inc.

TECH: Jared - F

Plant: 100



Size: 36" x 36"

Rim to Invert: 2.96'

Floor Height: 8"


Slack: 0.52"

REINFORCING PER ASTM A615 (GRADE 60).
- WALLS (As .12) #5 BARS AT 12" C.C.E.W.
- FLOOR (As .12) #5 BARS AT 12" C.C.E.W.


P2) 36" x 36" - CASTING HEIGHT - 3"
P1) 36" x 36" - BOX BASE 8inW, 8inF, Variable Ht - 35"
1) CASTING - HOE 595 F/G
1) 36" x 36" - Conseal CS-102 1.00"
1) Hole - 32
1) Hole - 20
1) Hole - 26

0 lb
4809 lb
376 lb
0 lb
0 lb
0 lb
0 lb


Structure Total: 5185 lb

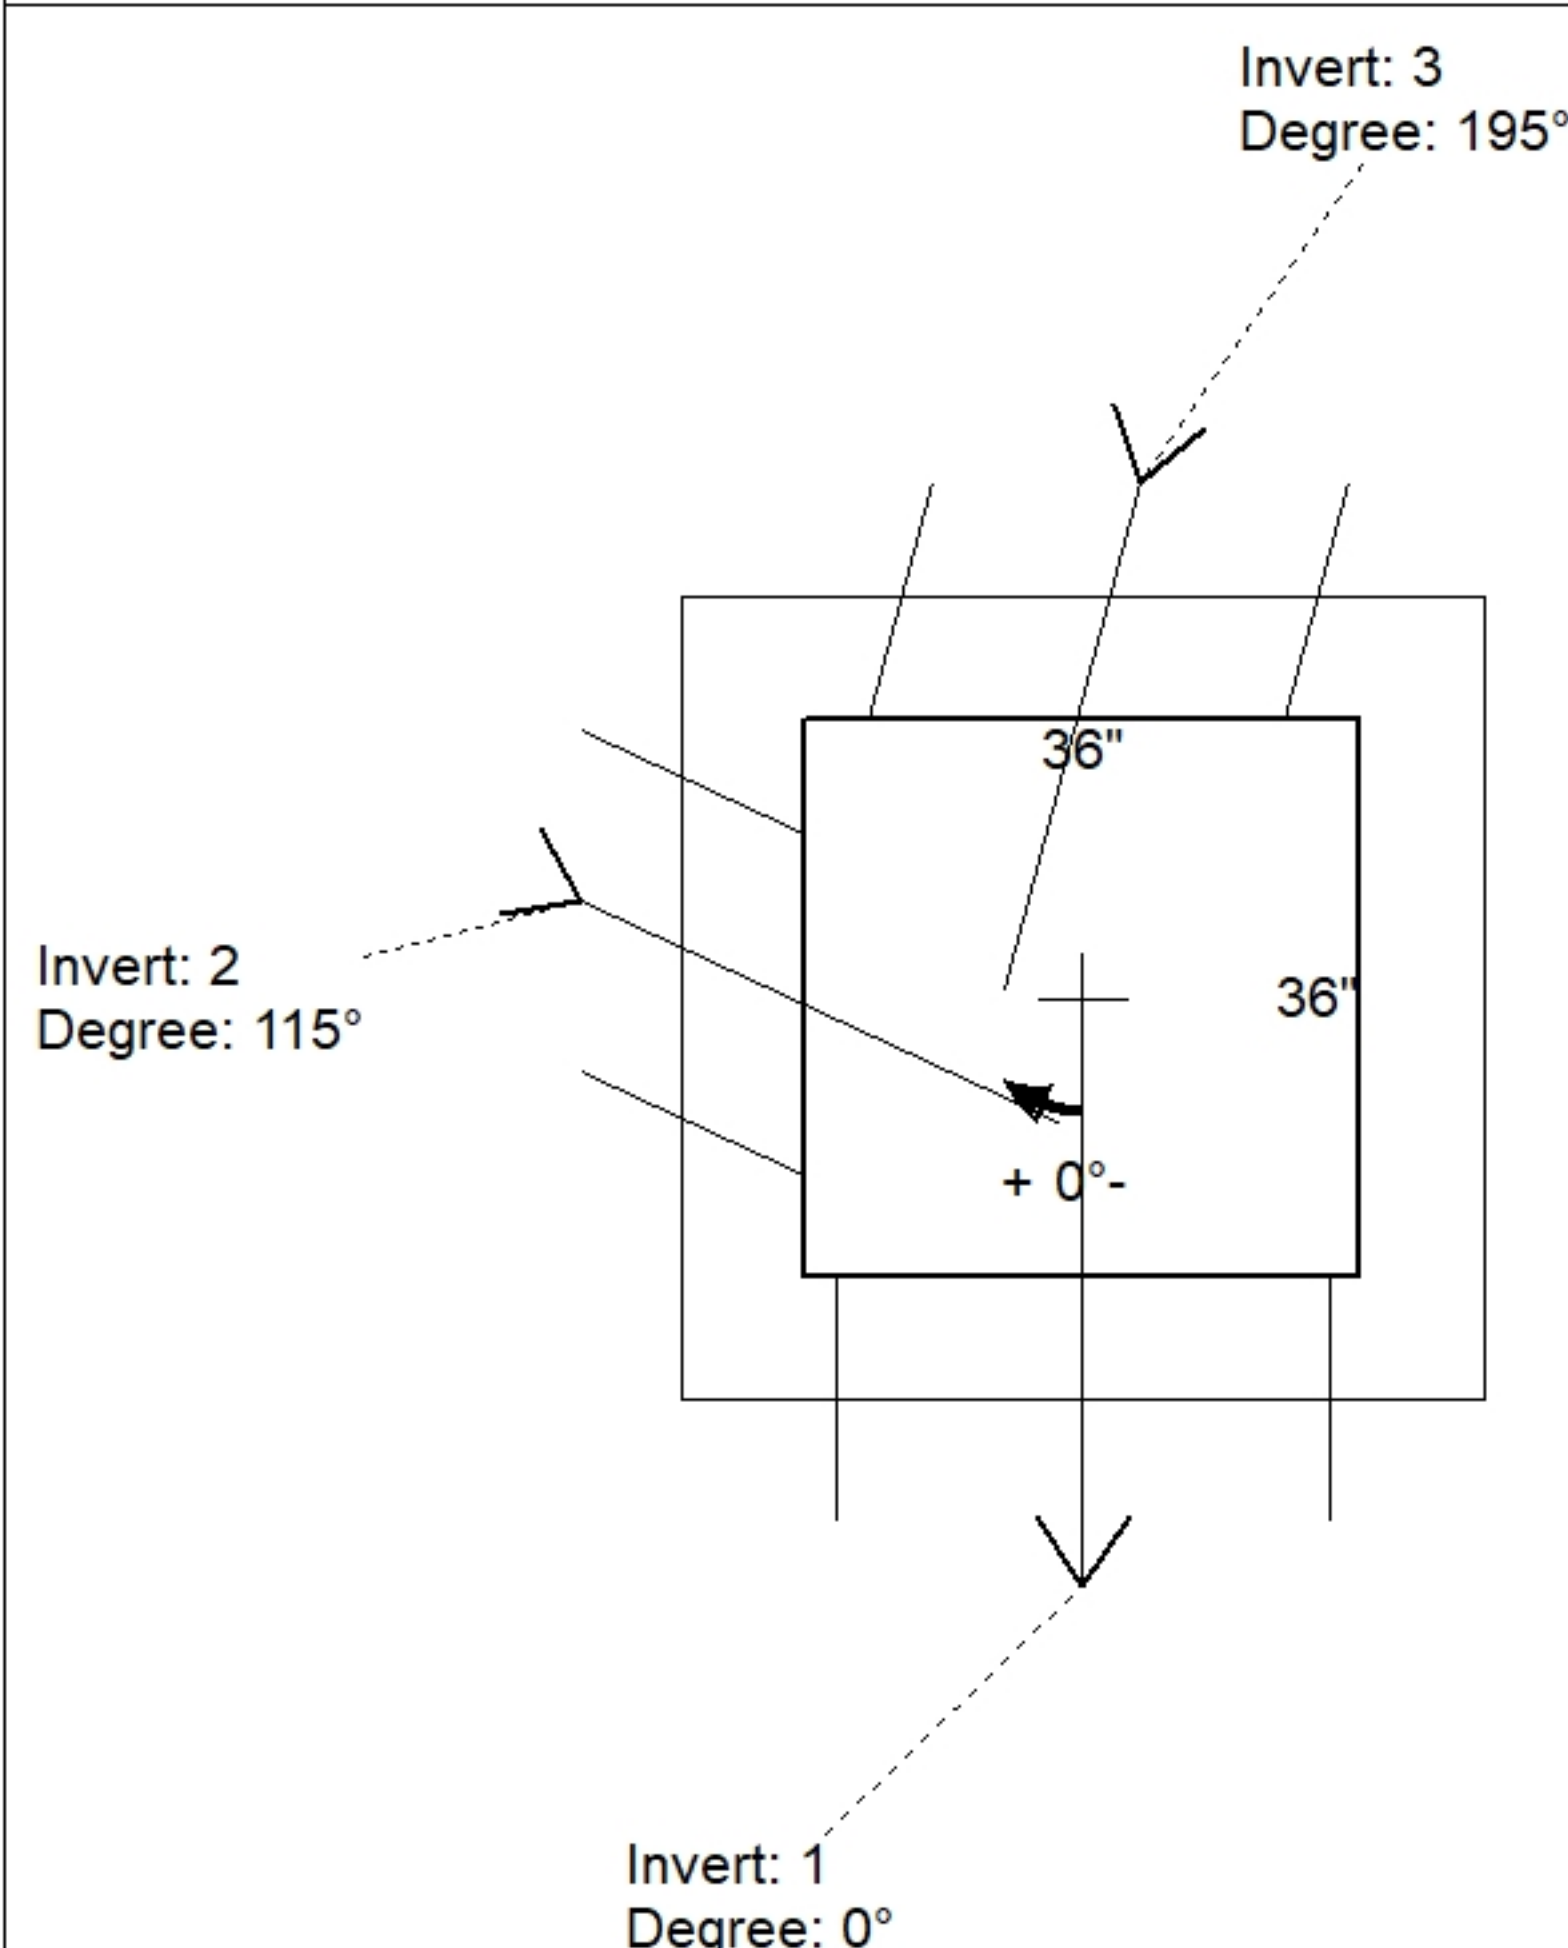

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up (')	Ref
Rim	373.7'							
Reducer								
Invert 1	370.74'	0°	24" RCP B WALL	30"	32"	Hole 32	0"	P1
Invert 2	370.74'	115°	15" VCP	17.75"	20"	Hole 20	1.625"	P1
Invert 3	370.74'	195°	18" RCP B WALL	23"	26"	Hole 26	0.5"	P1
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

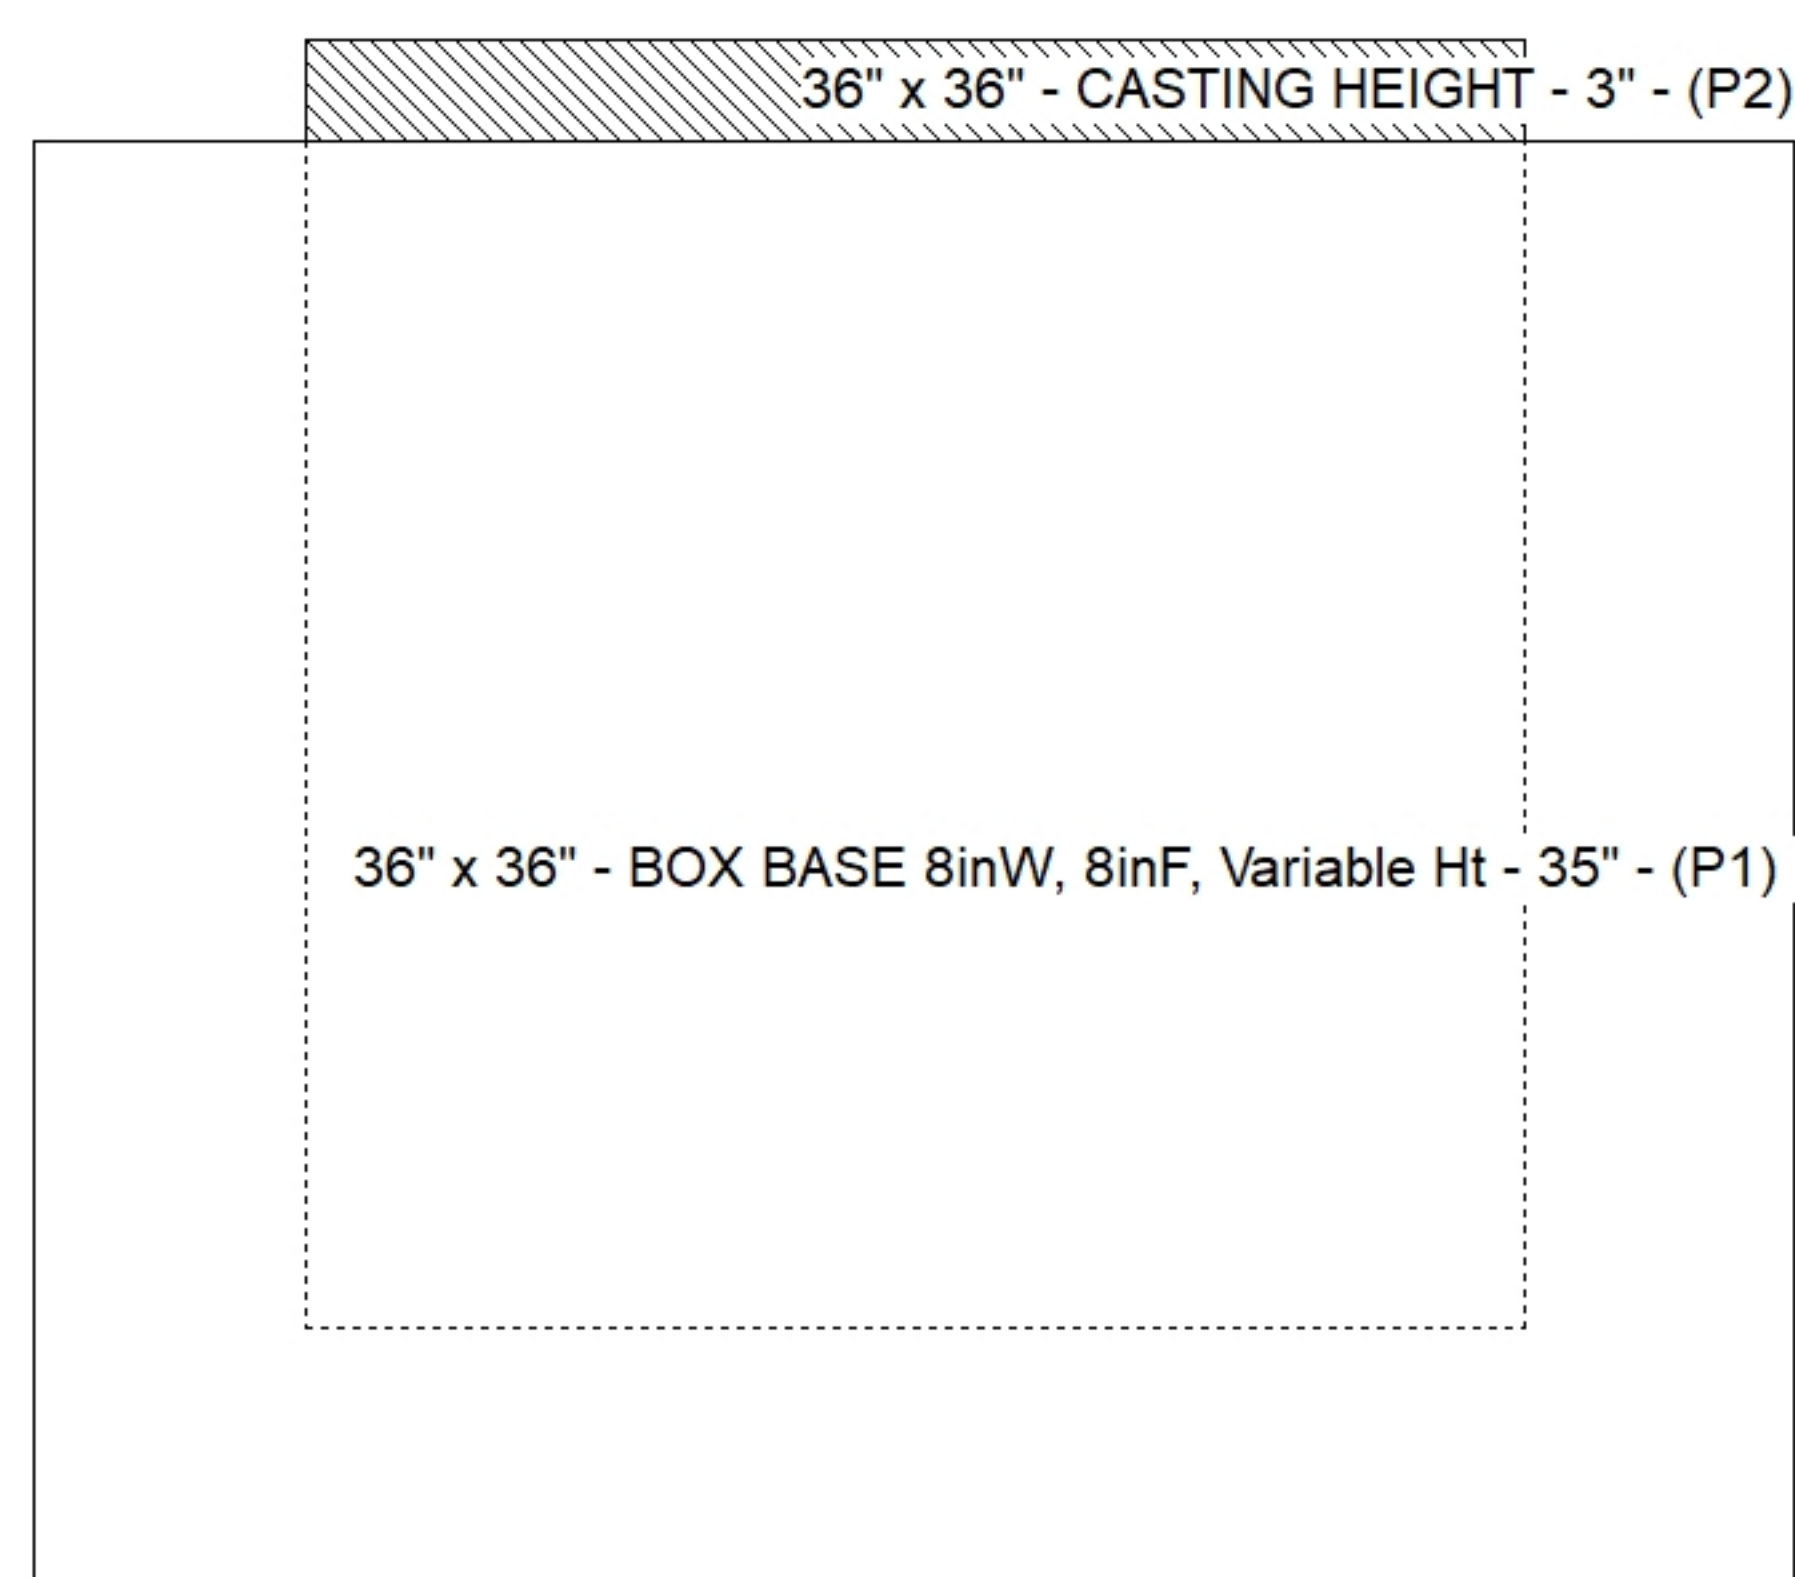

Default - Interior Dimensions

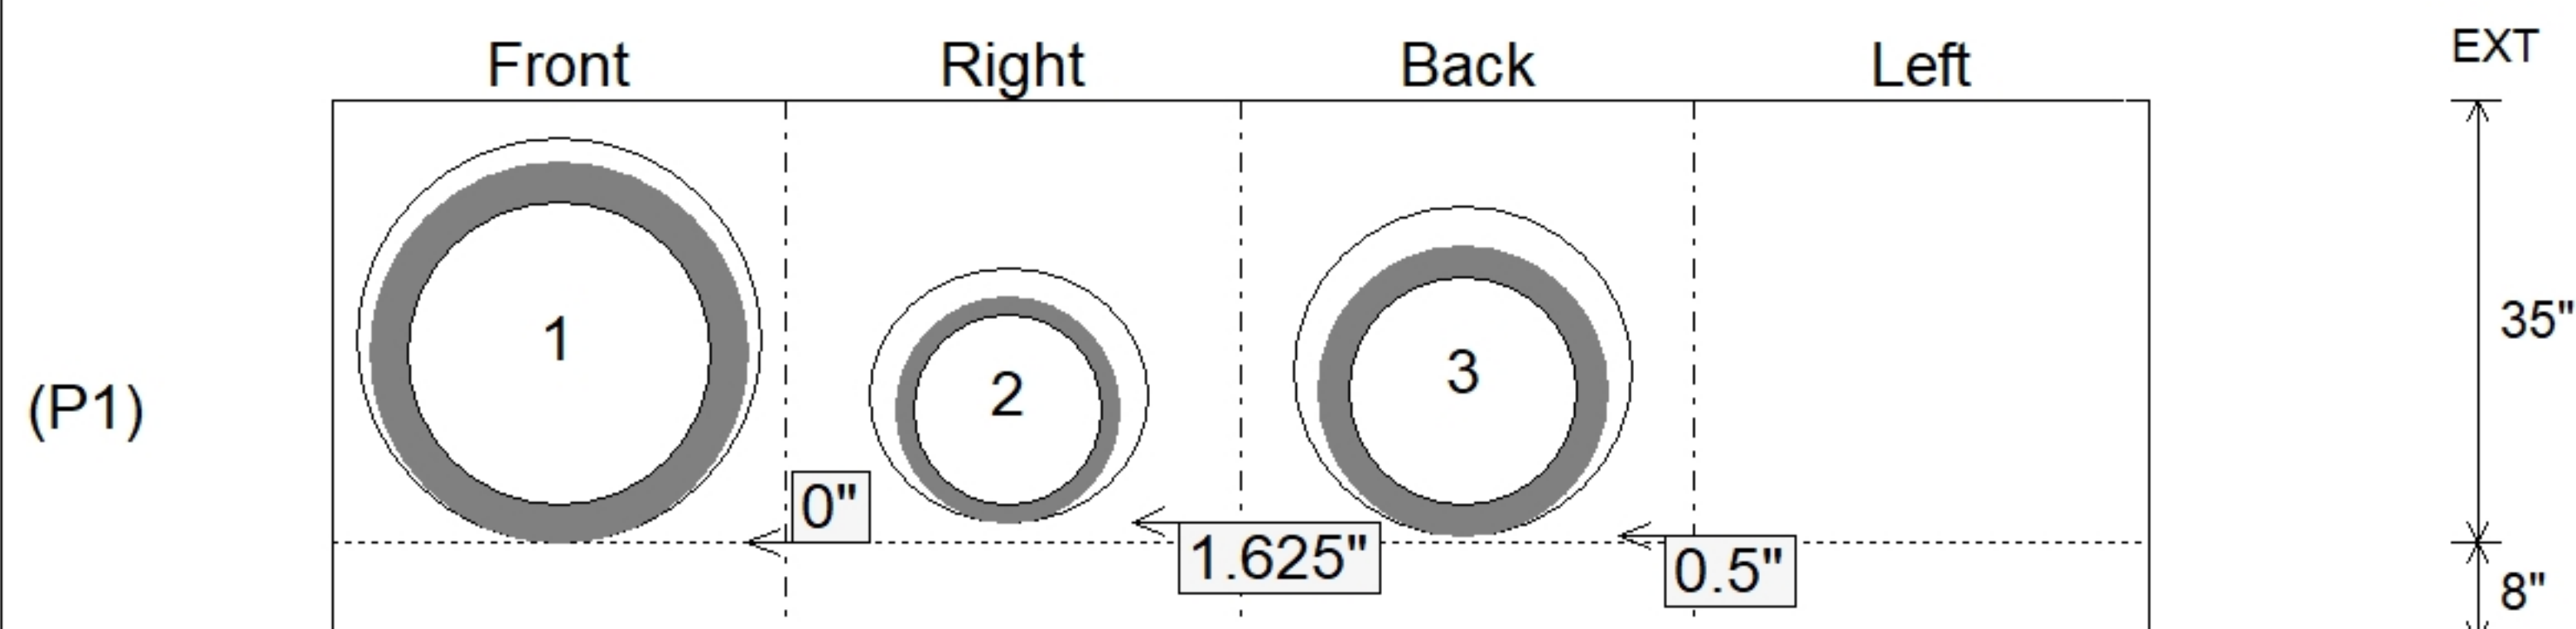

Submittal Drawing
10/9/2026 12:57:16 PM

SUBMITTAL
APPROVED BY: