

Job Name: 26-2424 Fifth Third Mt. Juliet Central
Job Location: Mount Juliet, TN 37122
Contractor: Hayes Pipe Supply

Plant: 100
6/30/2026 11:38:48 AM

Tech: Jared - A
PC: Erica Bradley



Structure ID: ST-3 ST-MH

P2 MH048LD12ECC


MH FLAT TOP w/ 24" ECC Hole

- P3) 24" - CASTING HEIGHT - 7"
P2) 48" - MH FLAT TOP w/ 24" ECC Hole - 12"
P1) 48" - MH BASE - 30"
1) 48" - Conseal CS-102 1.00"
1) 24" - Conseal CS-102 1.00"
2) Hole - 20
2) MH Step ML-10-TDS-NCR - 10"


Structure Total:

0 lb
1561 lb
3155 lb
0 lb
0 lb
0 lb
0 lb
4716 lb

Structure Notes:
1. HOE MC-375 F/C STORM PROVIDED BY OTHERS
2. PER ASTM C478 SPECIFICATIONS.
3. CONCRETE = 4,000 PSI AT 28 DAYS.
4. REINFORCING PER ASTM A615 (GRADE 60).
- TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W..
- RISER/WALLS (As .12)
- FLOOR (As .31) #5 BARS AT 12" C.C.E.W.

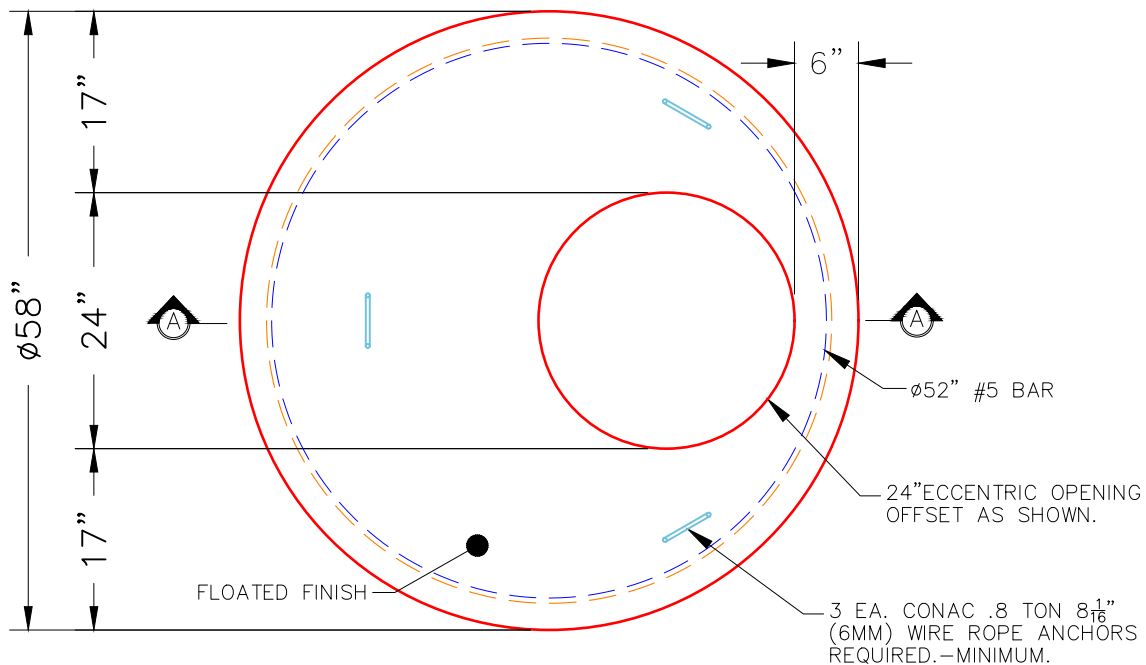

PLAN VIEW

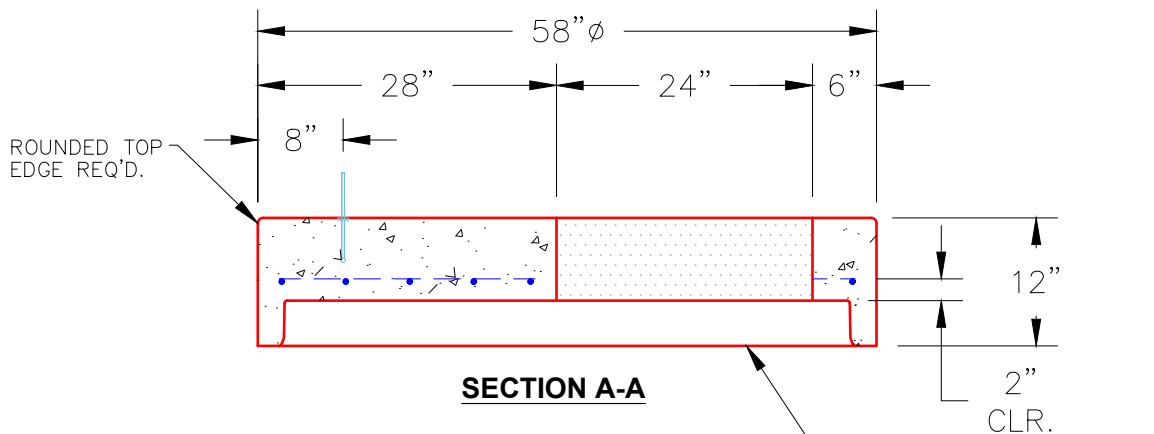

SECTION A-A

NOTES:

1. MANUFACTURED TO ASTM C-478 (LATEST REVISION).
2. CONCRETE: 4,000 PSI AT 28 DAYS.
3. REINFORCING: #5 BAR @ 6" O.C. E.W. (GRADE 60).

STANDARD SINGLE OFFSET
GROOVE JOINT REQUIRED

Coating (Int):
Coating (Ext):

Seam Up: Flat
Seam Dn: Groove

Wall Thickness: 5"

Height (Ext): 12"

Weight (Net): 1561 lb
Volume (Net): 0.42cu.yd