

Contractor: Core & Main LP

Plant: Beaver Dam, KY




Slack: 2"


1. PER ASTM C-913 SPECIFICATIONS
2. CONCRETE: 4,000 PSI AT 28 DAYS
3. REINFORCEMENT:
 - FLAT LID: #5 BAR @ 6" C.C. E.W. (GRADE 60)
 - BASE: #5 BAR @ 12" C.C. E.W. (GRADE 60)
4. NO INVERT CHANNEL
5. STEPS AT 90 DEGREES
6. 6" CASTING SUPPLIED BY OTHERS

0 lb


Structure Total: 56658 lb

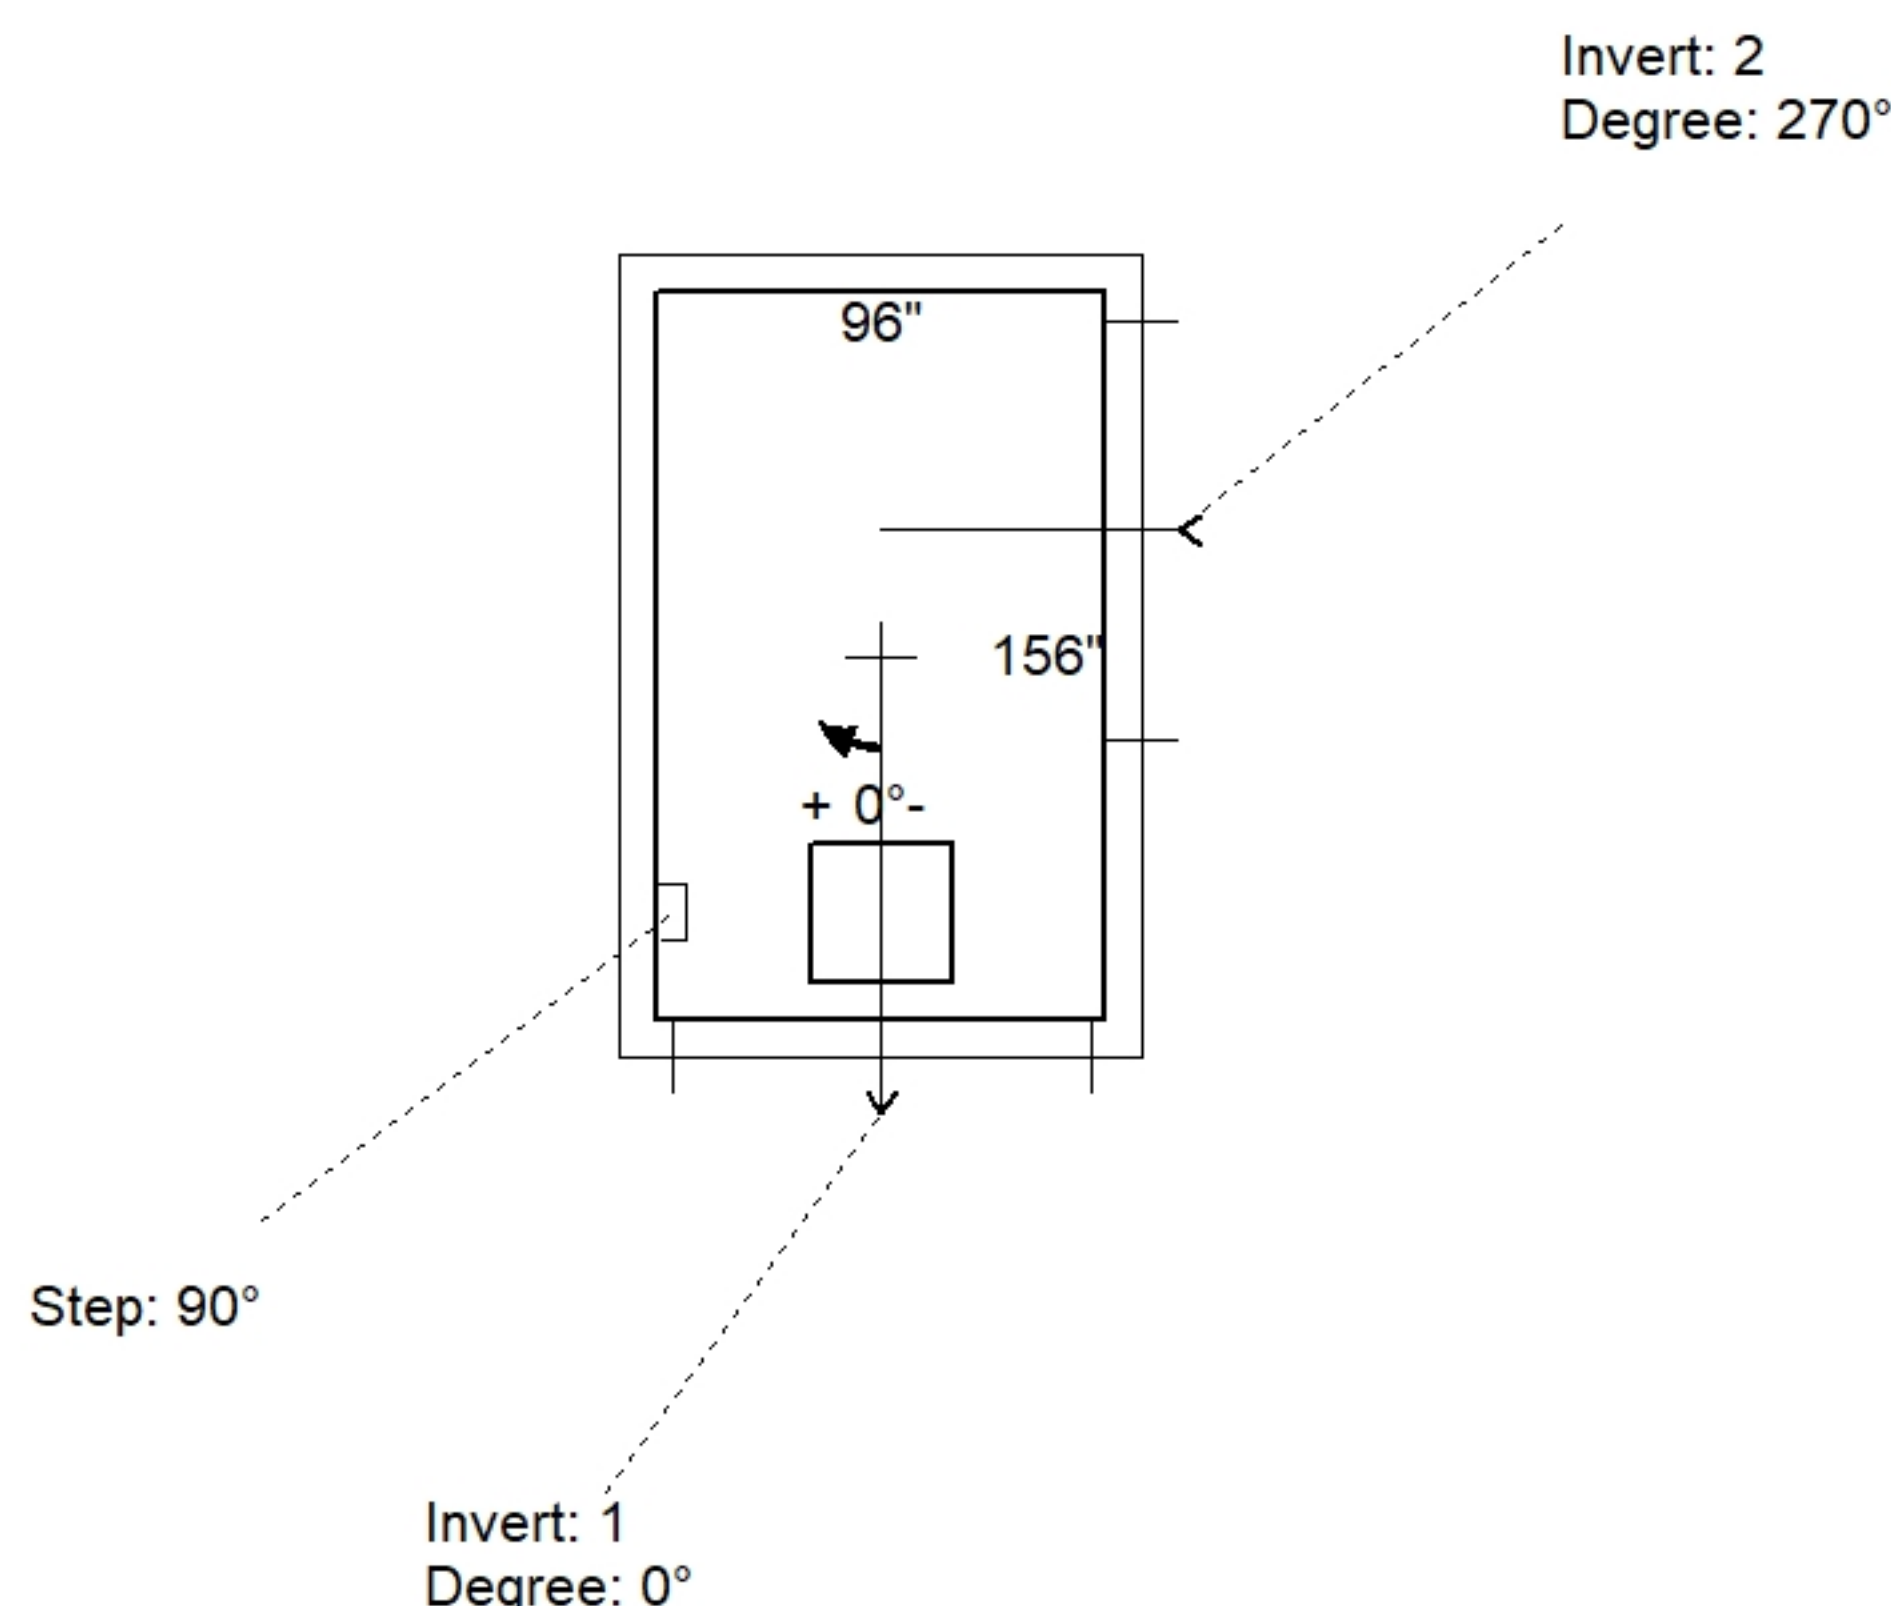

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up (')	Ref
Rim	478'							
Reducer								
Invert 1	468'	0°	72" RCP B WALL	86"	90"	Hole 90	0"	P1
Invert 2	468'	270°	72" RCP B WALL	86"	90"	Hole 90	0"	P1
Invert 3								
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

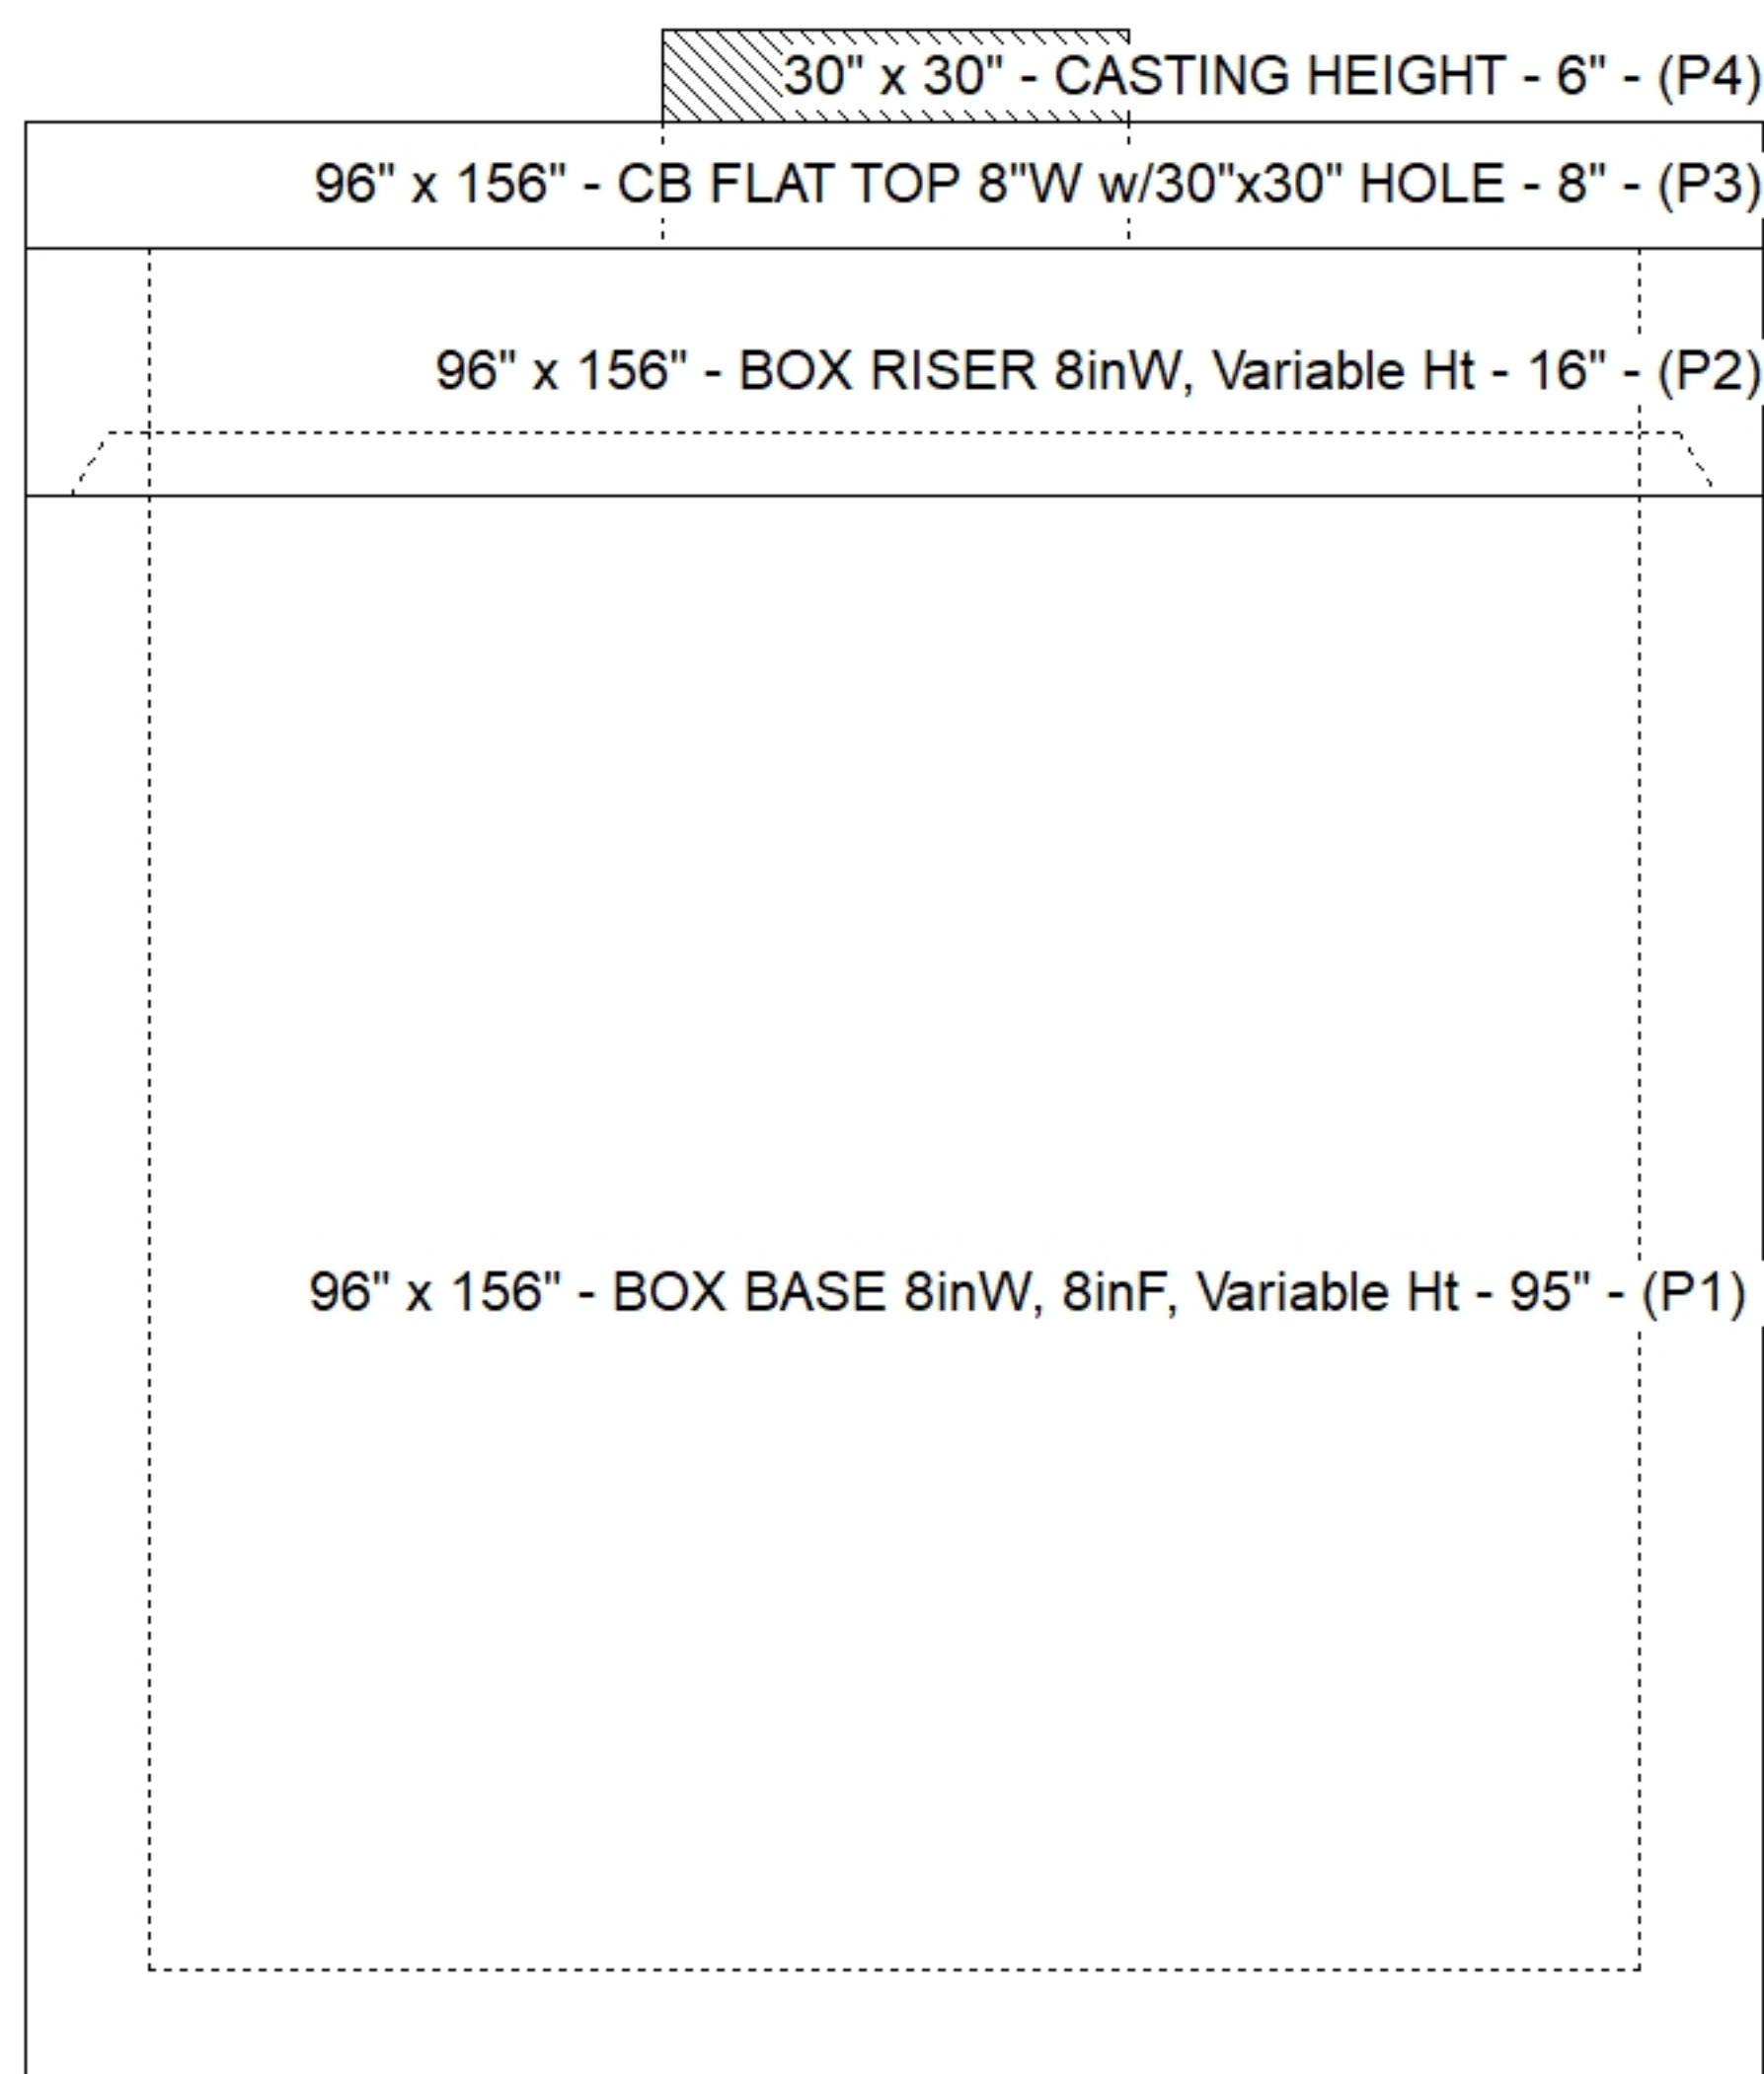

Default - Interior Dimensions

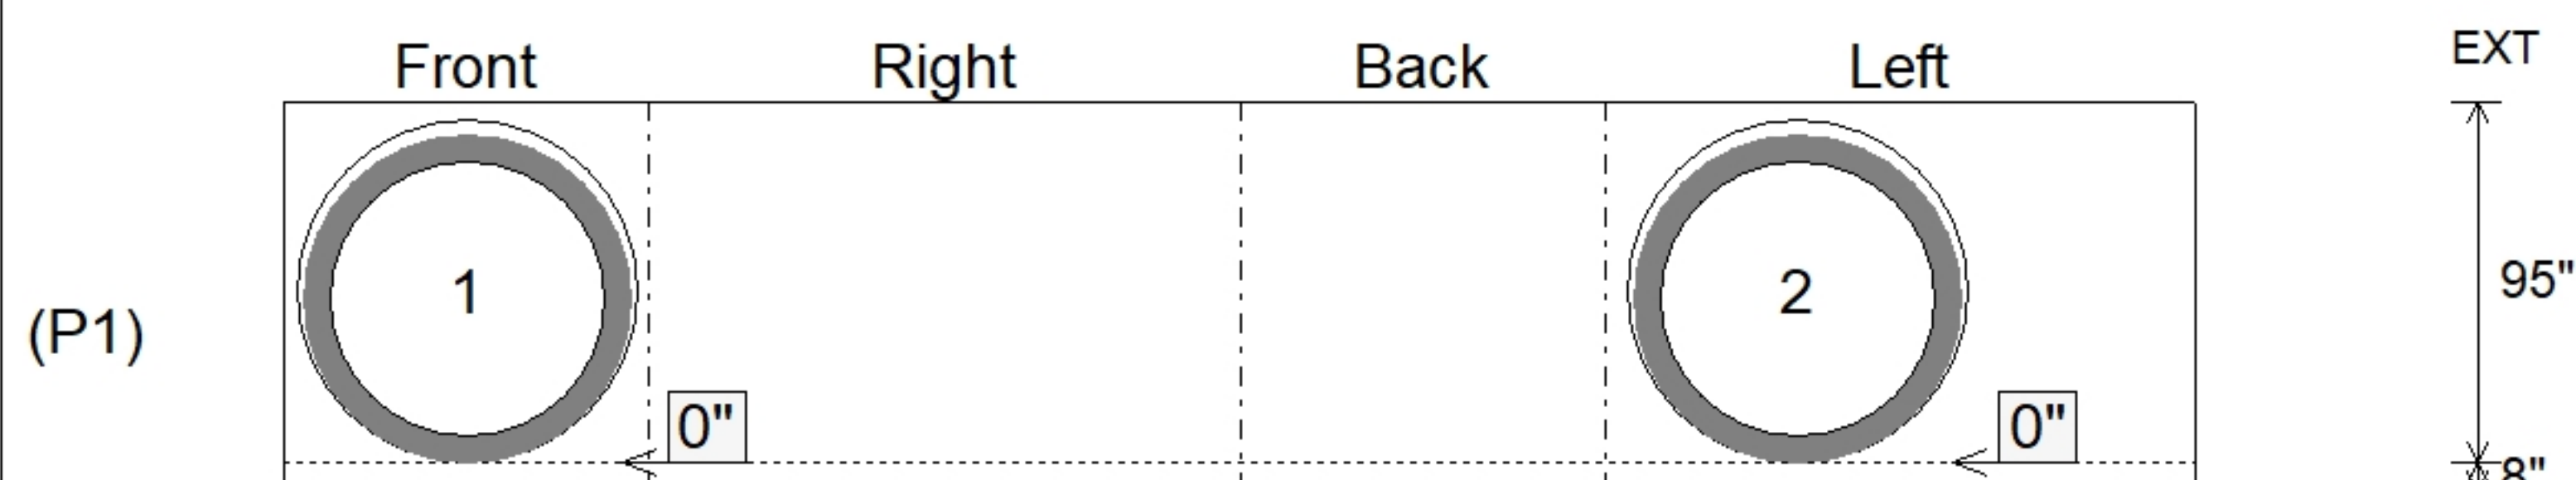

SUBMITTAL
APPROVED BY: