



GENERAL NOTES:

1. MANUFACTURED PER ASTM C-890-13 & ASTM C-913 SPECIFICATIONS
2. CONCRETE: 4,500 PSI AT 28 DAYS
3. REINFORCEMENT:
 - FLAT LID: #5 BAR @ 8" C.C. E.W. (GRADE 60)
 - BASE: #5 BAR @ 8" C.C. E.W. (GRADE 60)
 - BAFFLE WALL: #4 BAR @ 12" C.C. E.W. (GRADE 60)
4. WEIGHTS
 - 8" FLAT LID: 5,775 LBS
 - 4'-6" BASE: 16,120 LBS
 - 4" BAFFLE WALL: 975 LBS
 - TOTAL WEIGHT: 22,870 LBS
5. SEALED WITH PETROLEUM RESISTANT JOINT SEALANT (CONSEAL CS-440)
6. GRADE RINGS AVAILABLE UPON REQUEST

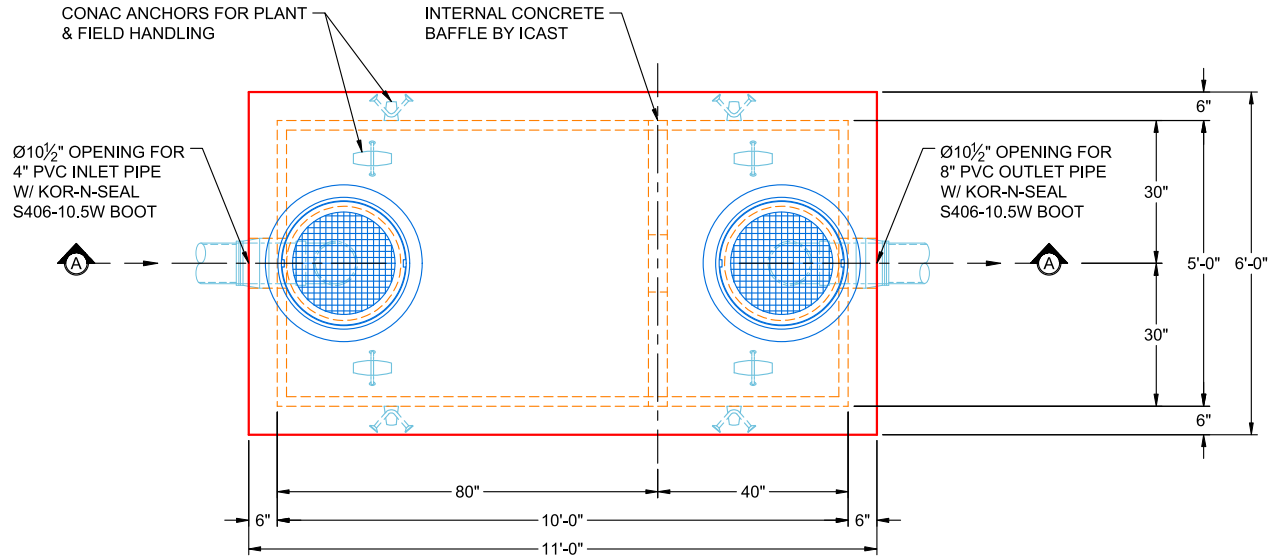

PLAN VIEW

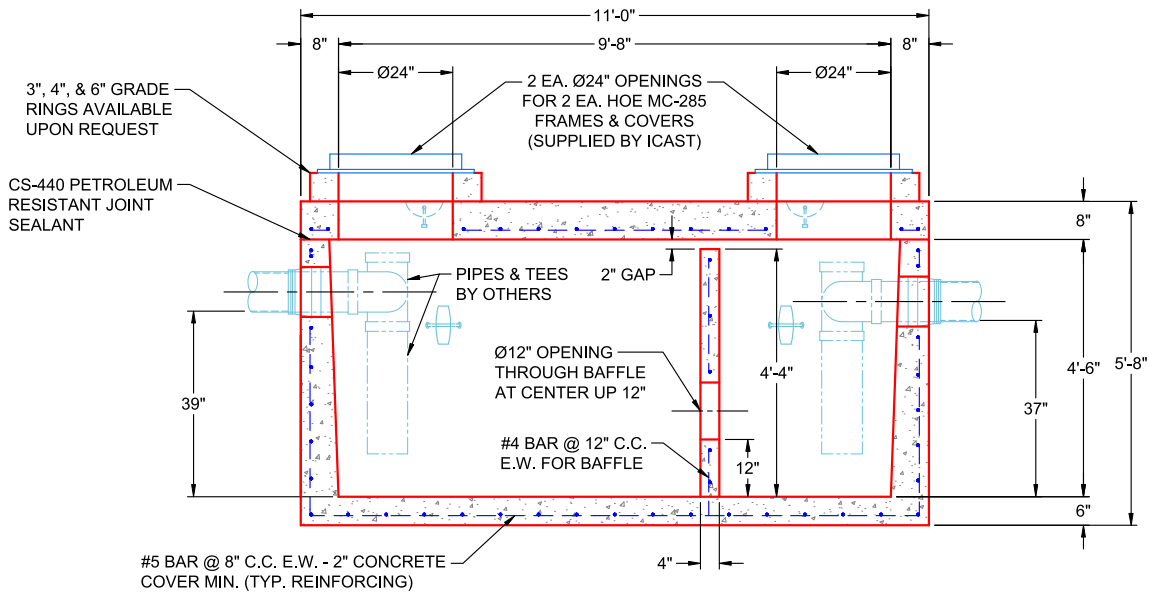

SECTION A-A

REVISIONS

REV. 0 DATE: NO REVISIONS TO DATE



SUBMITTAL DRAWING: 10' X 5' OWS (1,000 GAL)

CUSTOMER: BILL RISINGER CONSTRUCTION

PROJECT: JIMMY RISINGER CONSTRUCTION

STRUCTURE: 1000 GAL OWS

SALES ORDER NO: 26-2480

CHECKED BY: B. SMITH

DRAWN BY: K. CARDWELL

DATE: 06/08/26

SCALE: NTS

PG. 1 OF 1