




Job Name: 26-2509 - Airpark Expansion Industrial Subdivision Job Location: Owensboro, KY 42301 Contractor: Koberstein Contracting, Inc.					Plant: 100 7/20/2026 10:55:18 AM		Tech: Jared - F PC: A. Chambers			
Structure ID: CC-3 ST-CI										
P1 BX2436-08BA36 BOX BASE 8inW, 8inF F/n										
P2) 24" x 36" - CASTING HEIGHT - 6" P1) 24" x 36" - BOX BASE 8inW, 8inF F/n - 36" 1) CASTING - HOE 525 SET FLAT GRATE (F/G/H) 1) 24" x 36" - Conseal CS-102 1.00" 2) Hole - 32					0 lb 3990 lb 442 lb 0 lb 0 lb ----- Structure Total: 4432 lb		Structure Notes: . 1. PER ASTM C913 SPECIFICATIONS. 2. CONCRETE = 4,000 PSI AT 28 DAYS. 3. NO STEPS AND NO INVERT CHANNEL. 4. CASTING BY ICAST (HOE 525 SET FLAT GRATE (F/G/H)). REINFORCING PER ASTM A615 (GRADE 60). - WALLS (As .12) #5 BARS AT 12" C.C.E.W. - FLOOR (As .12) #5 BARS AT 12" C.C.E.W.			
Rim: 393.99' Rim to Invert: 3.31' Slack: 0.72" Sump: 3" Step Position:										
Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset
Invert 1	390.68'	90°	26"	24" RCP B WALL	30"	Hole 32	32"	32"	0"	0"
Invert 2	390.68'	270°	26"	24" RCP B WALL	30"	Hole 32	32"	32"	0"	0"
Invert 3										
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										

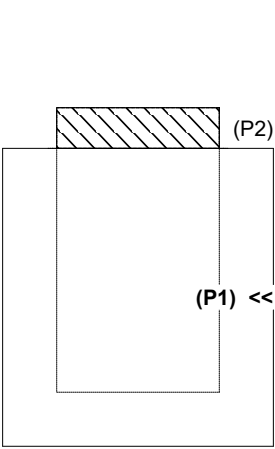

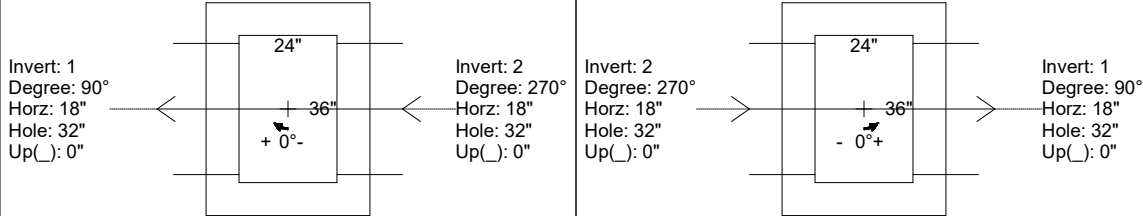

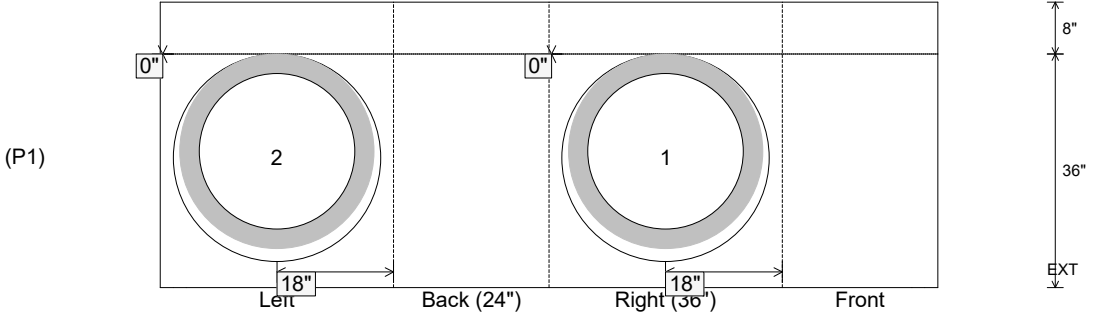

Coating (Int): Coating (Ext):	Seam Up: Flat Seam Dn: n/a	Wall Thickness: 8" Floor Height: 8"	Height (Int): 36" Height (Ext): 44"	Weight (Net): 3990 lb Volume (Net): 1.02cu.yd
----------------------------------	-------------------------------	--	--	--