
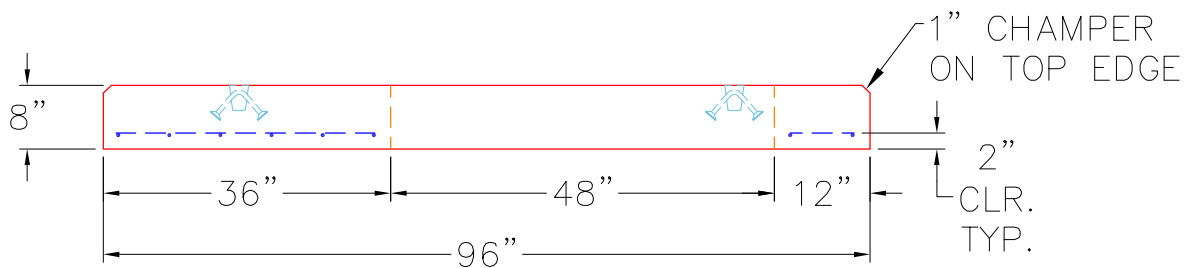


GENERAL NOTES:

1. MANUFACTURED TO ASTM C-913 (LATEST REVISION).
2. CONCRETE 4,000 PSI AT 28 DAYS.
3. REINFORCING: #4 BAR @ 8" C.C.E.W. BOTH WAYS
4. WEIGHT = 5,540 LBS

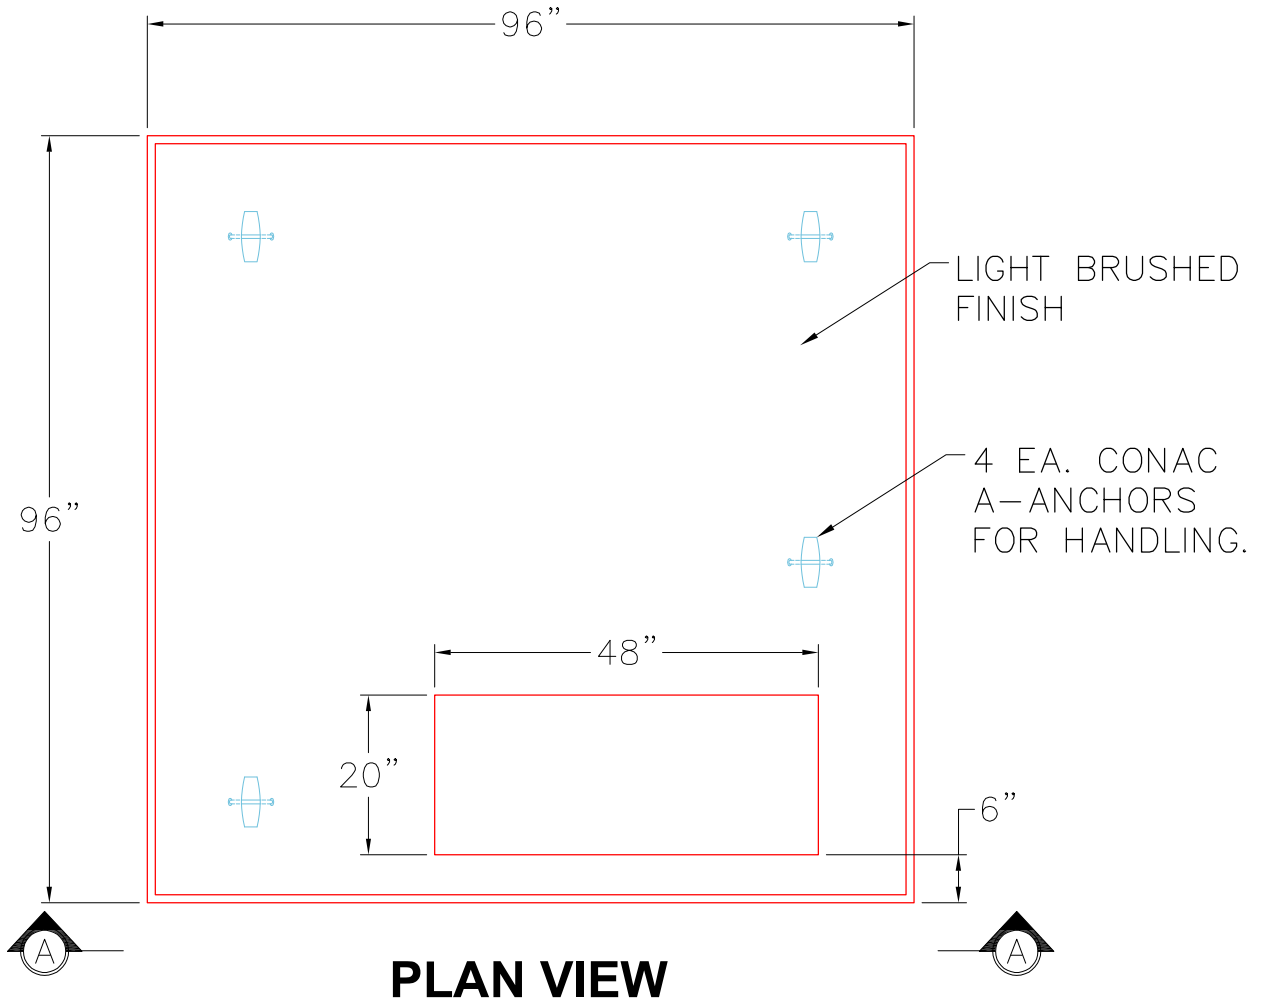

REVISION INFORMATION			SUBMITTAL DRAWING: 3000 KVA TRANSF PAD		
REV. 	DATE:		CUSTOMER: STEWART RICHEY		
	NO REVISIONS TO DATE		PROJECT: GOTTBRATH TRANSFORMER PAD		
			STRUCTURE: QL1		
			QUOTE/SALES ORDER NO: 26–2541		
			PC: T. LEWIS		DRAWN BY: S. FELLETER
			DATE: 06/03/26		SCALE: NTS
					PG. 1 of 1