

Job Name: 26-2560 Ashtree Subdivision Unit 3 Ph. 1
Job Location: Nicholasville, KY
Contractor: The Allen Company, Inc.

Plant: Beaver Dam
8/24/2026 8:12:13 AM

Tech: J. ROSS
PC: E. BRADLEY



Structure ID: CC4 LEXA

P3 CBITA10LEX-TL

CB INLET LEX A 10' TOP LEFT

- P3) 36" x 120" - CB INLET LEX A 10' TOP LEFT - 12"
P2) 36" x 120" - CB INLET LEX A 10' BOTTOM LEFT - 18"
P1) 36" x 36" - BOX BASE 8inW, 8inF - 24"
1) CASTING - HOE KY-206 F/C (KY CBI A)
1) 36" x 36" - Conseal CS-102 1.00"
1) 24" - Conseal CS-102 1.00"
2) Hole - 22
1) Hole - 6
3) MH Step ML-10-TDS-NCR - 10"


2700 lb
3650 lb
4174 lb
206 lb
0 lb
0 lb
0 lb
0 lb
0 lb
0 lb

Structure Total: 10730 lb

Structure Notes:

1. PER ASTM C913 SPECIFICATIONS.
2. CONCRETE = 4,000 PSI AT 28 DAYS.
3. REINFORCING PER ASTM A615 (GRADE 60).
 - TOP PHASE TOP - #5 BARS AT 6" C.C.E.W.
 - TOP PHASE BTM - #5 BARS AT 12" C.C.E.W.
 - TOP SLAB - #5 BARS AT 12" C.C.E.W..
 - RISER/WALLS - #5 BARS AT 12" C.C.E.W.
 - FLOOR - #5 BARS AT 12" C.C.E.W.
4. HOE KY-206 F/C CASTING PROVIDED BY ICAST

- GENERAL NOTES:**
1. MANUFACTURE PER LFUGG SPECIFICATIONS
 2. CONCRETE F'C = 4,500 PSI AT 28 DAYS.
 3. REINFORCING: #5 BAR @ 6" C/C E.W. (GRADE 60)
 4. TOP PHASE OVERALL HEIGHT NOT TO EXCEED 30"
 5. LIGHT BRUSH FINISH REQUIRED ON TOP SURFACE.

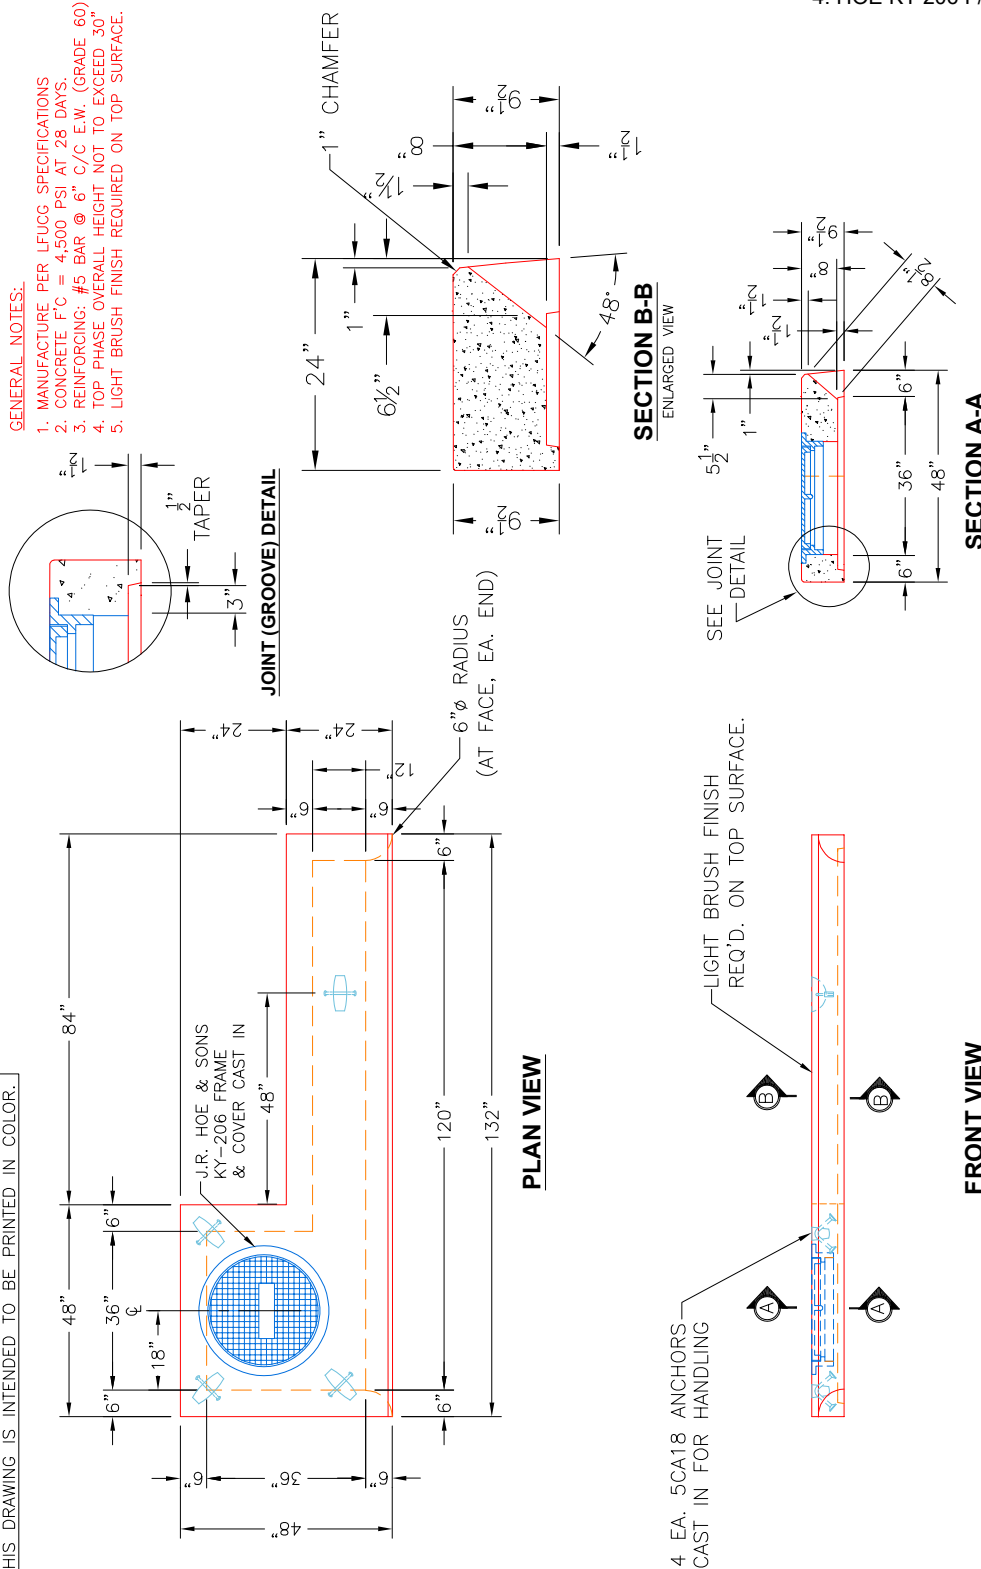

FRONT VIEW

PRODUCTION WORK ORDER

QUALITY CONTROL CHECKLIST	PRODUCT I.D.: CBITA10LEX-TL
☐ ALL DIMENSIONS CORRECT.	PRODUCT VIEW: RIGHT SIDE UP
☐ LIFTERS INSTALLED.	PLANT: BEAVER DAM, KY.
☐ LIGHT BRUSH FINISH ON TOP SURFACE.	WEIGHT: 2,700 LBS.
☐ REINFORCING CORRECT.	TOP JOINT: N/A
☐ CASTING CORRECT.	BOTTOM JOINT: SHIP-LAP GROOVE
☐ LFUGG THROAT CORRECT.	QC CHECK INITIALS:
☐ ALL PATCHWORK ACCEPTABLE.	



THIS DRAWING IS THE PROPERTY OF INFRASTRUCTURE PRECAST, INC. ANY USE OR DUPLICATION OF THIS DRAWING WITHOUT PRIOR AUTHORIZATION IS STRICTLY PROHIBITED.

THIS DRAWING IS INTENDED TO BE PRINTED IN COLOR.