

Job Name: 26-2560 Ashtree Subdivision Unit 3 Ph. 1
Job Location: Nicholasville, KY
Contractor: The Allen Company, Inc.

Plant: Beaver Dam
8/24/2026 8:12:17 AM

Tech: J. ROSS
PC: E. BRADLEY



Structure ID: EE1 LEXA

P3 CBITA10LEX-TL

CB INLET LEX A 10' TOP LEFT

- P3) 36" x 120" - CB INLET LEX A 10' TOP LEFT - 12"
P2) 36" x 120" - CB INLET LEX A 10' BOTTOM LEFT - 18"
P1) 36" x 36" - BOX BASE 8inW, 8inF - 30"
1) CASTING - HOE KY-206 F/C (KY CBI A)
1) 36" x 36" - Conseal CS-102 1.00"
1) 24" - Conseal CS-102 1.00"
2) Hole - 26
1) Hole - 6
4) MH Step ML-10-TDS-NCR - 10"


2700 lb
3650 lb
4680 lb
206 lb
0 lb
0 lb
0 lb
0 lb
0 lb
0 lb

Structure Total: 11236 lb

Structure Notes:

- PER ASTM C913 SPECIFICATIONS.
- CONCRETE = 4,000 PSI AT 28 DAYS.
- REINFORCING PER ASTM A615 (GRADE 60).
 - TOP PHASE TOP - #5 BARS AT 6" C.C.E.W.
 - TOP PHASE BTM - #5 BARS AT 12" C.C.E.W.
 - TOP SLAB - #5 BARS AT 12" C.C.E.W.
 - RISER/WALLS - #5 BARS AT 12" C.C.E.W.
 - FLOOR - #5 BARS AT 12" C.C.E.W.
- HOE KY-206 F/C CASTING PROVIDED BY ICAST

- GENERAL NOTES:**
- MANUFACTURE PER LFUGG SPECIFICATIONS
 - CONCRETE F'C = 4,500 PSI AT 28 DAYS.
 - REINFORCING: #5 BAR @ 6" C/C E.W. (GRADE 60)
 - TOP PHASE OVERALL HEIGHT NOT TO EXCEED 30"
 - LIGHT BRUSH FINISH REQUIRED ON TOP SURFACE.

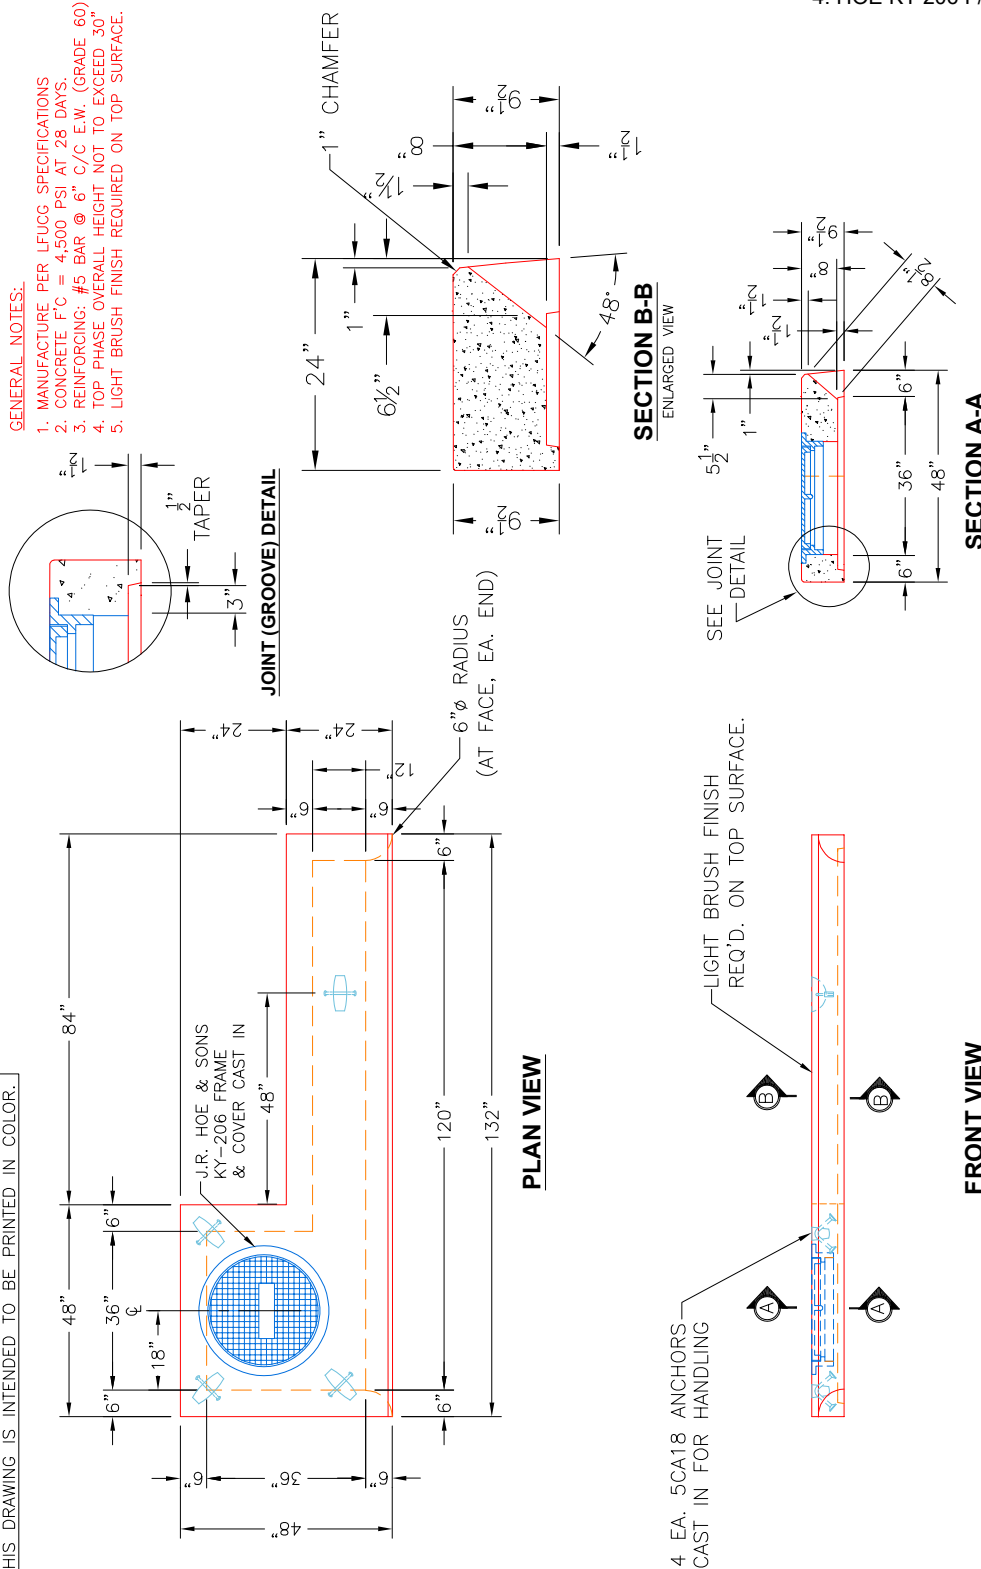

FRONT VIEW

PRODUCTION WORK ORDER

QUALITY CONTROL CHECKLIST	PRODUCT I.D.: CBITA10LEX-TL
☐ ALL DIMENSIONS CORRECT.	PRODUCT VIEW: RIGHT SIDE UP
☐ LIFTERS INSTALLED.	PLANT: BEAVER DAM, KY.
☐ LIGHT BRUSH FINISH ON TOP SURFACE.	WEIGHT: 2,700 LBS.
☐ REINFORCING CORRECT.	TOP JOINT: N/A
☐ CASTING CORRECT.	BOTTOM JOINT: SHIP-LAP GROOVE
☐ LFUGG THROAT CORRECT.	QC CHECK INITIALS:
☐ ALL PATCHWORK ACCEPTABLE.	



THIS DRAWING IS THE PROPERTY OF INFRASTRUCTURE PRECAST, INC. ANY USE OR DUPLICATION OF THIS DRAWING WITHOUT PRIOR AUTHORIZATION IS STRICTLY PROHIBITED.