
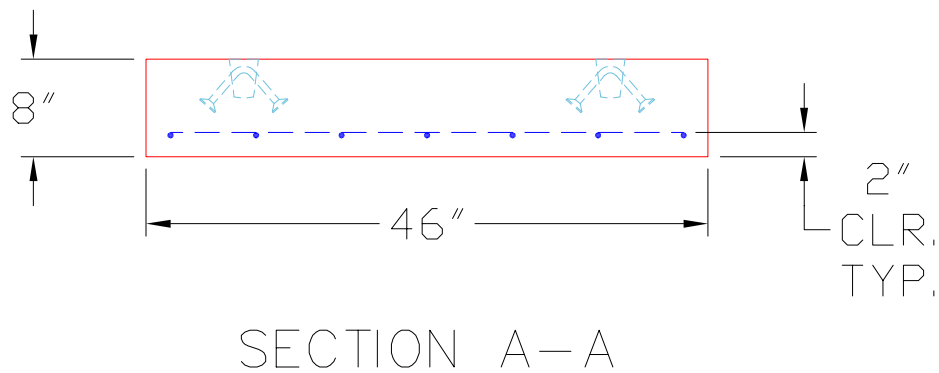


THIS DRAWING IS INTENDED TO BE PRINTED IN COLOR.

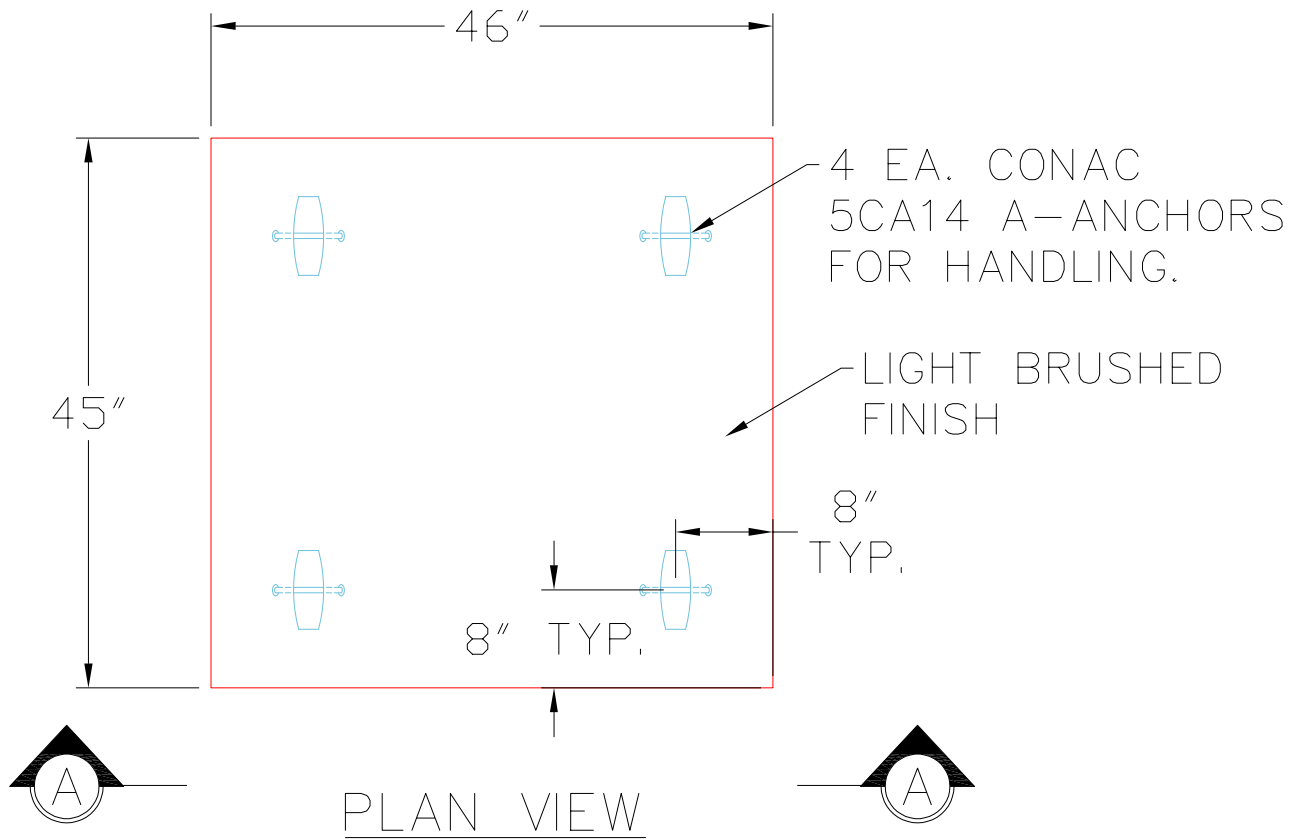

NOTES:

1. MANUFACTURED TO ASTM C-478 (LATEST REVISION).
2. CONCRETE: 5,000 PSI AT 28 DAYS.
3. REINFORCING: #5 BAR @ 6" C.C. E.W. (GRADE 60).

PRODUCTION WORK ORDER		PRODUCT I.D.: CTS	DESCRIPTION: 45" X 46" X 8" TOP SLAB	
	QUALITY CONTROL CHECKLIST		CUSTOMER: CLEARY CONSTRUCTION	
	☐ ALL DIMENSIONS CORRECT.		PROJECT: CNZ216	
	☐ LIFTERS INSTALLED.		STRUCTURE: QL1	
	☐ HOLE LOCATION CORRECT.		QUOTE/SALES ORDER NO: 26-2624	
	☐ REINFORCING CORRECT.		PC: T. RYAN	
	☐ FINISH ON SLAB SURFACE UNIFORM.		DRAWING: S. FELLETER	
	☐ OUTSIDE TOP EDGE TROWELLED.		DATE: 06/09/26	
☐ FLAT BOTTOM.		QC CHECK INITIALS:	SCALE: NTS	PG. 1 of 1