



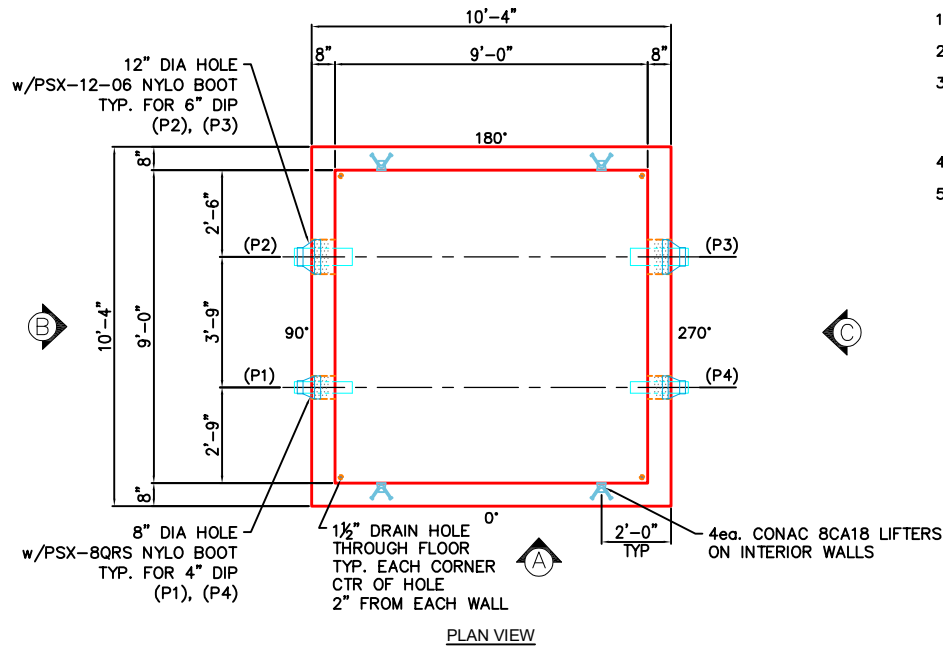


NOTES:

1. MANUFACTURED PER ASTM C913 SPECIFICATIONS.
2. CONCRETE = 5,000 PSI AT 28 DAYS.
3. REINFORCING PER ASTM A615 (GRADE 60).
 - TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W
 - WALLS (As .47) #5 BARS AT 8" C.C.E.W
 - FLOOR (As .47) #5 BARS AT 8" C.C.E.W
4. NO STEPS OR LADDER REQUIRED.
5. HATCHES SUPPLIED BY OTHERS:
 HATCH 1 = HALLIDAY W1S 60"x30" WITH SKIRT FOR 10" SLAB.
 HATCH 2 = HALLIDAY W2S 60"x42" WITH SKIRT FOR 10" SLAB.


1ST POUR (FLOOR).....10,320 LBS
 2ND POUR (WALLS).....28,035 LBS
 TOTAL WEIGHT.....38,355 LBS

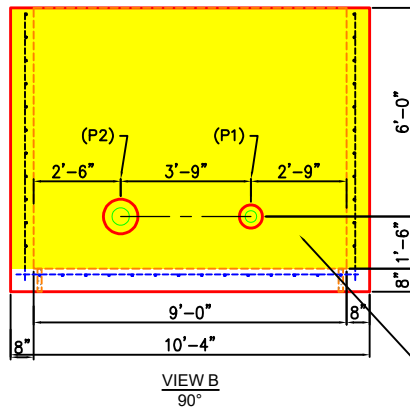

2ND POUR (WALLS)

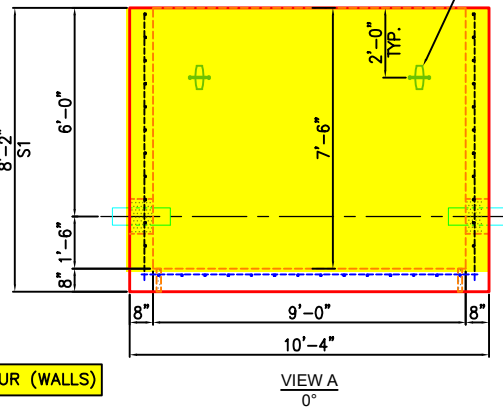

4ea. CONAC 8CA18 LIFTERS
ON INTERIOR WALLS

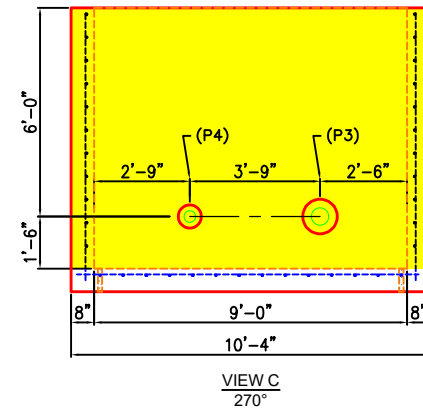

PRODUCTION WORK ORDER



QUALITY CONTROL CHECKLIST

- ☐ ALL DIMENSIONS CORRECT.
- ☐ LIFTERS INSTALLED.
- ☐ STEPPED HF CORRECT SIZE.
- ☐ REINFORCING CORRECT.
- ☐ SURFACE QUALITY ACCEPTABLE.
- ☐ EDGES CHAMFERED.
- ☐ ALL PATCHWORK ACCEPTABLE.

PRODUCT I.D.: BX108108-08BAVF

PRODUCT VIEW: RIGHT-SIDE UP

PLANT: BEAVER DAM, KY.

WEIGHT: 38,355 LBS

TOP SECTION JOINT: FLAT

BASE SECTION JOINT: N/A

QC CHECK INITIALS:

DESCRIPTION: BOX BASE 108"x108"x88" (8"W/8"F)

CUSTOMER: CORE & MAIN LP (MURFREESBORO)

PROJECT: FRANKLIN SENIOR LIVING VAULT

STRUCTURE ID.: QL2 MV

SALES ORDER NO: 26-2773

CHECK: B. SMITH

DRAWING: J. HORSLEY

DATE: 09/18/26

SCALE: NTS

PG. 1A of 1