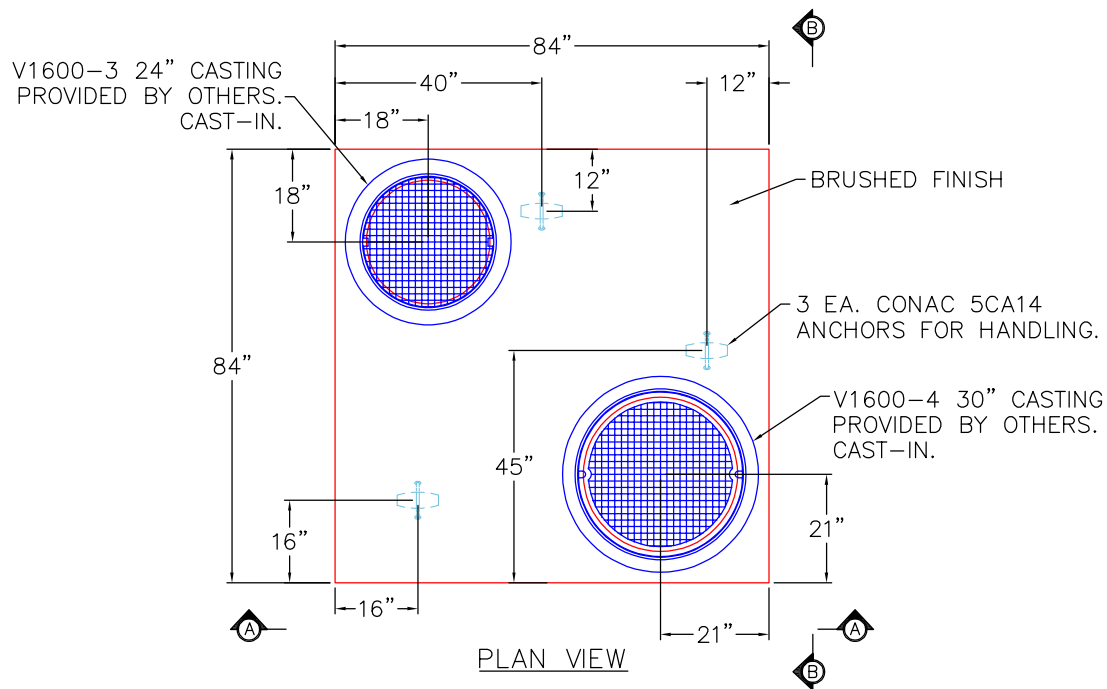


GENERAL NOTES:

1. MANUFACTURED TO ASTM C-913 (LATEST REVISION).
2. CONCRETE: 5,000 PSI AT 28 DAYS. CONCRETE.
3. REINFORCING: PER ASTM A615 (GRADE 60).
- TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W.
4. WEIGHT = 3,959 LBS
5. CASTINGS PROVIDED BY OTHERS (EJ V1600-3 & V1600-4 F/C). TO BE CAST-IN TOP SLAB.
6. VAULT JOINT TO BE SEALED WITH CONCRETE SEALANTS, INC. CS-102 ROLL BUTYL MASTIC. (SUPPLIED BY ICAST).

PRODUCTION WORK ORDER

PRODUCT I.D.: BX072072-06LD08S

DESCRIPTION: 84" X 84" X 7 1/4" VAULT TOP SLAB



QUALITY CONTROL CHECKLIST

- ☐ ALL DIMENSIONS CORRECT.
- ☐ LIFTERS INSTALLED.
- ☐ HATCH INSTALLED CORRECT.
- ☐ REINFORCING CORRECT.
- ☐ SURFACE QUALITY ACCEPTABLE.
- ☐ EDGES CHAMFERED.
- ☐ ALL PATCHWORK ACCEPTABLE.

PRODUCT VIEW: RIGHT SIDE UP

CUSTOMER: CONTECH ENGINEERING SOLUTIONS

PLANT: BEAVER DAM, KY.

PROJECT: 868959 COOK OUT

WEIGHT: 3,959 LBS.

STRUCTURE: 10-KFPD0606

TOP SECTION JOINT: N/A

ORDER NO: 26-2789

BASE SECTION JOINT: N/A

PC: C. GOFF

DRAWING: S. FELLETER

QC CHECK INITIALS:

DATE: 06/25/26

SCALE: NTS

PG. 1 of 1