
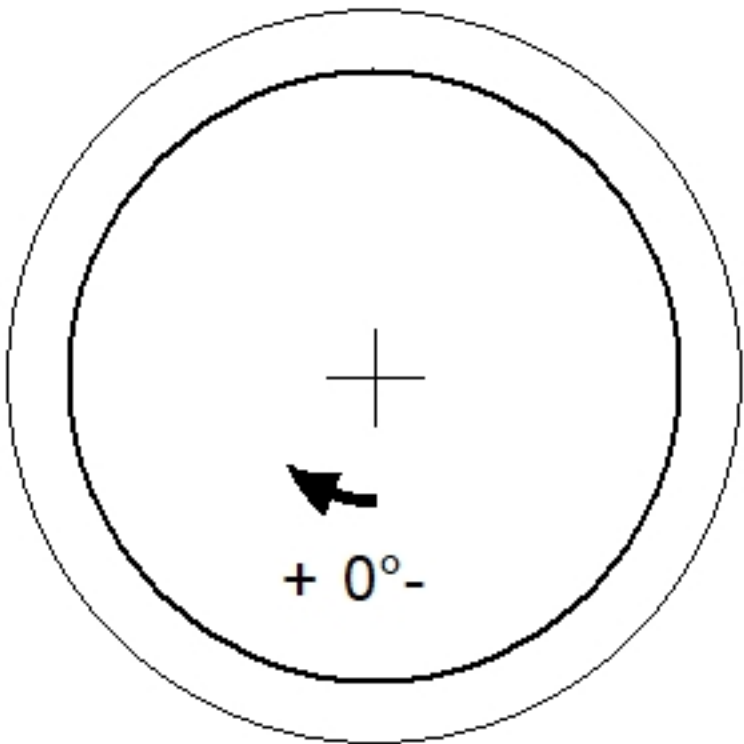
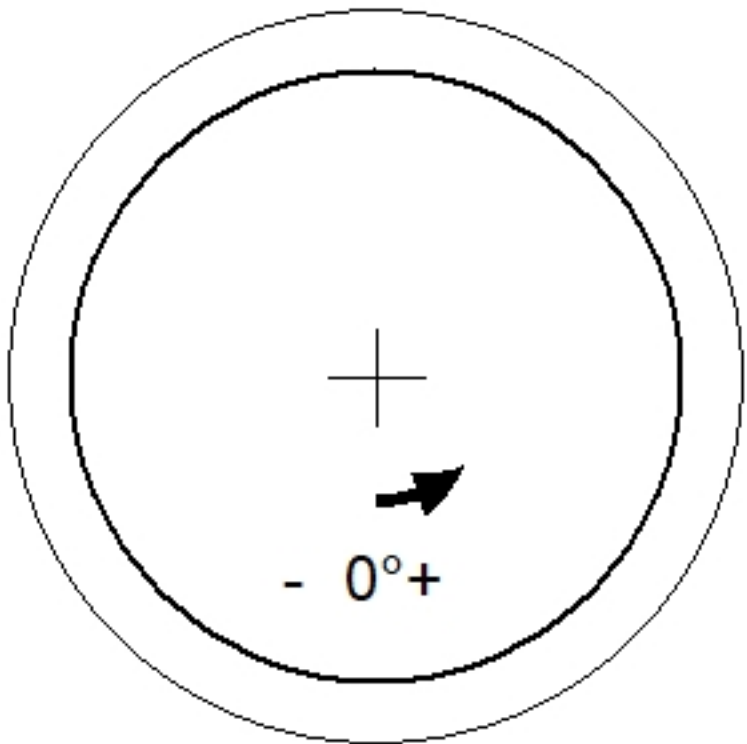


Job Name: 26-3134 ADS Park Community Credit Union Job Location: Louisville, KY Contractor: ADS Advanced Drainage Systems, Inc.					Plant: Beaver Dam 8/28/2026 8:11:32 AM		Tech: S. Felletter PC: T. Ryan						
Structure ID: WQU1													
P1		MH060BA18		MH BASE T/n									
P5) 24" - CASTING HEIGHT - 7" P4) 60" - MH FLAT TOP w/24" Ctr. Hole F/F - 8" P3) 60" - MH RISER SPECIAL F/G - 48" P2) 60" - MH RISER T/G - 36" P1) 60" - MH BASE T/n - 18" 1) ASSEMBLY REQUIRED 1) JOINT WRAP - 0.065"x6"x50' CONSEAL CS212 1) JOINT WRAP PRIMER - CONSEAL CS-75 (1 gal.) 3) 60" - Conseal CS-102 1.00" (Double) 1) 24" - Conseal CS-102 1.00" (Double) 2) Hole - 20						0 lb 2429 lb 4570 lb 3758 lb 4612 lb 0 lb 0 lb 0 lb 0 lb 0 lb 0 lb ----- 15370 lb		Structure Notes: . 1. PER ASTM C478 SPECIFICATIONS. 2. CONCRETE = 4,000 PSI AT 28 DAYS. 3. CASTING BY ICAST (HOE MC-375 F/C "STORM"). 4. LIFTING ANCHORS TO BE INSTALLED ON THE OUTSIDE OF THE STRUCTURE. 5. P2 & P3 RISERS TO BE MECHANICALLY ATTACHED PRIOR TO INTERNAL INTALLATION/DELIVERY. . REINFORCING PER ASTM A615 (GRADE 60). - TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W. - RISER/WALLS (As .18) - FLOOR (As .37) #5 BARS AT 10" C.C.E.W.					
Rim: 507.3'		Rim to Invert: 3.02'		Slack: 0.24"		Sump: 81"		Step Position:					
Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up (⌋)	Offset			
Invert 1													
Invert 2													
Invert 3													
Invert 4													
Invert 5													
Invert 6													
Invert 7													
Invert 8													
(P5) (P4) (P3) (P2) (P1) << RIGHT-SIDE UP VIEW (int. dimensions)  UPSIDE-DOWN VIEW (int. dimenions) 													

INSIDE WALL DIMENSIONS

(P1)

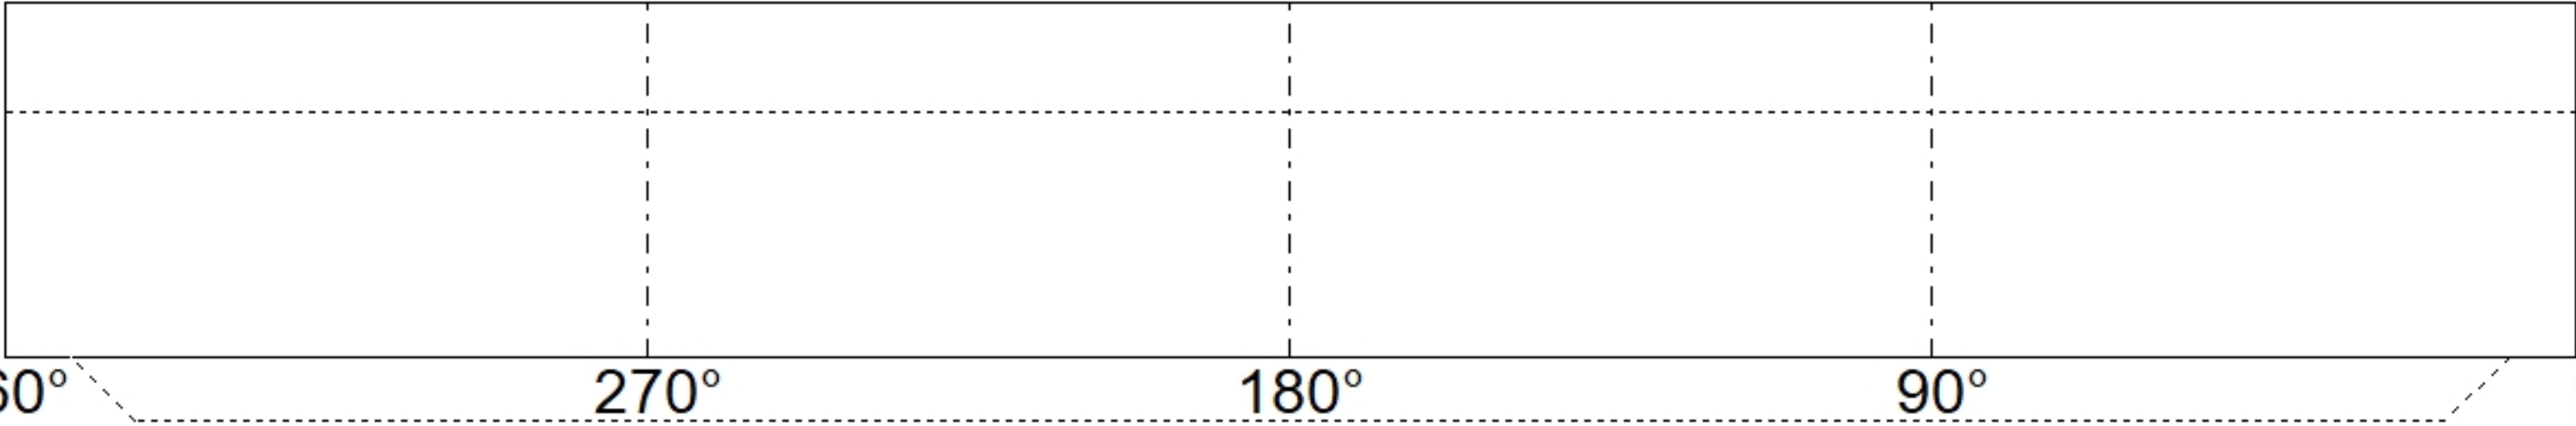

8"

18"

EXT