
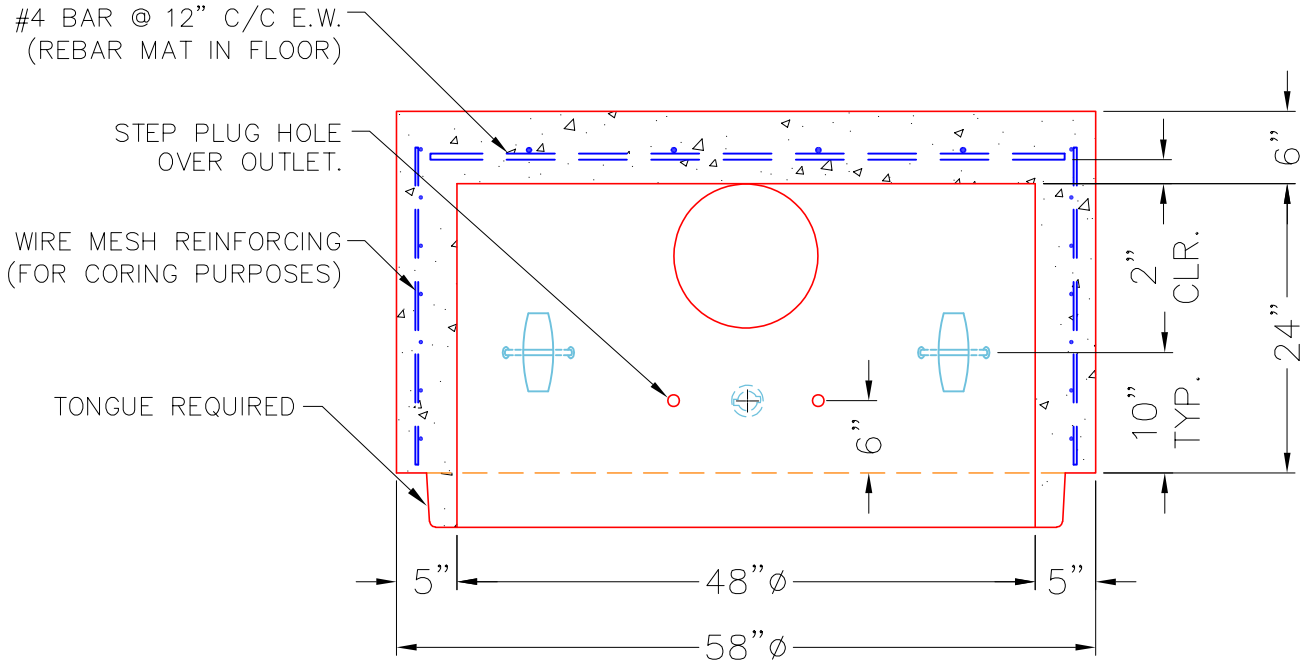


- NOTES:
- 1. MANUFACTURE TO ASTM C-478 (LATEST REVISION).
 - 2. CONCRETE: 4,000 PSI AT 28 DAYS (MINIMUM).
 - 3. REINFORCING: WWF MESH—USE STANDARD FOR WALLS.
#4 BAR @ 12" C/C E.W. FOR FLOOR.
 - 4. STEP PLUG TO BE INSTALLED OVER THE OUTLET HOLE.

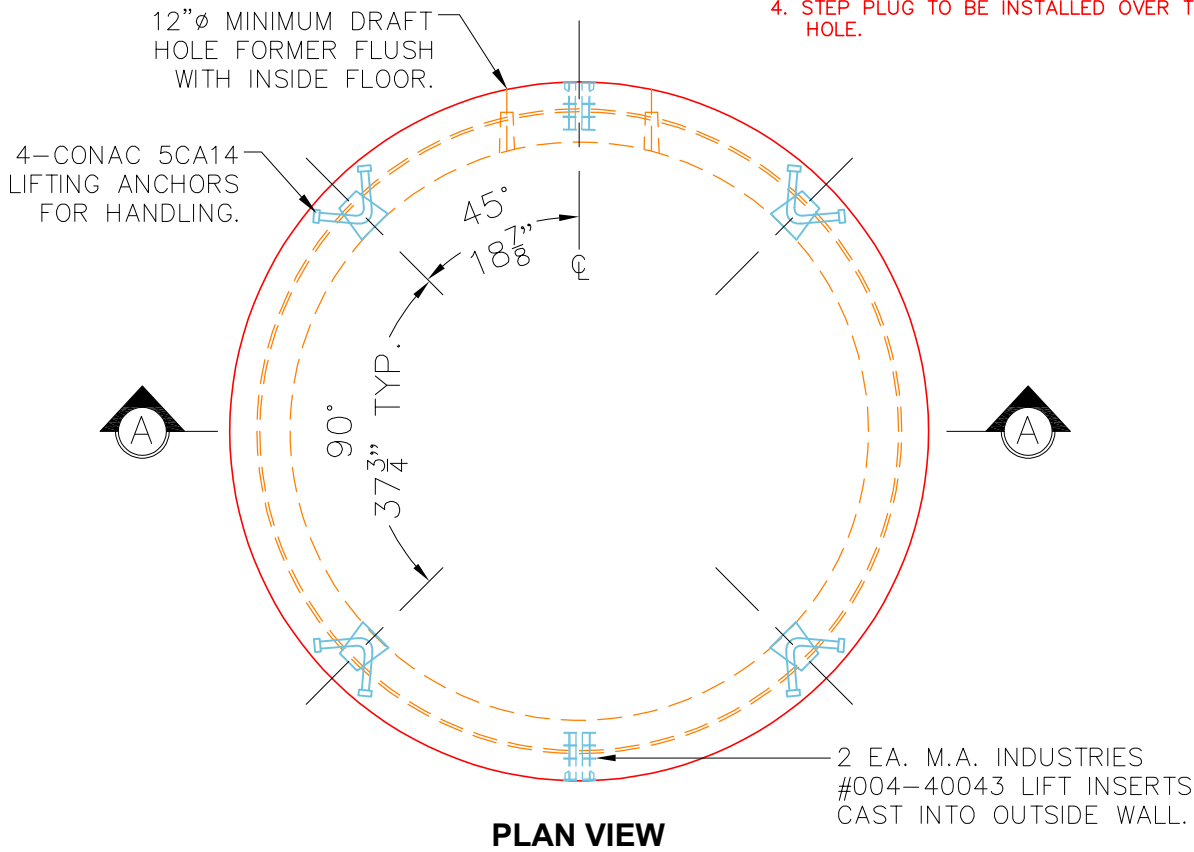

SECTION A-A

PRODUCTION WORK ORDER		PRODUCT ID.:	DESCRIPTION:
		MH048BA24-B	MANHOLE 48"Ø X 24" BLANK BASE
	QUALITY CONTROL CHECKLIST		CUSTOMER: STOCK
	☐ ALL DIMENSIONS CORRECT.		PROJECT: STOCK
	☐ LIFTERS INSTALLED.		STRUCTURE ID.: 48"Ø X 24" BLANK BASE
	☐ HOLE FORMER INSTALLED.		SALES ORDER NO.: N/A
	☐ STEP PLUG INSTALLED.		CHK.: J.H. ROSS, PE
	☐ HEIGHT CORRECT.		DRAWING: N. RICHARDS
☐ REINFORCING & SPACING CORRECT.		DATE: 1/31/24	SCALE: NTS
☐ TONGUE JOINT INSTALLED.		QC CHECK INITIALS:	PG. 1 of 1